

TEST REPORT

September 03, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	02/09/24
Date of Analysis:	03/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1198	Redevelopment Works – Location 1	0710	1606	536	2.0	100	0	<0.01
70836 – 1199	Redevelopment Works – Location 2	0708	1605	537	2.0	100	0	<0.01
70836 – 1200	Redevelopment Works – Location 3	0707	1603	536	2.0	100	0	<0.01
70836 – 1201	Red4velopment Works – Location 4	0718	1615	537	2.0	100	0	<0.01
70836 – 1202	Redevelopment Works – Location 5	0714	1610	536	2.0	100	0	<0.01
70836 – 1203	Redevelopment Works – Location 6	0707	1557	530	2.0	100	0	<0.01
70836 – 1204	Redevelopment Works – Location 7	0705	1555	530	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

TEST REPORT

September 04, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	03/09/24
Date of Analysis:	04/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1205	Redevelopment Works – Location 1	0714	1530	496	2.0	100	0	<0.01
70836 – 1206	Redevelopment Works – Location 2	0712	1527	495	2.0	100	0	<0.01
70836 – 1207	Redevelopment Works – Location 3	0710	1526	496	2.0	100	0	<0.01
70836 – 1208	Red4velopment Works – Location 4	0721	1534	493	2.0	100	0	<0.01
70836 – 1209	Redevelopment Works – Location 5	0718	1533	495	2.0	100	0	<0.01
70836 – 1210	Redevelopment Works – Location 6	0704	1523	499	2.0	100	0	<0.01
70836 – 1211	Redevelopment Works – Location 7	0702	1522	500	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

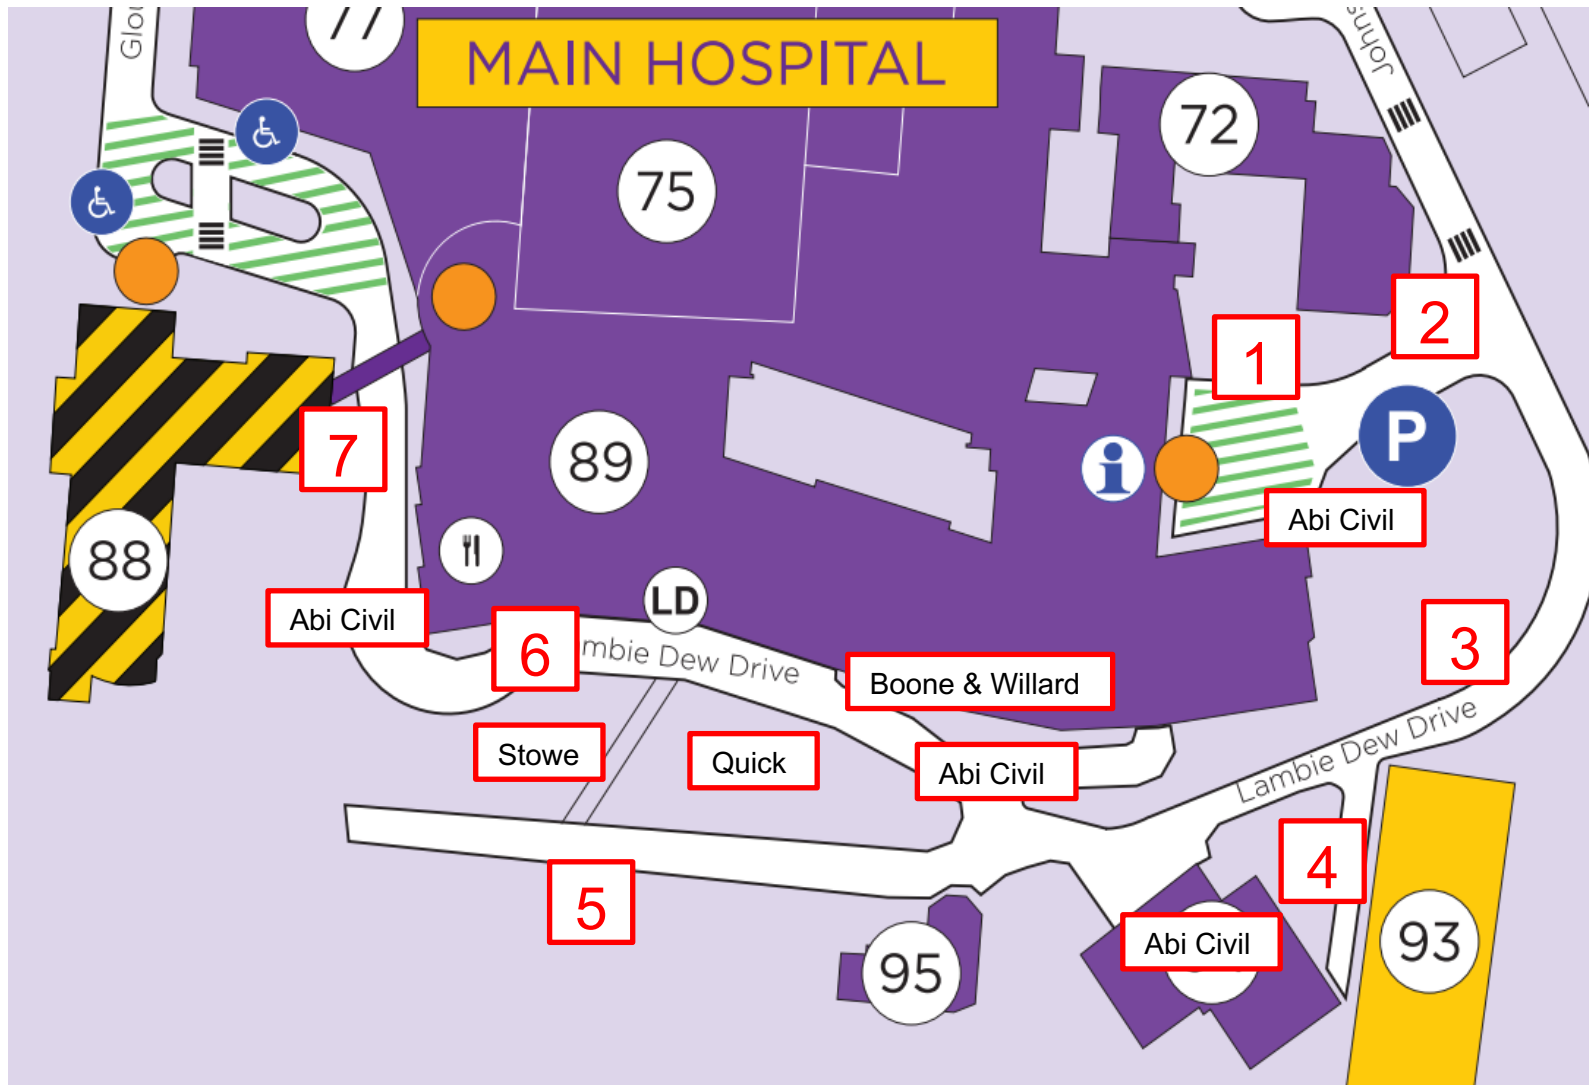


Figure 1. Air Monitoring Location.

TEST REPORT

September 05, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	04/09/24
Date of Analysis:	05/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1212	Redevelopment Works – Location 1	0716	1459	463	2.0	100	0	<0.01
70836 – 1213	Redevelopment Works – Location 2	0715	1500	465	2.0	100	2	<0.01
70836 – 1214	Redevelopment Works – Location 3	0714	1505	471	2.0	100	0	<0.01
70836 – 1215	Red4velopment Works – Location 4	0727	1506	459	2.0	100	0	<0.01
70836 – 1216	Redevelopment Works – Location 5	0722	1502	460	2.0	100	1	<0.01
70836 – 1217	Redevelopment Works – Location 6	0712	1514	482	2.0	100	0	<0.01
70836 – 1218	Redevelopment Works – Location 7	0710	1515	485	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

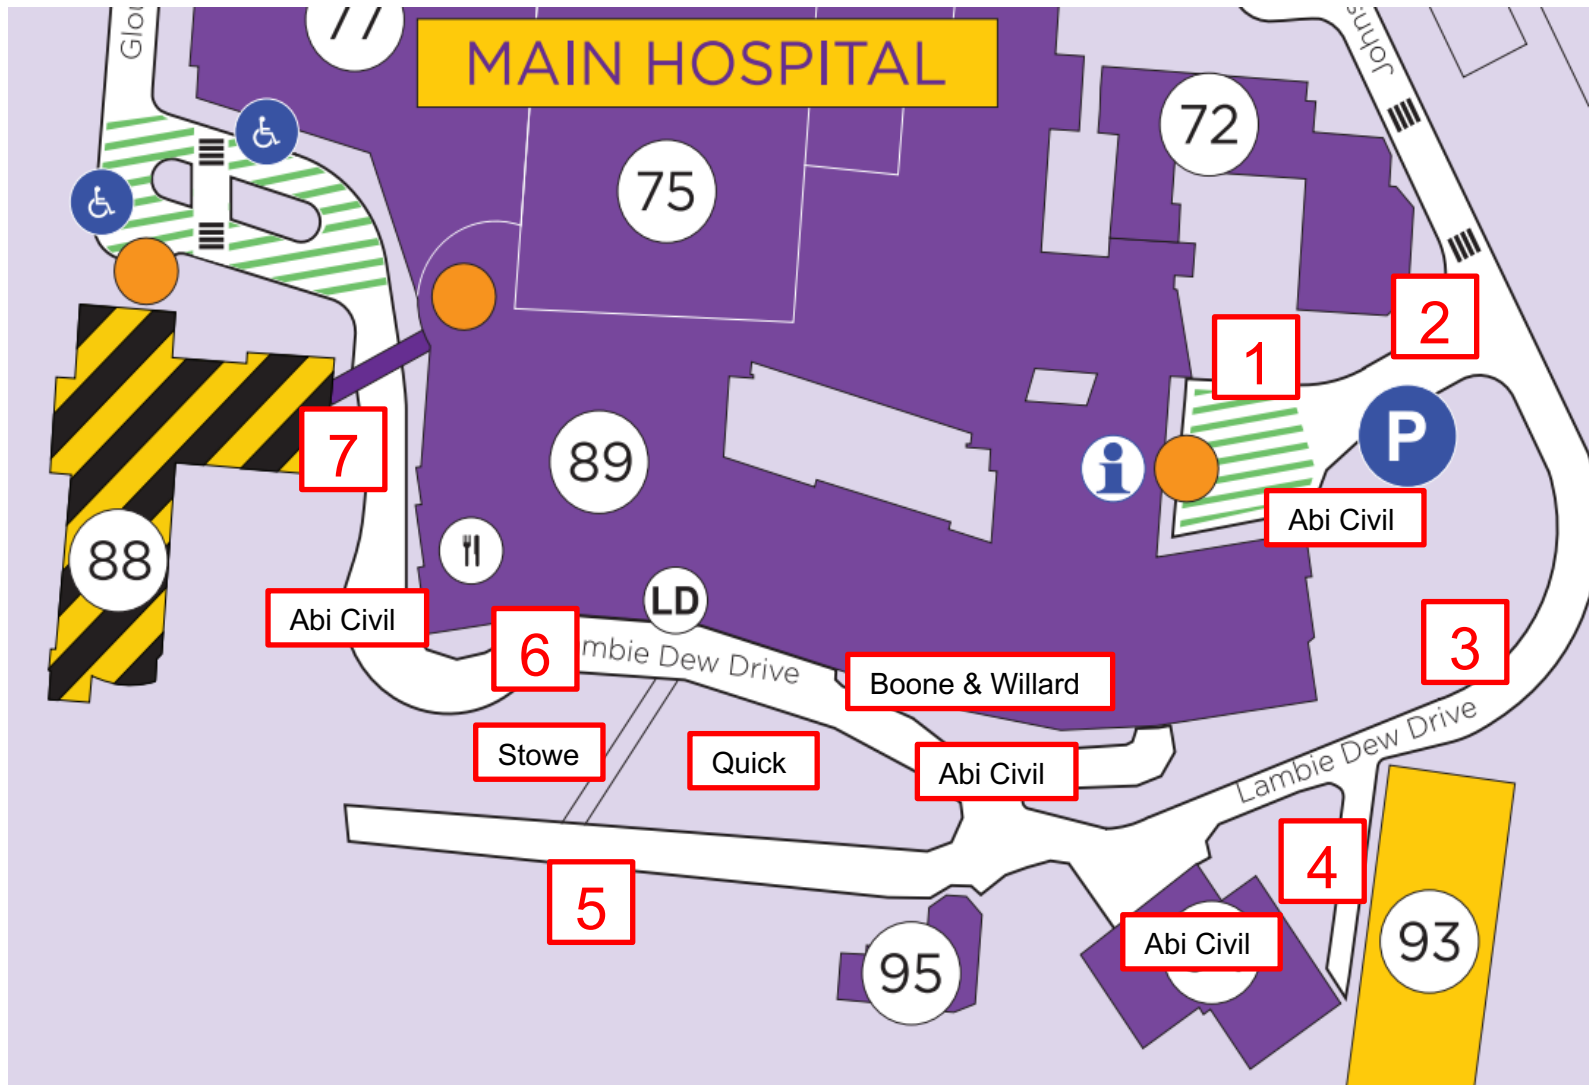


Figure 1. Air Monitoring Location.

TEST REPORT

September 06, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	05/09/24
Date of Analysis:	06/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1219	Redevelopment Works – Location 1	0639	1609	570	2.0	100	0	<0.01
70836 – 1220	Redevelopment Works – Location 2	0640	1608	568	2.0	100	0	<0.01
70836 – 1221	Redevelopment Works – Location 3	0641	1607	566	2.0	100	0	<0.01
70836 – 1222	Red4velopment Works – Location 4	0651	1606	555	2.0	100	0	<0.01
70836 – 1223	Redevelopment Works – Location 5	0647	1613	566	2.0	100	0	<0.01
70836 – 1224	Redevelopment Works – Location 6	0655	1602	547	2.0	100	0	<0.01
70836 – 1225	Redevelopment Works – Location 7	0657	1601	544	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

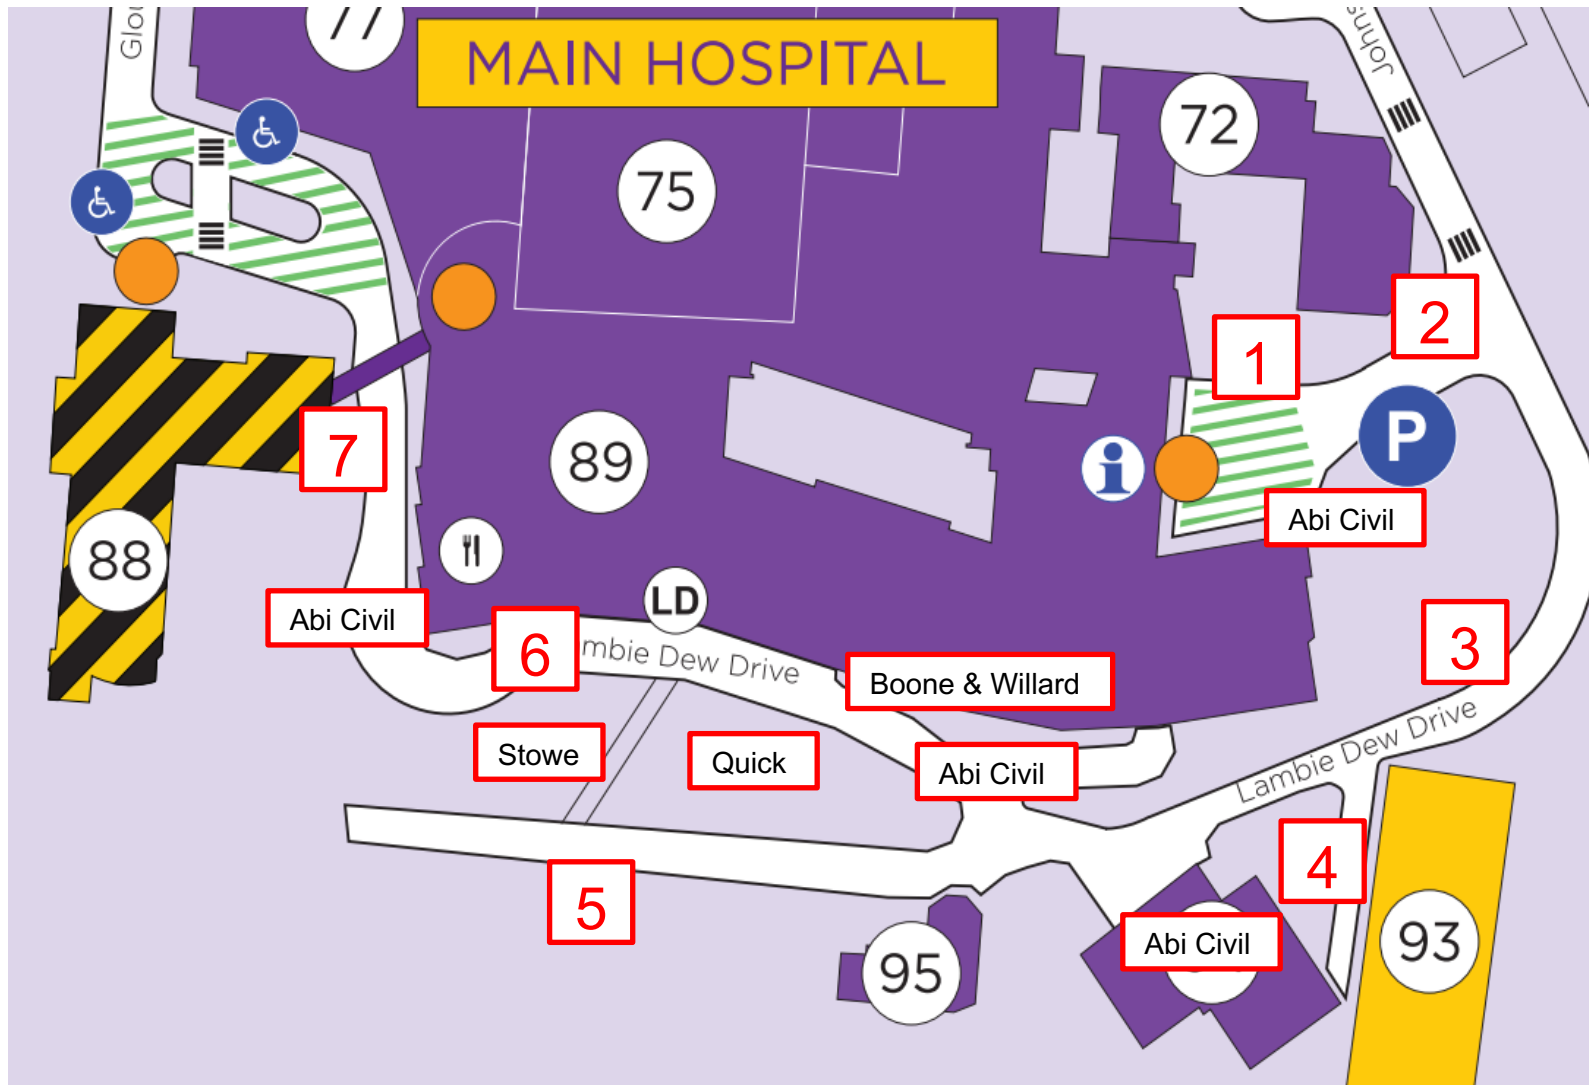


Figure 1. Air Monitoring Location.

TEST REPORT

September 09, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	06/09/24
Date of Analysis:	09/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1226	Redevelopment Works – Location 1	0716	1455	459	2.0	100	0	<0.01
70836 – 1227	Redevelopment Works – Location 2	0714	1456	462	2.0	100	0	<0.01
70836 – 1228	Redevelopment Works – Location 3	0712	1458	466	2.0	100	0	<0.01
70836 – 1229	Red4velopment Works – Location 4	0713	1459	466	2.0	100	0	<0.01
70836 – 1230	Redevelopment Works – Location 5	0721	1505	464	2.0	100	0	<0.01
70836 – 1231	Redevelopment Works – Location 6	0704	1510	486	2.0	100	0	<0.01
70836 – 1232	Redevelopment Works – Location 7	0706	1511	485	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

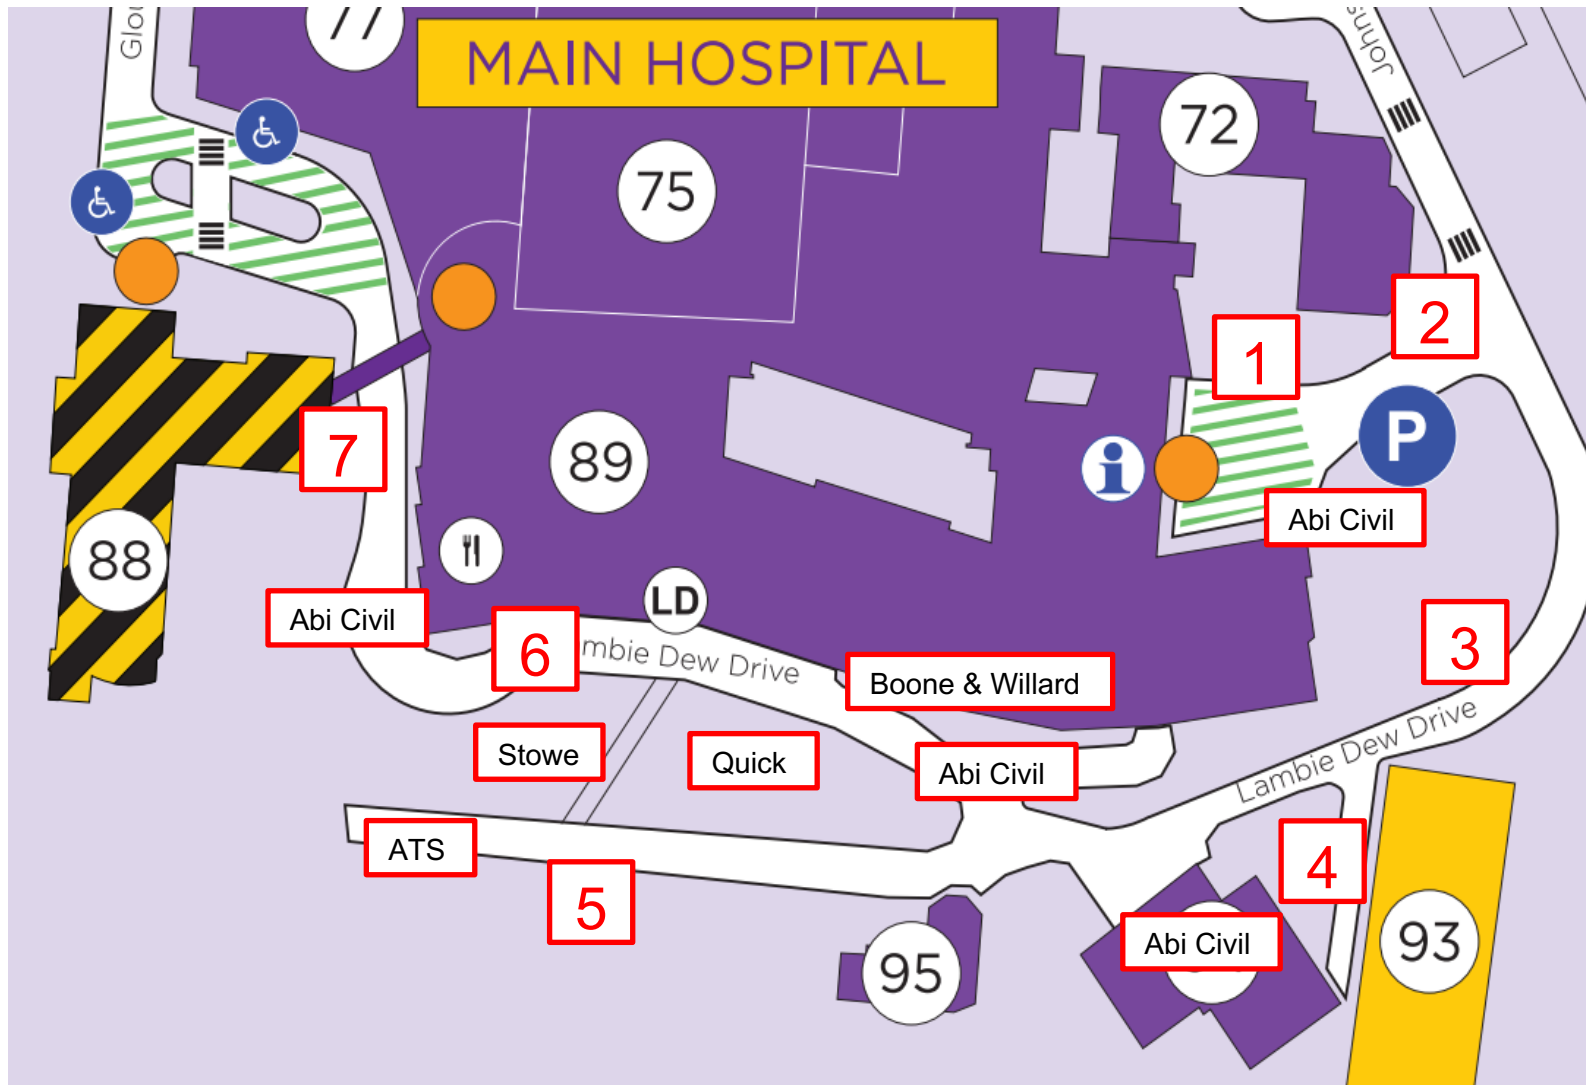


Figure 1. Air Monitoring Location.

TEST REPORT

September 10, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	09/09/24
Date of Analysis:	10/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1233	Redevelopment Works – Location 1	0708	1542	514	2.0	100	0	<0.01
70836 – 1234	Redevelopment Works – Location 2	0707	1541	514	2.0	100	0	<0.01
70836 – 1235	Redevelopment Works – Location 3	0705	1539	514	2.0	100	0	<0.01
70836 – 1236	Red4velopment Works – Location 4	0704	1538	514	2.0	100	0	<0.01
70836 – 1237	Redevelopment Works – Location 5	0711	1545	514	2.0	100	0	<0.01
70836 – 1238	Redevelopment Works – Location 6	0702	1535	513	2.0	100	0	<0.01
70836 – 1239	Redevelopment Works – Location 7	0701	1533	512	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

TEST REPORT

September 11, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	10/09/24
Date of Analysis:	11/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1240	Redevelopment Works – Location 1	0710	1611	541	2.0	100	0	<0.01
70836 – 1241	Redevelopment Works – Location 2	0708	1609	541	2.0	100	0	<0.01
70836 – 1242	Redevelopment Works – Location 3	0707	1608	541	2.0	100	0	<0.01
70836 – 1243	Red4velopment Works – Location 4	0706	1607	541	2.0	100	0	<0.01
70836 – 1244	Redevelopment Works – Location 5	0714	1616	542	2.0	100	0	<0.01
70836 – 1245	Redevelopment Works – Location 6	0701	1605	544	2.0	100	0	<0.01
70836 – 1246	Redevelopment Works – Location 7	0659	1603	544	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

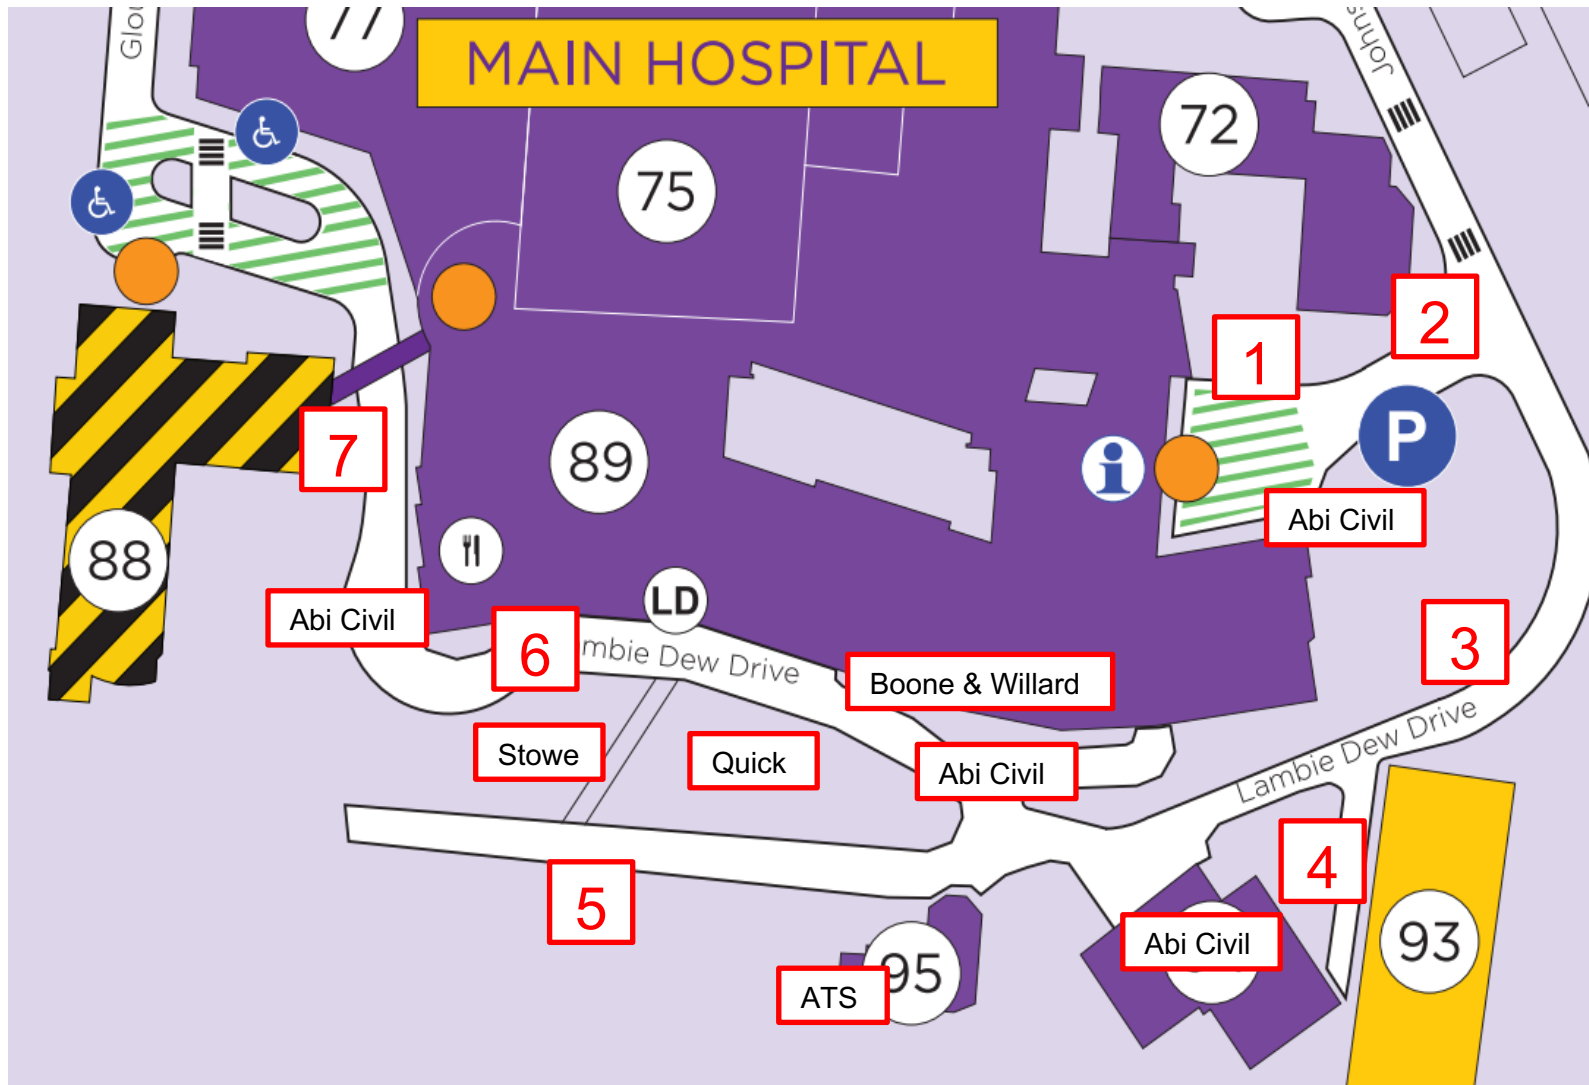


Figure 1. Air Monitoring Location.

TEST REPORT

September 12, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	11/09/24
Date of Analysis:	12/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1247	Redevelopment Works – Location 1	0710	1522	492	2.0	100	0	<0.01
70836 – 1248	Redevelopment Works – Location 2	0709	1520	491	2.0	100	0	<0.01
70836 – 1249	Redevelopment Works – Location 3	0707	1519	492	2.0	100	0	<0.01
70836 – 1250	Red4velopment Works – Location 4	0706	1518	492	2.0	100	0	<0.01
70836 – 1251	Redevelopment Works – Location 5	0715	1526	491	2.0	100	0	<0.01
70836 – 1252	Redevelopment Works – Location 6	0703	1516	493	2.0	100	0	<0.01
70836 – 1253	Redevelopment Works – Location 7	0702	1515	493	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

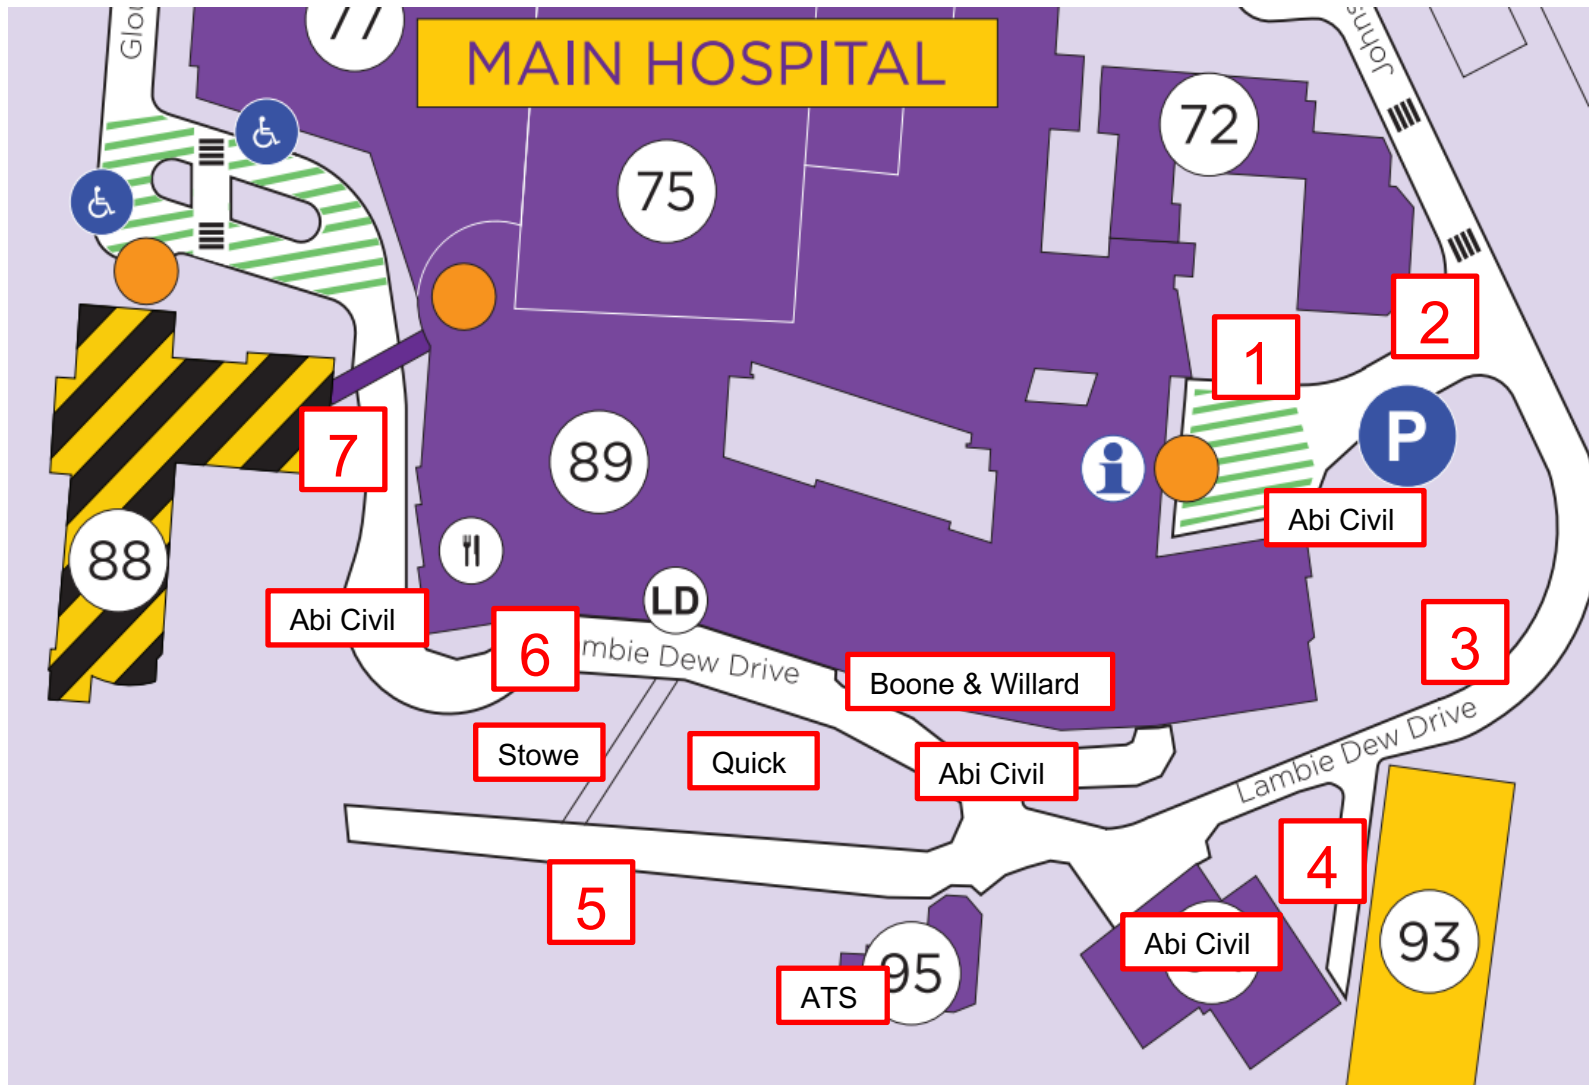


Figure 1. Air Monitoring Location.

TEST REPORT

September 13, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	12/09/24
Date of Analysis:	13/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1254	Redevelopment Works – Location 1	0712	1616	544	2.0	100	0	<0.01
70836 – 1255	Redevelopment Works – Location 2	0711	1617	546	2.0	100	0	<0.01
70836 – 1256	Redevelopment Works – Location 3	0710	1618	548	2.0	100	0	<0.01
70836 – 1257	Red4velopment Works – Location 4	0708	1625	557	2.0	100	0	<0.01
70836 – 1258	Redevelopment Works – Location 5	0716	1621	545	2.0	100	0	<0.01
70836 – 1259	Redevelopment Works – Location 6	0705	1613	548	2.0	100	0	<0.01
70836 – 1260	Redevelopment Works – Location 7	0704	1612	548	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

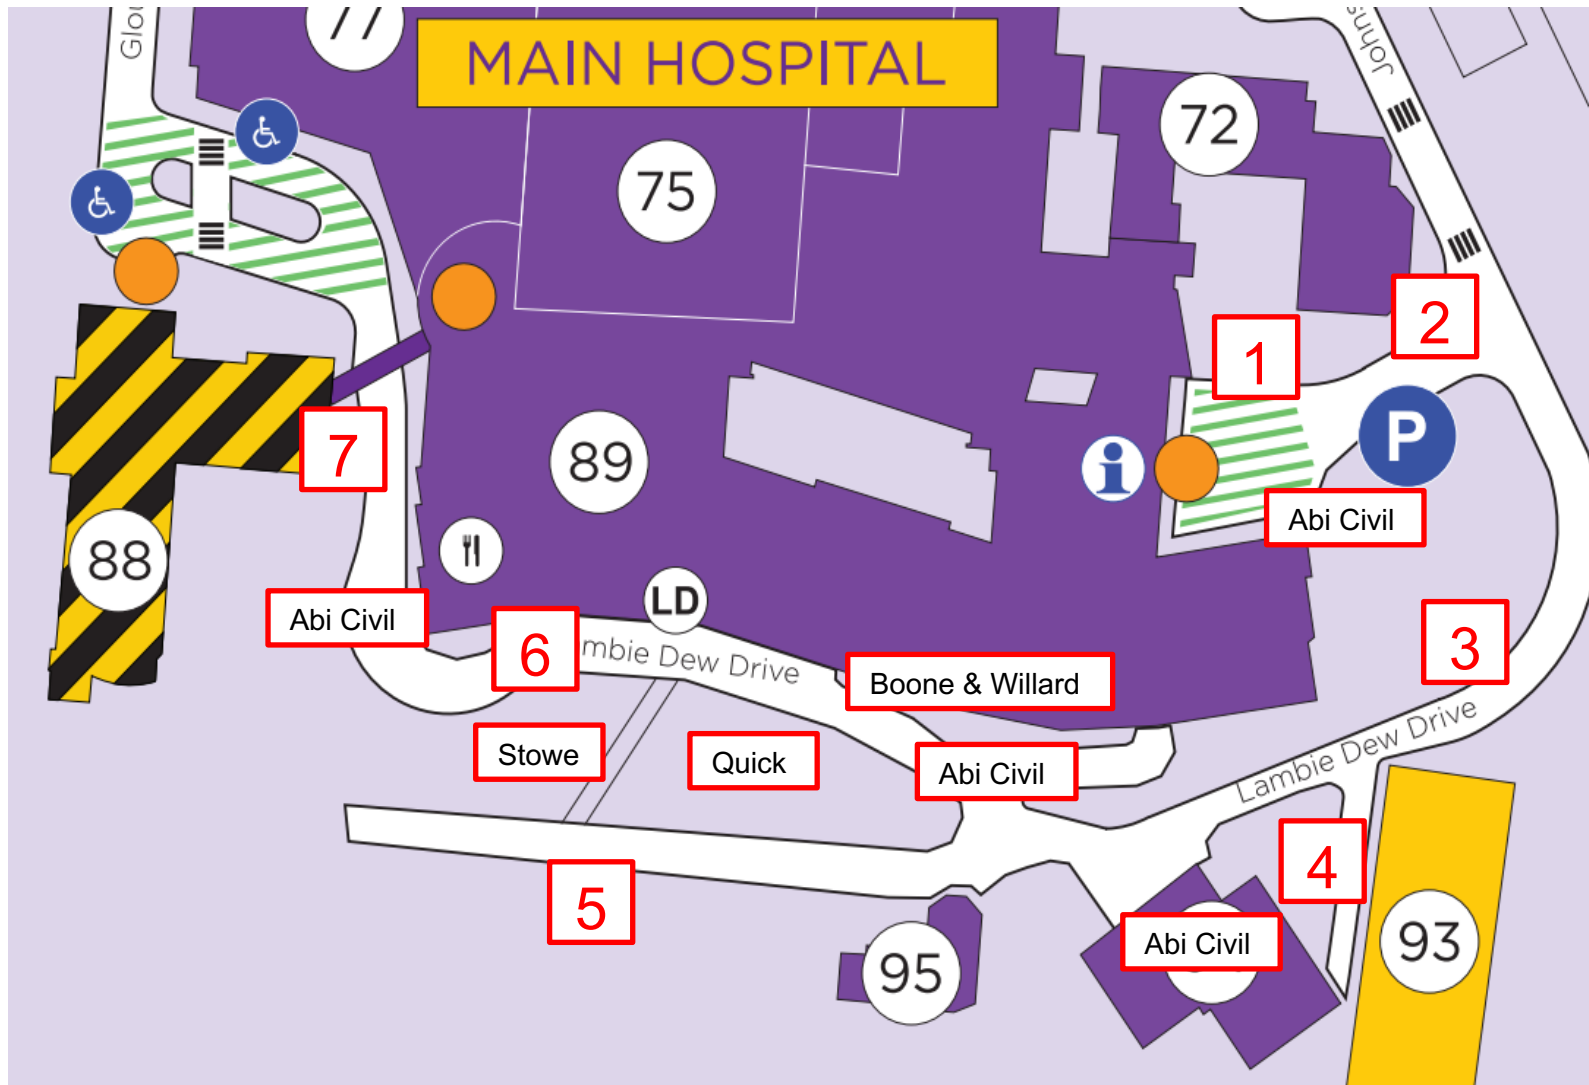


Figure 1. Air Monitoring Location.

TEST REPORT

September 16, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	13/09/24
Date of Analysis:	16/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1261	Redevelopment Works – Location 1	0700	1638	578	2.0	100	0	<0.01
70836 – 1262	Redevelopment Works – Location 2	0659	1637	578	2.0	100	0	<0.01
70836 – 1263	Redevelopment Works – Location 3	0657	1636	579	2.0	100	0	<0.01
70836 – 1264	Red4velopment Works – Location 4	0658	1635	577	2.0	100	0	<0.01
70836 – 1265	Redevelopment Works – Location 5	0711	1645	574	2.0	100	0	<0.01
70836 – 1266	Redevelopment Works – Location 6	0654	1633	579	2.0	100	0	<0.01
70836 – 1267	Redevelopment Works – Location 7	0652	1632	580	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

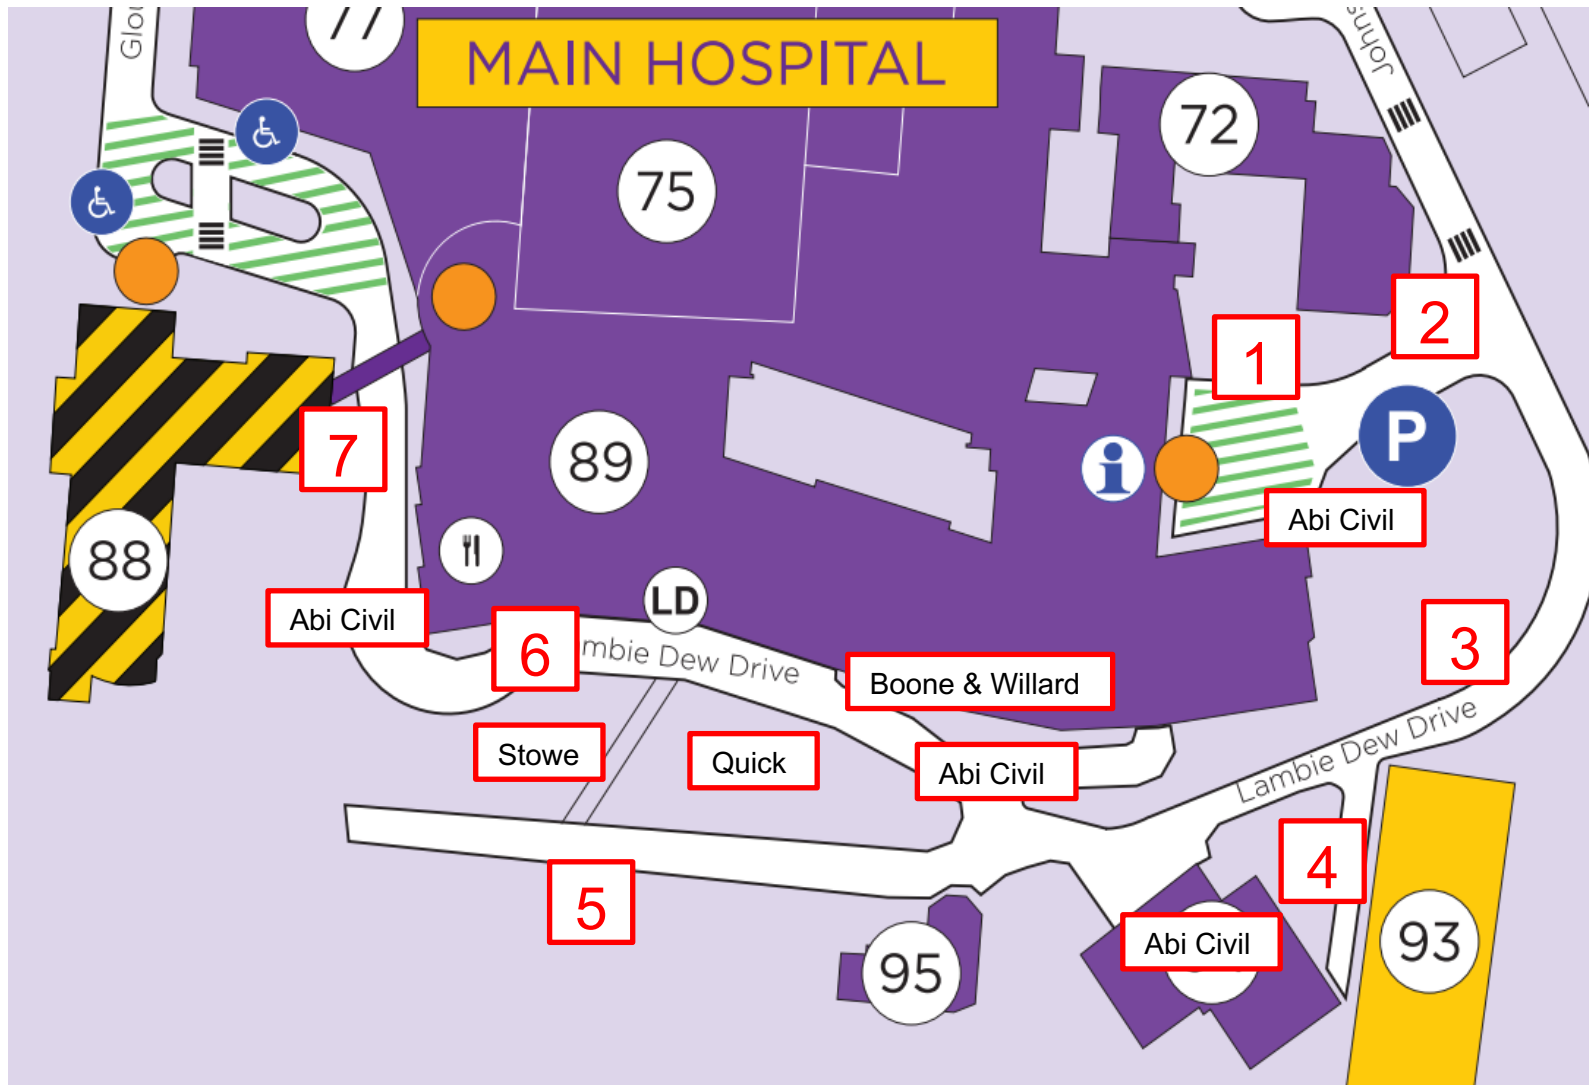


Figure 1. Air Monitoring Location.

TEST REPORT

September 17, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	16/09/24
Date of Analysis:	17/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1268	Redevelopment Works – Location 1	0652	1452	480	2.0	100	0	<0.01
70836 – 1269	Redevelopment Works – Location 2	0653	1453	480	2.0	100	0	<0.01
70836 – 1270	Redevelopment Works – Location 3	0654	1454	480	2.0	100	0	<0.01
70836 – 1271	Red4velopment Works – Location 4	0656	1456	480	2.0	100	0	<0.01
70836 – 1272	Redevelopment Works – Location 5	0700	1500	480	2.0	100	0	<0.01
70836 – 1273	Redevelopment Works – Location 6	0650	1450	480	2.0	100	0	<0.01
70836 – 1274	Redevelopment Works – Location 7	0649	1449	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

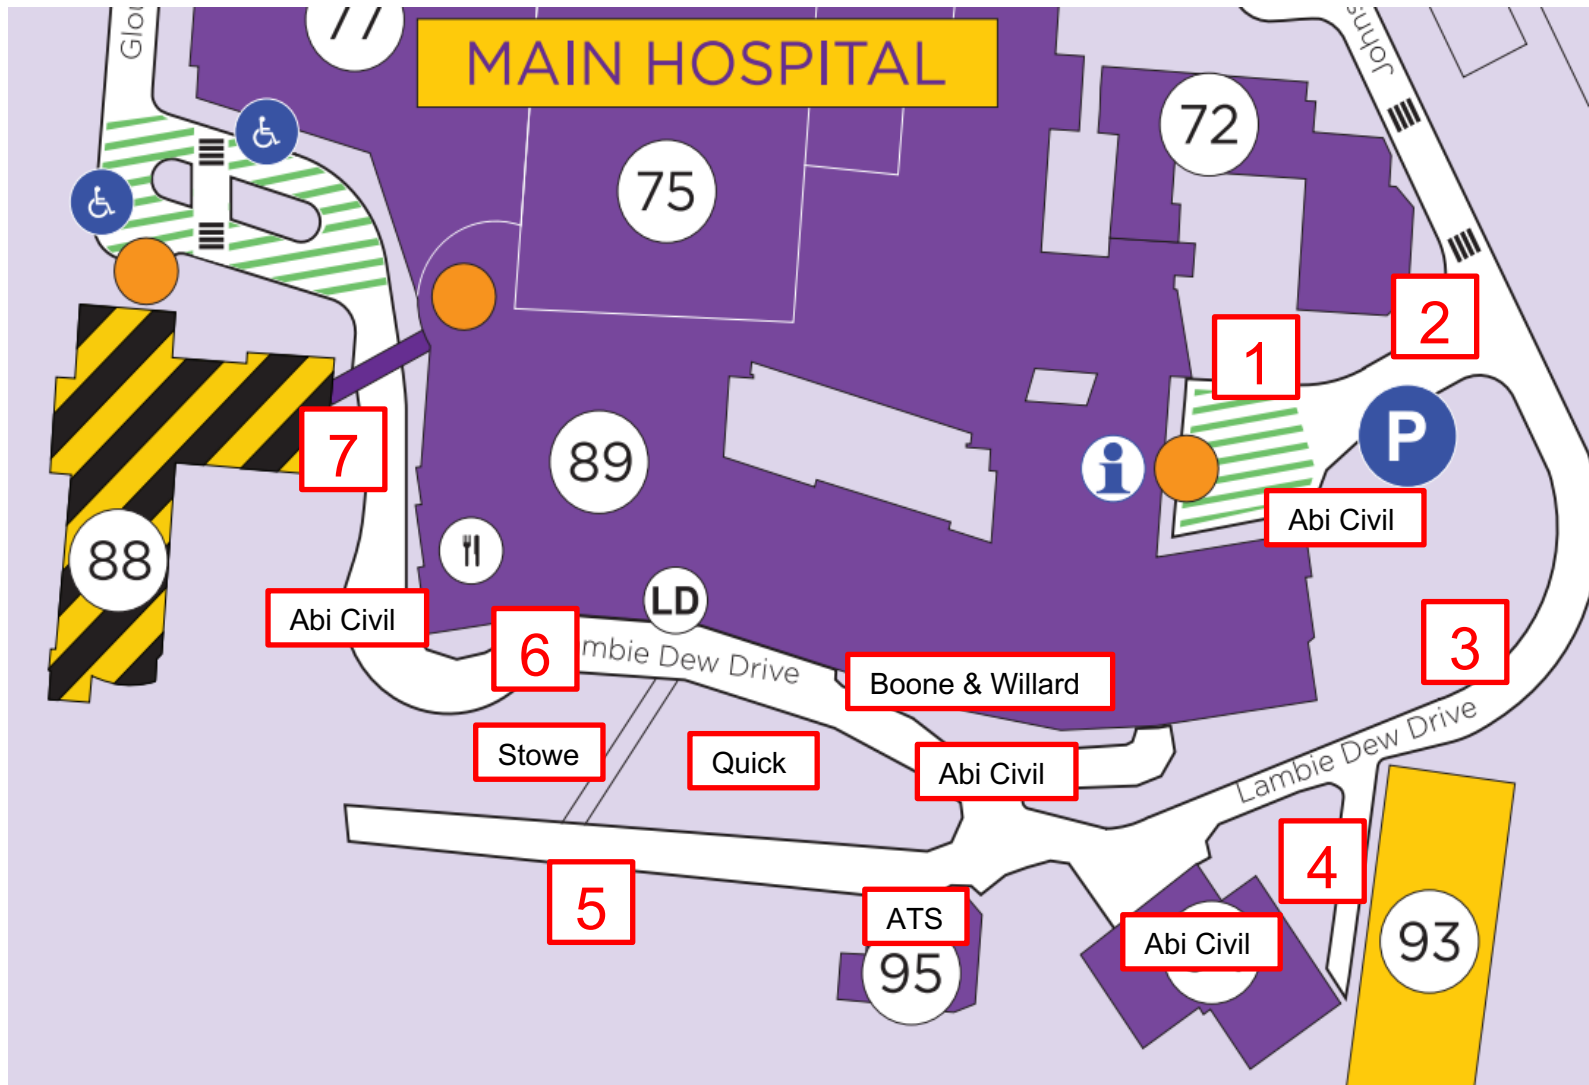


Figure 1. Air Monitoring Location.

TEST REPORT

September 18, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	17/09/24
Date of Analysis:	18/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1275	Redevelopment Works – Location 1	0703	1503	480	2.0	100	0	<0.01
70836 – 1276	Redevelopment Works – Location 2	0701	1501	480	2.0	100	0	<0.01
70836 – 1277	Redevelopment Works – Location 3	0659	1459	480	2.0	100	0	<0.01
70836 – 1278	Red4velopment Works – Location 4	0658	1458	480	2.0	100	0	<0.01
70836 – 1279	Redevelopment Works – Location 5	0709	1509	480	2.0	100	0	<0.01
70836 – 1280	Redevelopment Works – Location 6	0655	1455	480	2.0	100	0	<0.01
70836 – 1281	Redevelopment Works – Location 7	0654	1454	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

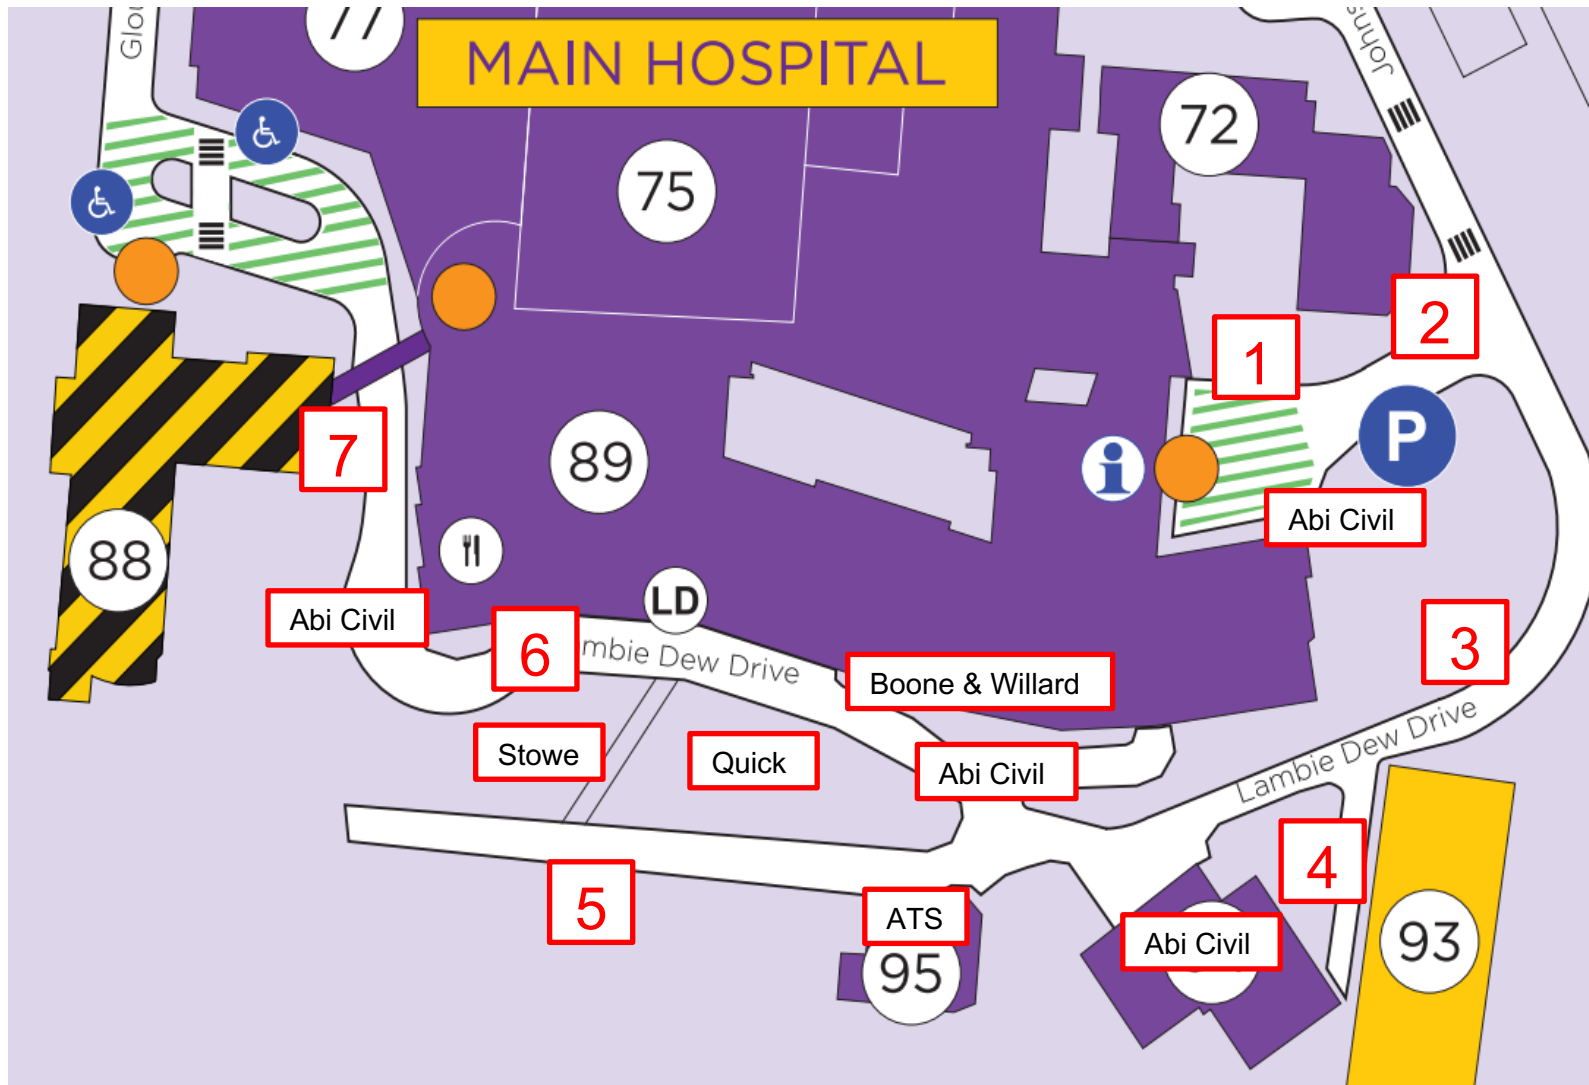


Figure 1. Air Monitoring Location.

TEST REPORT

September 19, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	18/09/24
Date of Analysis:	19/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1282	Redevelopment Works – Location 1	0713	1601	528	2.0	100	0	<0.01
70836 – 1283	Redevelopment Works – Location 2	0712	1602	530	2.0	100	0	<0.01
70836 – 1284	Redevelopment Works – Location 3	0710	1609	539	2.0	100	0	<0.01
70836 – 1285	Red4velopment Works – Location 4	0709	1611	542	2.0	100	0	<0.01
70836 – 1286	Redevelopment Works – Location 5	0717	1605	528	2.0	100	0	<0.01
70836 – 1287	Redevelopment Works – Location 6	0706	1558	532	2.0	100	0	<0.01
70836 – 1288	Redevelopment Works – Location 7	0704	1557	533	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

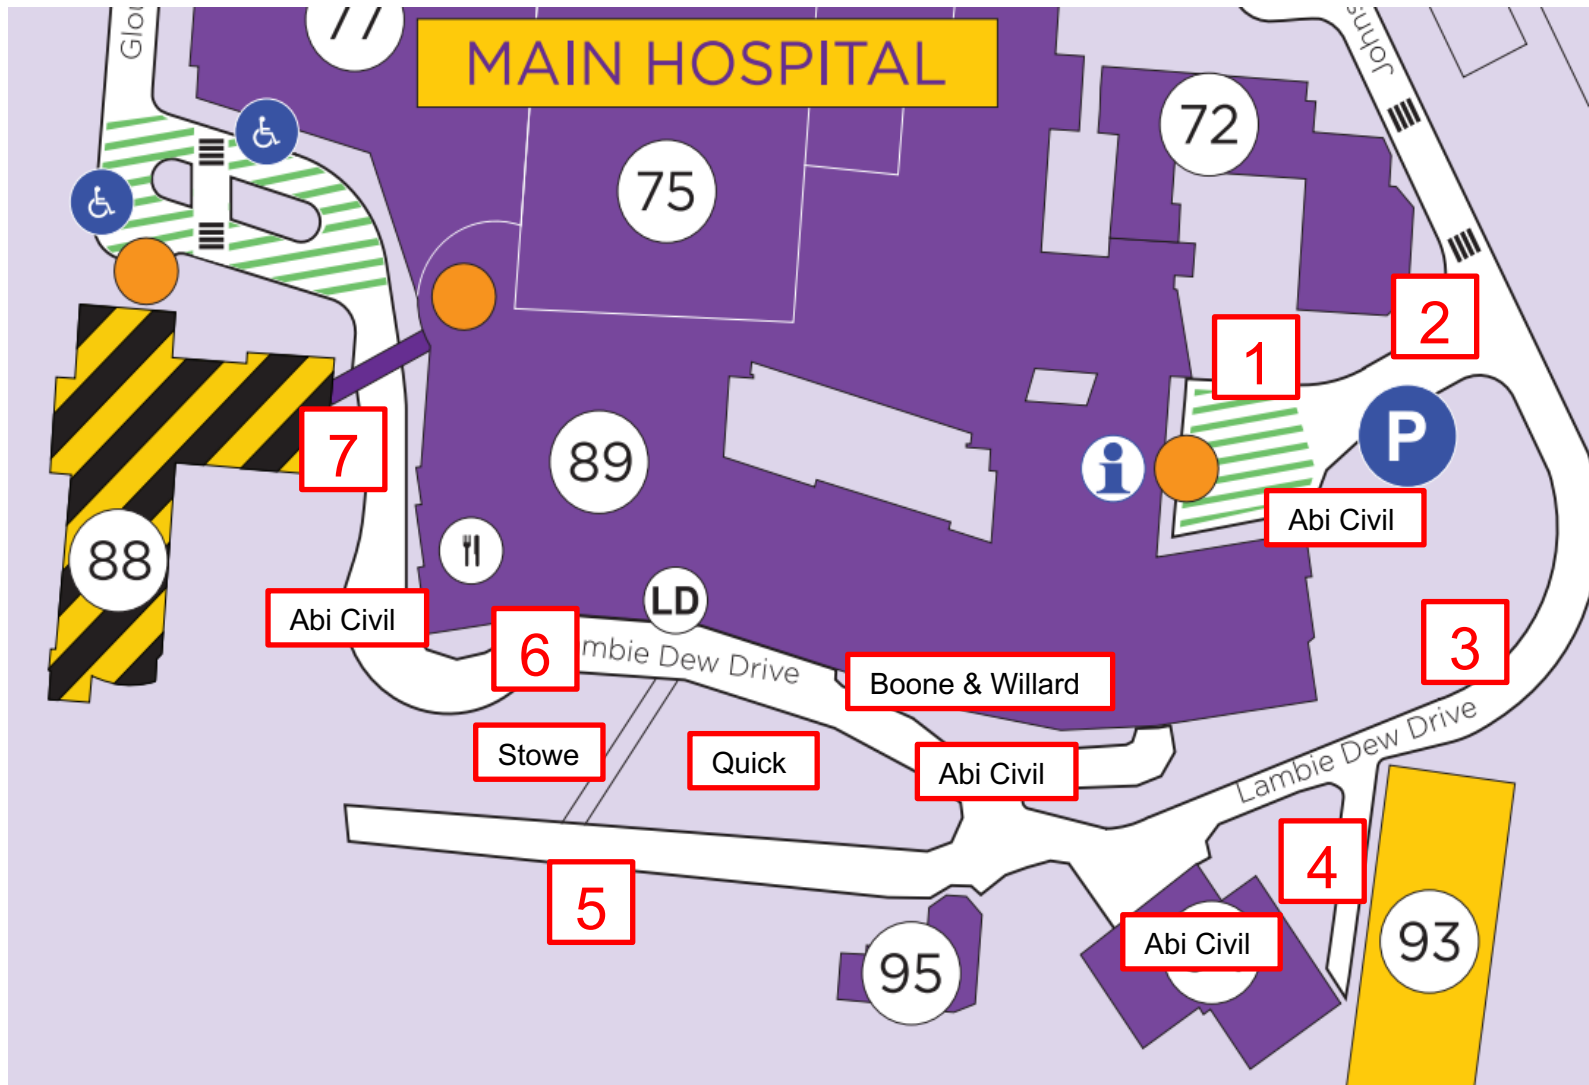


Figure 1. Air Monitoring Location.

TEST REPORT

September 20, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	19/09/24
Date of Analysis:	20/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1289	Redevelopment Works – Location 1	0723	1530	487	2.0	100	0	<0.01
70836 – 1290	Redevelopment Works – Location 2	0722	1531	489	2.0	100	0	<0.01
70836 – 1291	Redevelopment Works – Location 3	0720	1533	493	2.0	100	0	<0.01
70836 – 1292	Red4velopment Works – Location 4	0719	1539	500	2.0	100	0	<0.01
70836 – 1293	Redevelopment Works – Location 5	0727	1537	490	2.0	100	0	<0.01
70836 – 1294	Redevelopment Works – Location 6	0715	1544	509	2.0	100	0	<0.01
70836 – 1295	Redevelopment Works – Location 7	0716	1545	509	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

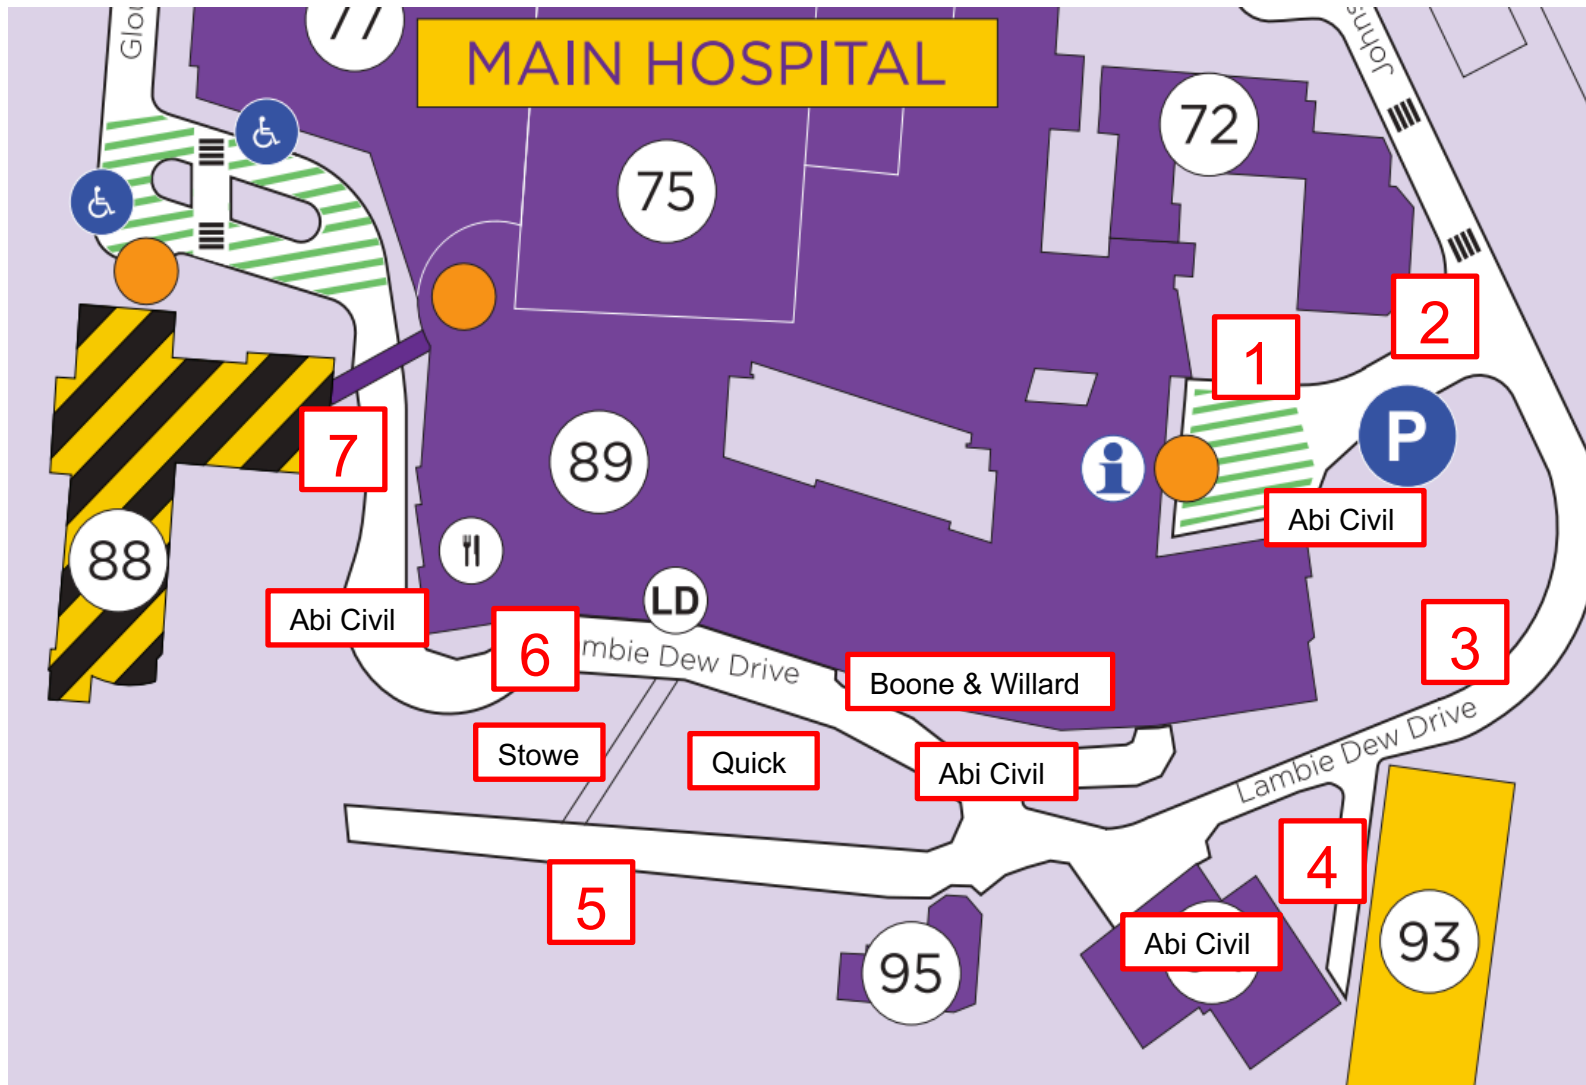


Figure 1. Air Monitoring Location.

TEST REPORT

September 23, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	20/09/24
Date of Analysis:	23/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1296	Redevelopment Works – Location 1	0656	1538	522	2.0	100	0	<0.01
70836 – 1297	Redevelopment Works – Location 2	0654	1539	525	2.0	100	0	<0.01
70836 – 1298	Redevelopment Works – Location 3	0653	1536	523	2.0	100	0	<0.01
70836 – 1299	Red4velopment Works – Location 4	0651	1535	524	2.0	100	0	<0.01
70836 – 1300	Redevelopment Works – Location 5	0700	1543	523	2.0	100	0	<0.01
70836 – 1301	Redevelopment Works – Location 6	0648	1532	524	2.0	100	0	<0.01
70836 – 1302	Redevelopment Works – Location 7	0647	1533	526	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

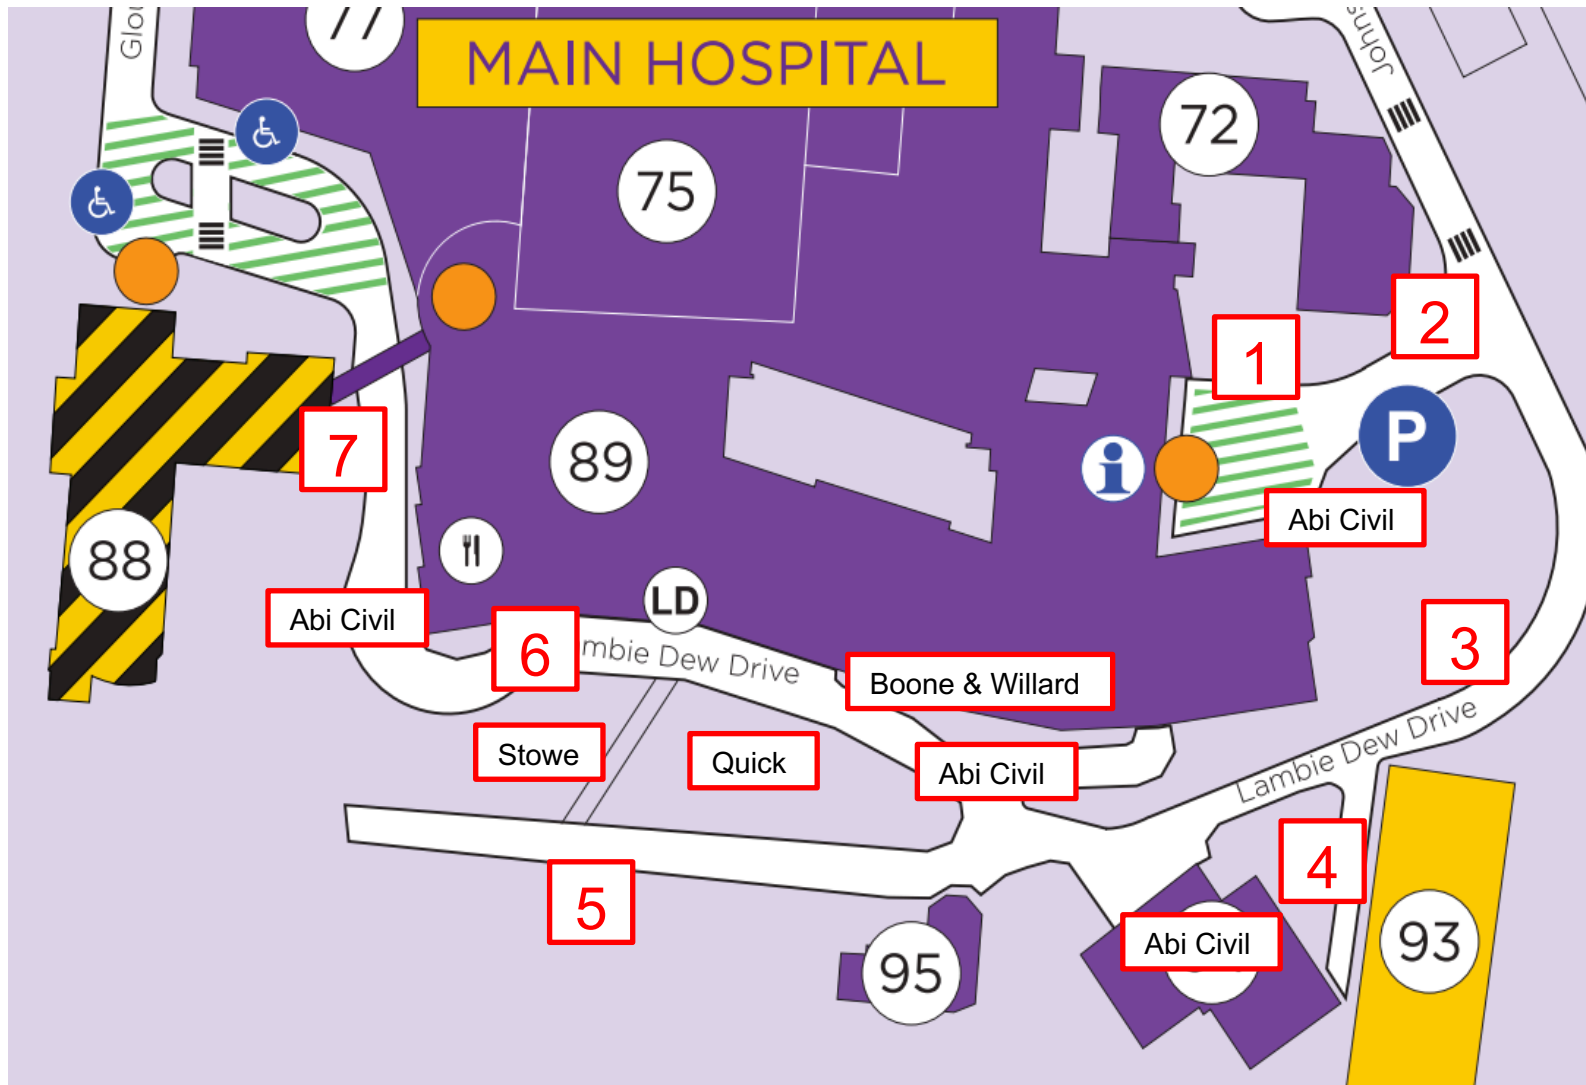


Figure 1. Air Monitoring Location.

TEST REPORT

September 24, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	23/09/24
Date of Analysis:	24/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1303	Redevelopment Works – Location 1	0703	1540	517	2.0	100	0	<0.01
70836 – 1304	Redevelopment Works – Location 2	0706	1542	516	2.0	100	0	<0.01
70836 – 1305	Redevelopment Works – Location 3	0708	1543	515	2.0	100	0	<0.01
70836 – 1306	Red4velopment Works – Location 4	0709	1544	515	2.0	100	0	<0.01
70836 – 1307	Redevelopment Works – Location 5	0712	1536	504	2.0	100	0	<0.01
70836 – 1308	Redevelopment Works – Location 6	0659	1534	515	2.0	100	0	<0.01
70836 – 1309	Redevelopment Works – Location 7	0657	1532	515	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

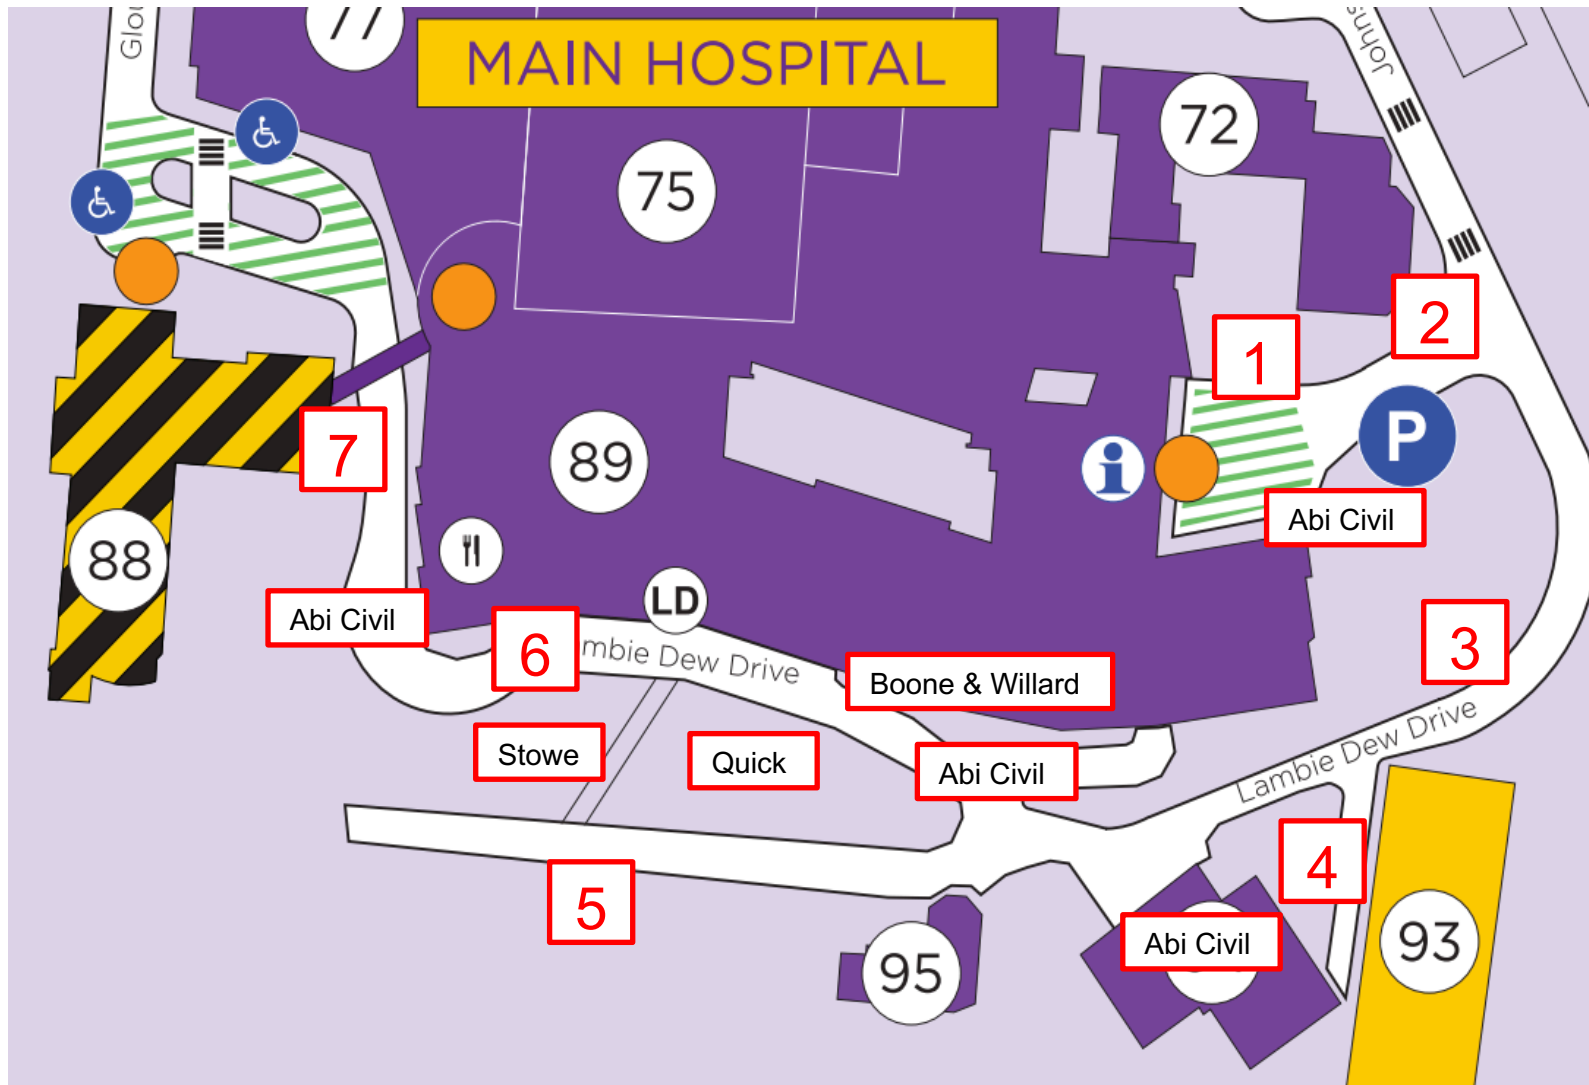


Figure 1. Air Monitoring Location.

TEST REPORT

September 25, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	10 Filters
Date of Sampling:	24/09/24
Date of Analysis:	25/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1310	Redevelopment Works – Location 1	0702	1544	522	2.0	100	0	<0.01
70836 – 1311	Redevelopment Works – Location 2	0659	1543	524	2.0	100	0	<0.01
70836 – 1312	Redevelopment Works – Location 3	0658	1542	524	2.0	100	0	<0.01
70836 – 1313	Red4velopment Works – Location 4	0657	1540	523	2.0	100	0	<0.01
70836 – 1314	Redevelopment Works – Location 5	0705	1542	517	2.0	100	0	<0.01
70836 – 1315	Redevelopment Works – Location 6	0651	1557	546	2.0	100	0	<0.01
70836 – 1316	Redevelopment Works – Location 7	0653	1559	546	2.0	100	0	<0.01
70836 – 1317	Redevelopment Works – Location 8	0715	1603	528	2.0	100	0	<0.01
70836 – 1318	Redevelopment Works – Location 9	0716	1604	528	2.0	100	0	<0.01
70836 – 1319	Redevelopment Works – Location 10	0717	1605	528	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

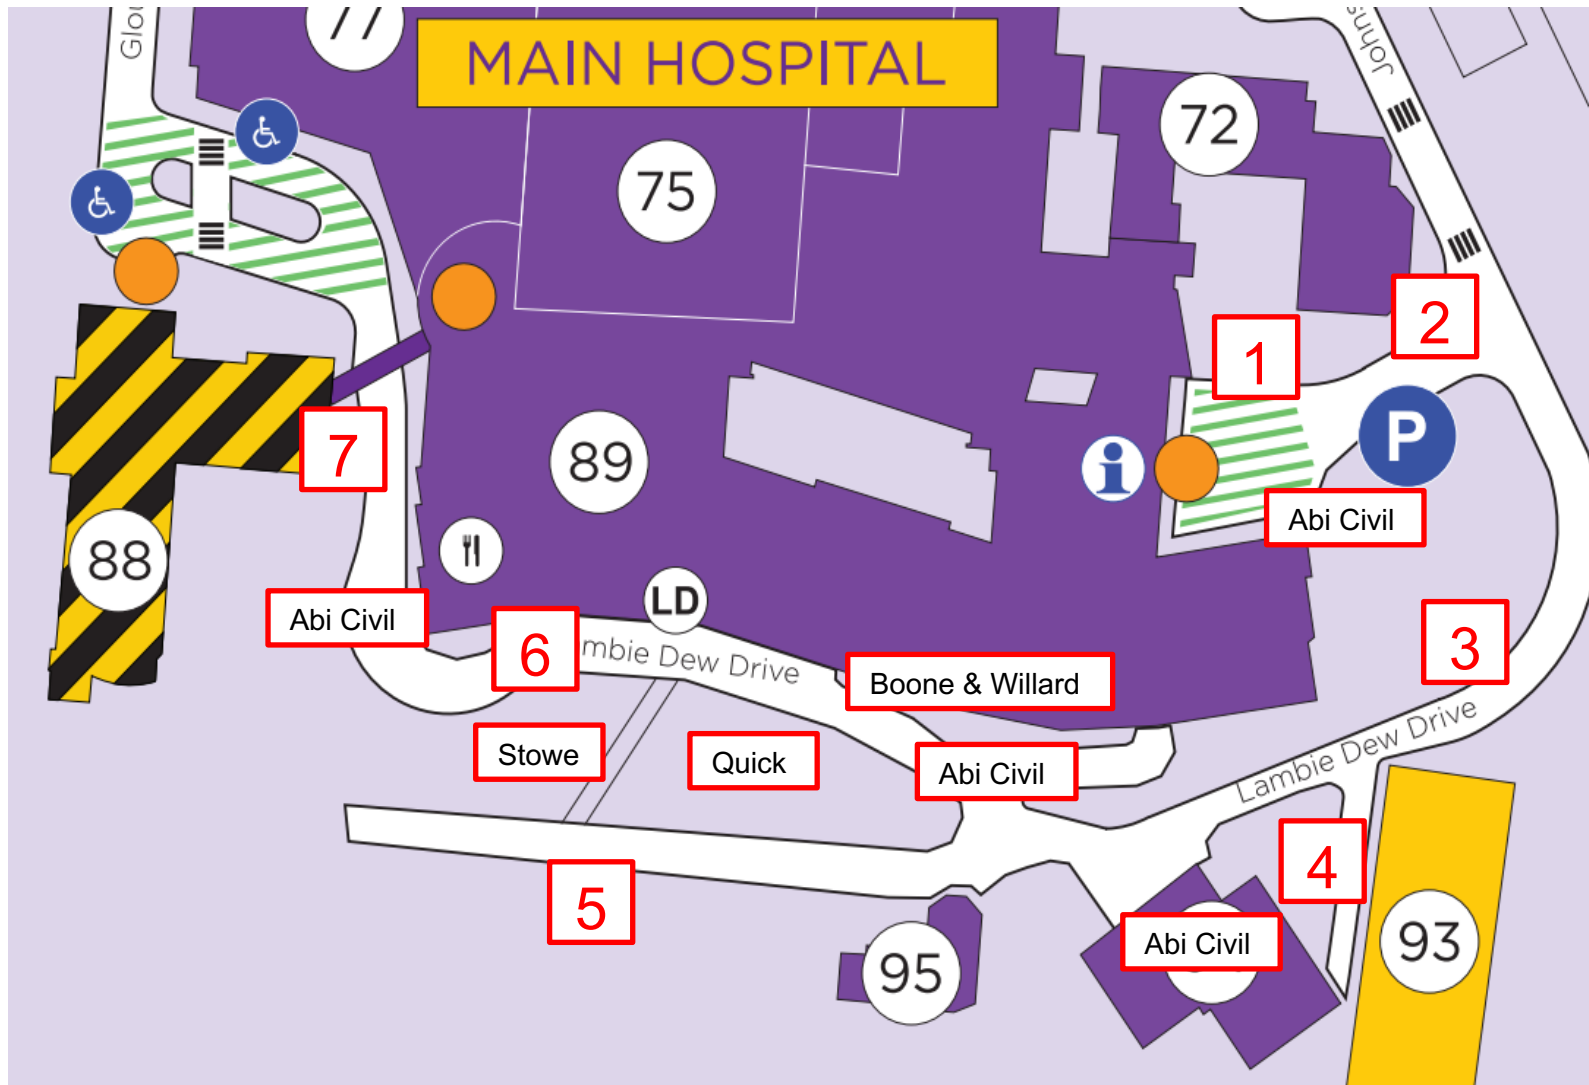


Figure 1. Air Monitoring Location.

SITE MAP



Figure 2. Air Monitoring Location.

TEST REPORT

September 26, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	10 Filters
Date of Sampling:	25/09/24
Date of Analysis:	26/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1320	Redevelopment Works – Location 1	0645	1611	566	2.0	100	0	<0.01
70836 – 1321	Redevelopment Works – Location 2	0644	1612	568	2.0	100	0	<0.01
70836 – 1322	Redevelopment Works – Location 3	0641	1613	572	2.0	100	0	<0.01
70836 – 1323	Red4velopment Works – Location 4	0640	1614	574	2.0	100	0	<0.01
70836 – 1324	Redevelopment Works – Location 5	0651	1607	556	2.0	100	0	<0.01
70836 – 1325	Redevelopment Works – Location 6	0635	1603	568	2.0	100	0	<0.01
70836 – 1326	Redevelopment Works – Location 7	0636	1601	565	2.0	100	0	<0.01
70836 – 1327	Redevelopment Works – Location 8	0702	1554	532	2.0	100	0	<0.01
70836 – 1328	Redevelopment Works – Location 9	0705	1552	527	2.0	100	0	<0.01
70836 – 1329	Redevelopment Works – Location 10	0707	1551	524	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full

SITE MAP

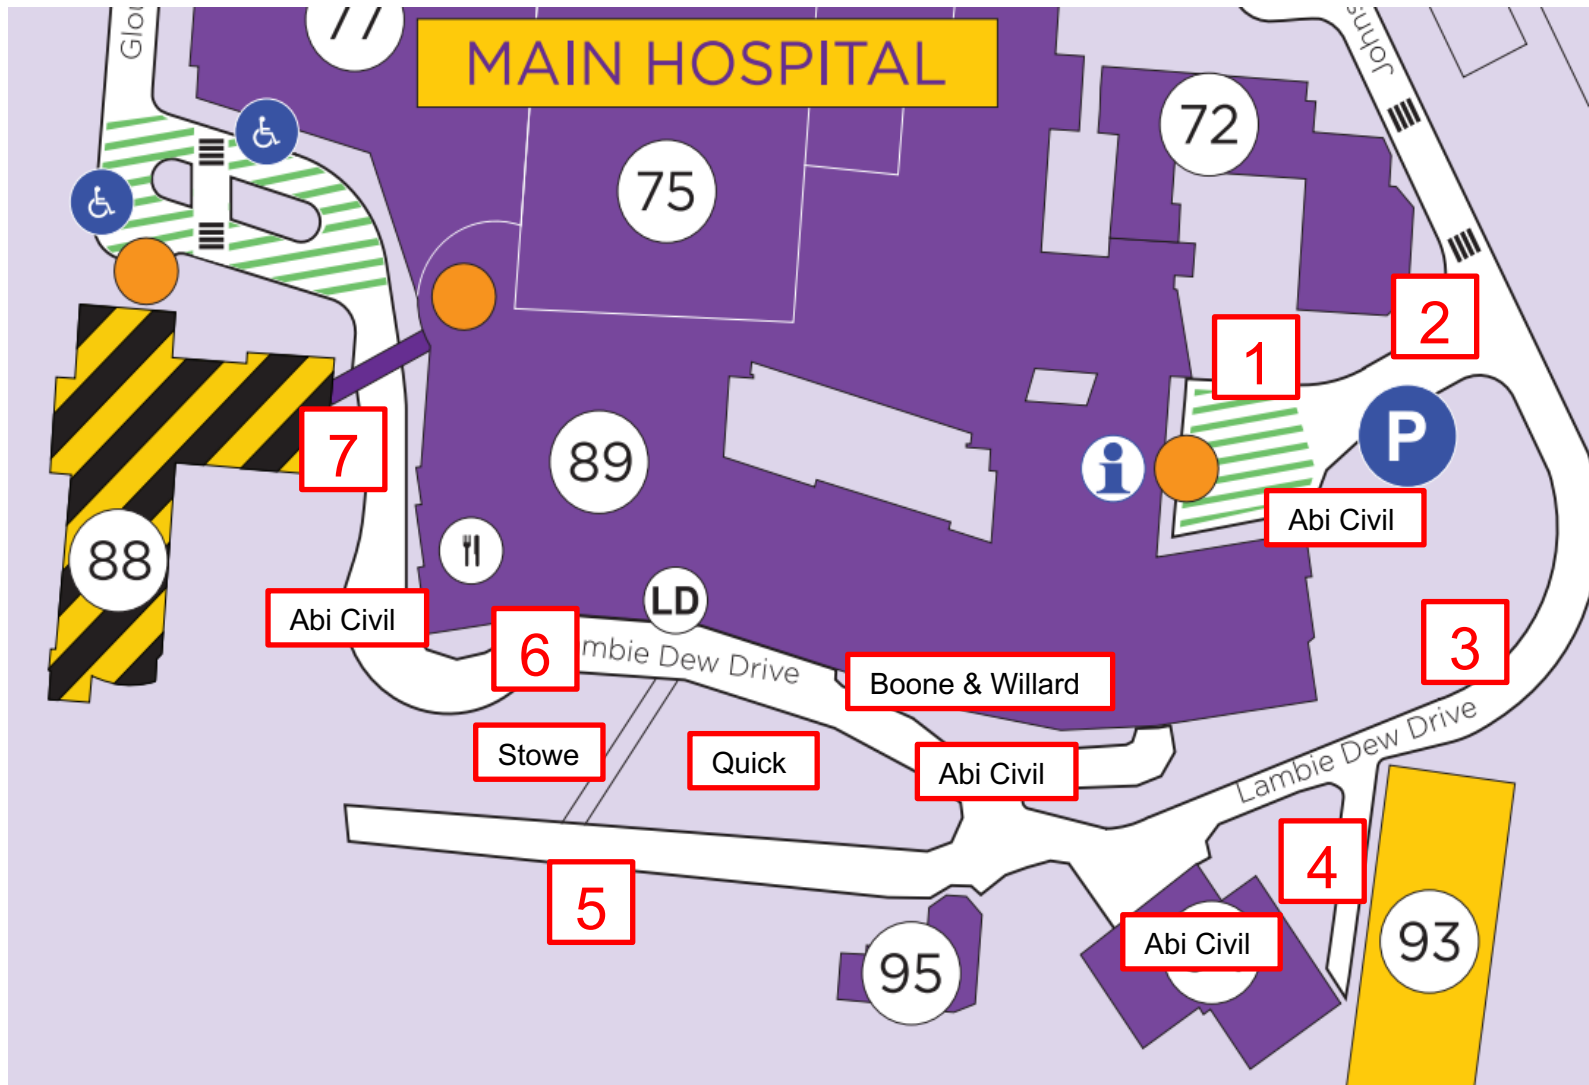


Figure 1. Air Monitoring Location.

SITE MAP



Figure 2. Air Monitoring Location.

TEST REPORT

September 27, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	10 Filters
Date of Sampling:	26/09/24
Date of Analysis:	27/09/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1330	Redevelopment Works – Location 1	0701	1533	512	2.0	100	0	<0.01
70836 – 1331	Redevelopment Works – Location 2	0703	1535	512	2.0	100	0	<0.01
70836 – 1332	Redevelopment Works – Location 3	0702	1536	514	2.0	100	0	<0.01
70836 – 1333	Red4velopment Works – Location 4	0700	1536	516	2.0	100	0	<0.01
70836 – 1334	Redevelopment Works – Location 5	0712	1537	505	2.0	100	0	<0.01
70836 – 1335	Redevelopment Works – Location 6	0654	1538	524	2.0	100	0	<0.01
70836 – 1336	Redevelopment Works – Location 7	0652	1541	529	2.0	100	0	<0.01
70836 – 1337	Redevelopment Works – Location 8	0720	1521	481	2.0	100	0	<0.01
70836 – 1338	Redevelopment Works – Location 9	0721	1523	482	2.0	100	0	<0.01
70836 – 1339	Redevelopment Works – Location 10	0723	1523	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full

SITE MAP

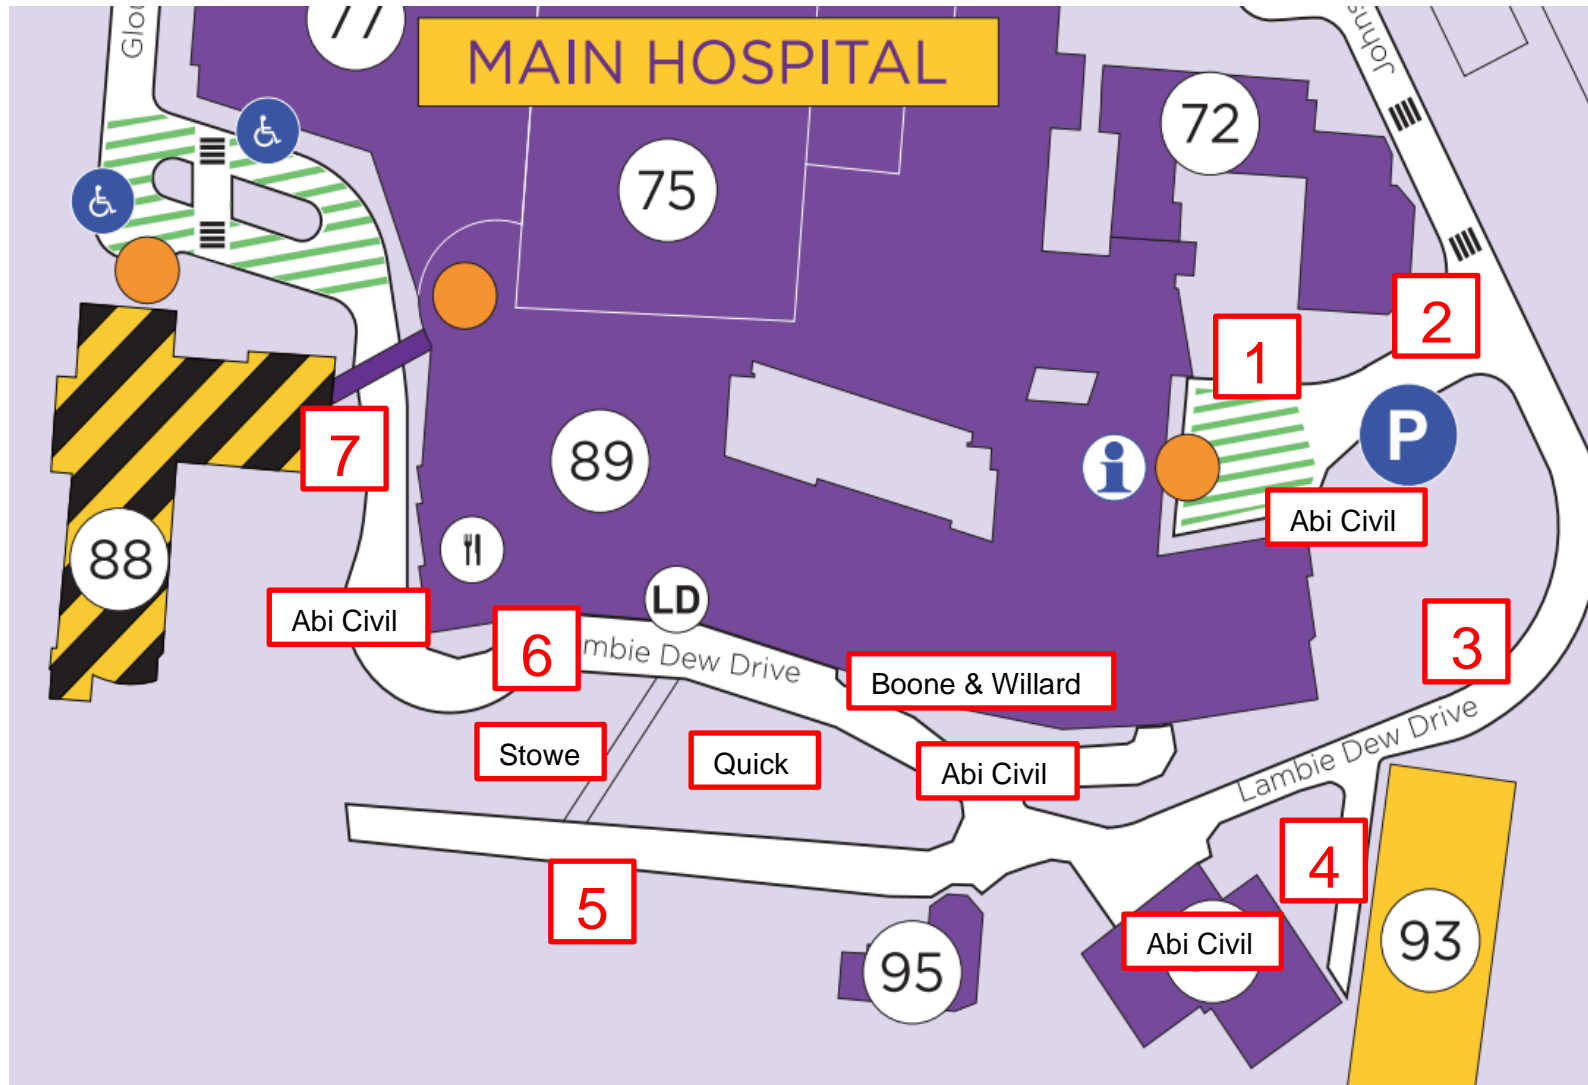


Figure 1. Air Monitoring Location.

SITE MAP



Figure 2. Air Monitoring Location.