

TEST REPORT

October 02, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	01/10/24
Date of Analysis:	02/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1360	Redevelopment Works – Location 1	0710	1602	532	2.0	100	0	<0.01
70836 – 1361	Redevelopment Works – Location 2	0711	1601	530	2.0	100	0	<0.01
70836 – 1362	Redevelopment Works – Location 3	0712	1559	527	2.0	100	0	<0.01
70836 – 1363	Red4velopment Works – Location 4	0708	1557	529	2.0	100	0	<0.01
70836 – 1364	Redevelopment Works – Location 5	0714	1606	532	2.0	100	0	<0.01
70836 – 1365	Redevelopment Works – Location 6	0706	1555	529	2.0	100	0	<0.01
70836 – 1366	Redevelopment Works – Location 7	0703	1554	531	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

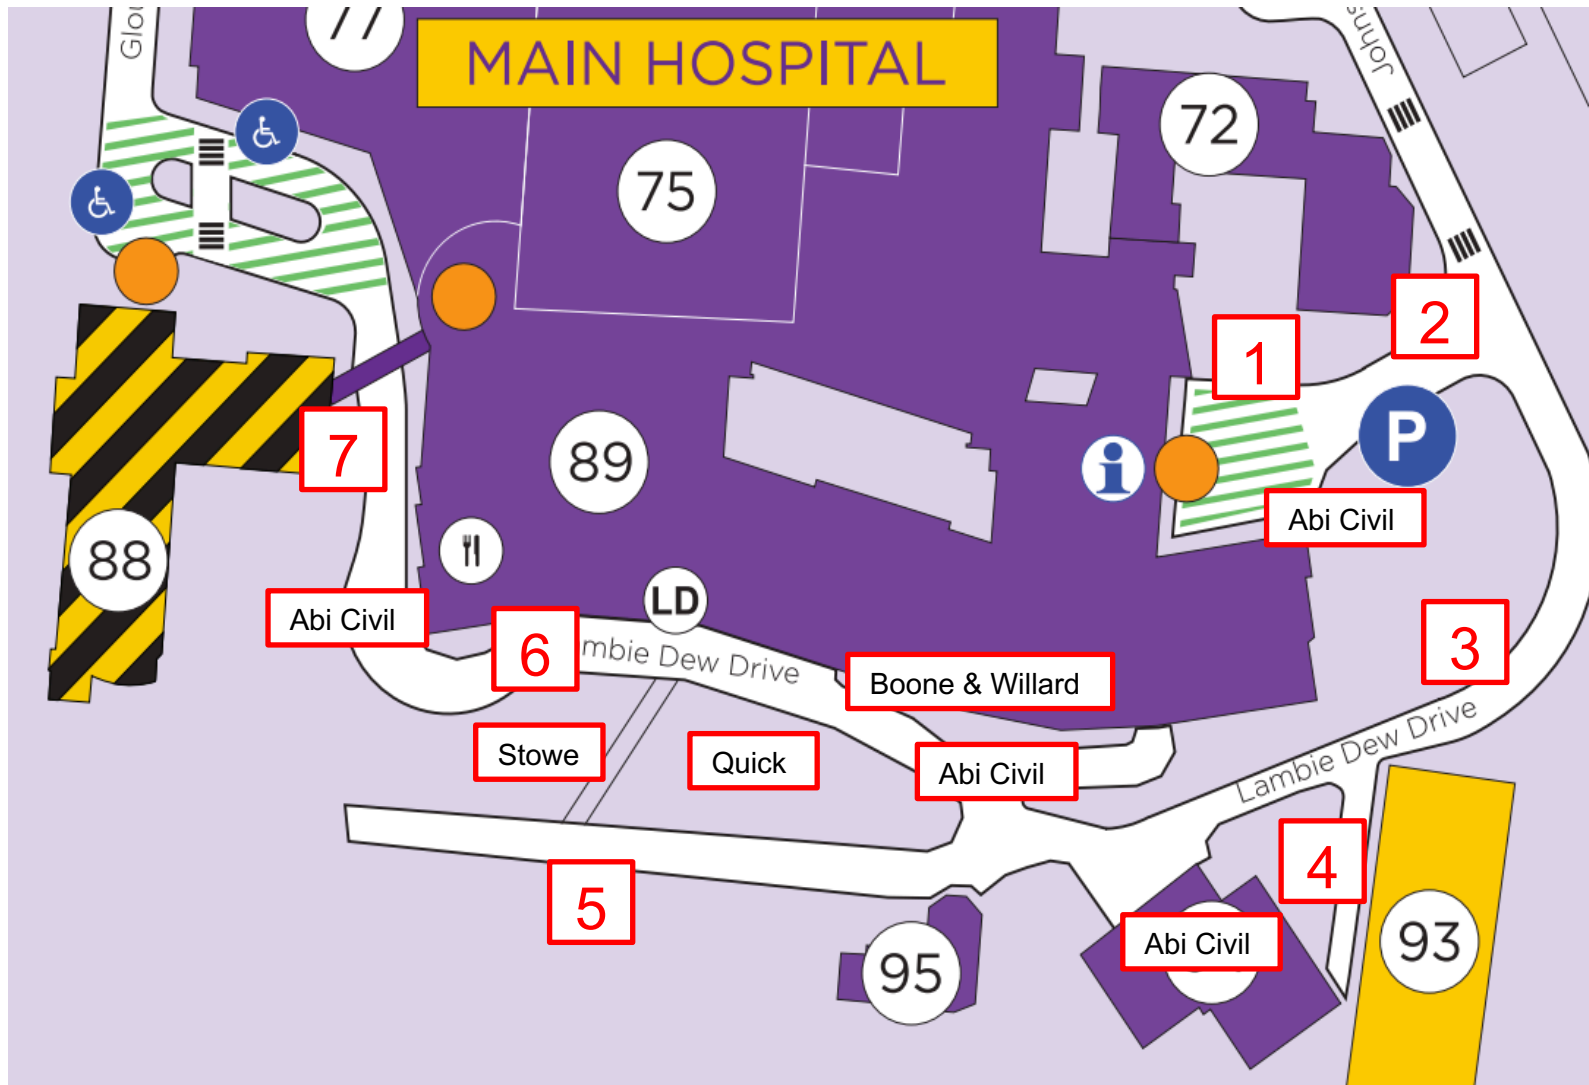


Figure 1. Air Monitoring Location.

TEST REPORT

October 02, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	01/10/24
Date of Analysis:	02/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1360	Redevelopment Works – Location 1	0710	1602	532	2.0	100	0	<0.01
70836 – 1361	Redevelopment Works – Location 2	0711	1601	530	2.0	100	0	<0.01
70836 – 1362	Redevelopment Works – Location 3	0712	1559	527	2.0	100	0	<0.01
70836 – 1363	Red4velopment Works – Location 4	0708	1557	529	2.0	100	0	<0.01
70836 – 1364	Redevelopment Works – Location 5	0714	1606	532	2.0	100	0	<0.01
70836 – 1365	Redevelopment Works – Location 6	0706	1555	529	2.0	100	0	<0.01
70836 – 1366	Redevelopment Works – Location 7	0703	1554	531	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

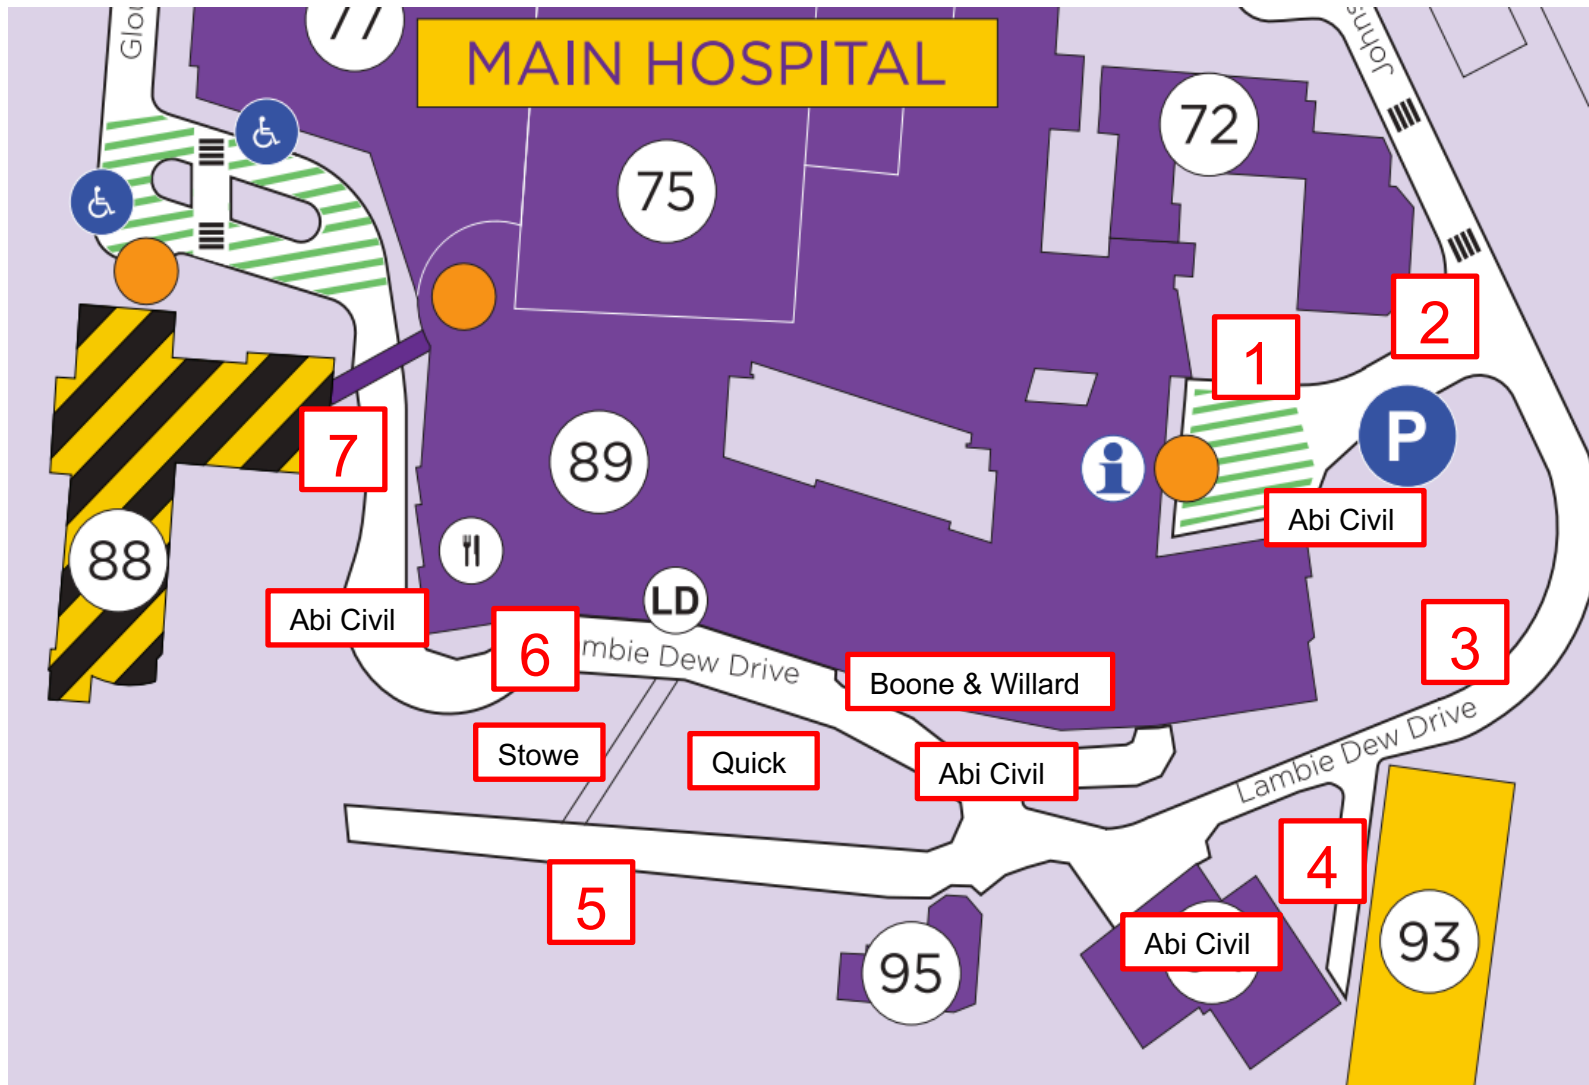


Figure 1. Air Monitoring Location.

TEST REPORT

October 03, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	02/10/24
Date of Analysis:	03/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1367	Redevelopment Works – Location 1	0706	1543	517	2.0	100	0	<0.01
70836 – 1368	Redevelopment Works – Location 2	0705	1541	516	2.0	100	0	<0.01
70836 – 1369	Redevelopment Works – Location 3	0704	1549	525	2.0	100	0	<0.01
70836 – 1370	Red4velopment Works – Location 4	0703	1550	527	2.0	100	0	<0.01
70836 – 1371	Redevelopment Works – Location 5	0710	1547	517	2.0	100	0	<0.01
70836 – 1372	Redevelopment Works – Location 6	0657	1555	538	2.0	100	0	<0.01
70836 – 1373	Redevelopment Works – Location 7	0655	1556	541	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

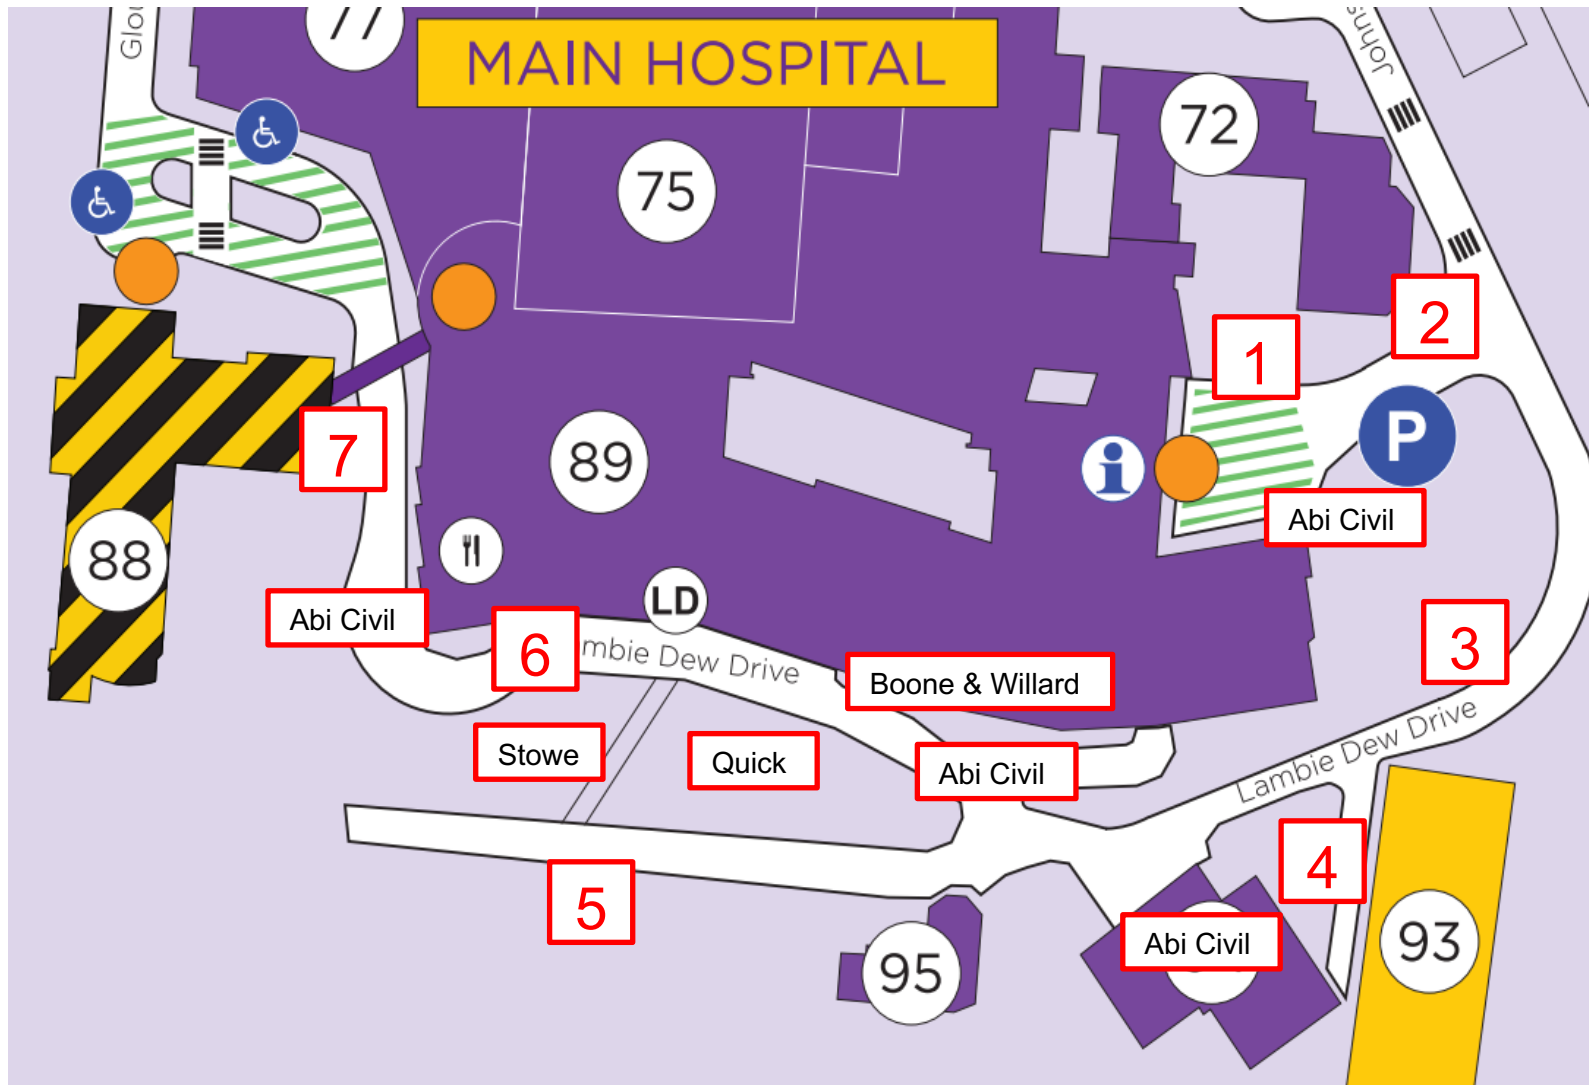


Figure 1. Air Monitoring Location.

TEST REPORT

October 04, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	03/10/24
Date of Analysis:	04/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1374	Redevelopment Works – Location 1	0656	1456	480	2.0	100	0	<0.01
70836 – 1375	Redevelopment Works – Location 2	0655	1455	480	2.0	100	0	<0.01
70836 – 1376	Redevelopment Works – Location 3	0654	1554	480	2.0	100	0	<0.01
70836 – 1377	Red4velopment Works – Location 4	0652	1552	480	2.0	100	0	<0.01
70836 – 1378	Redevelopment Works – Location 5	0700	1500	480	2.0	100	0	<0.01
70836 – 1379	Redevelopment Works – Location 6	0706	1506	480	2.0	100	0	<0.01
70836 – 1380	Redevelopment Works – Location 7	0707	1507	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full

SITE MAP

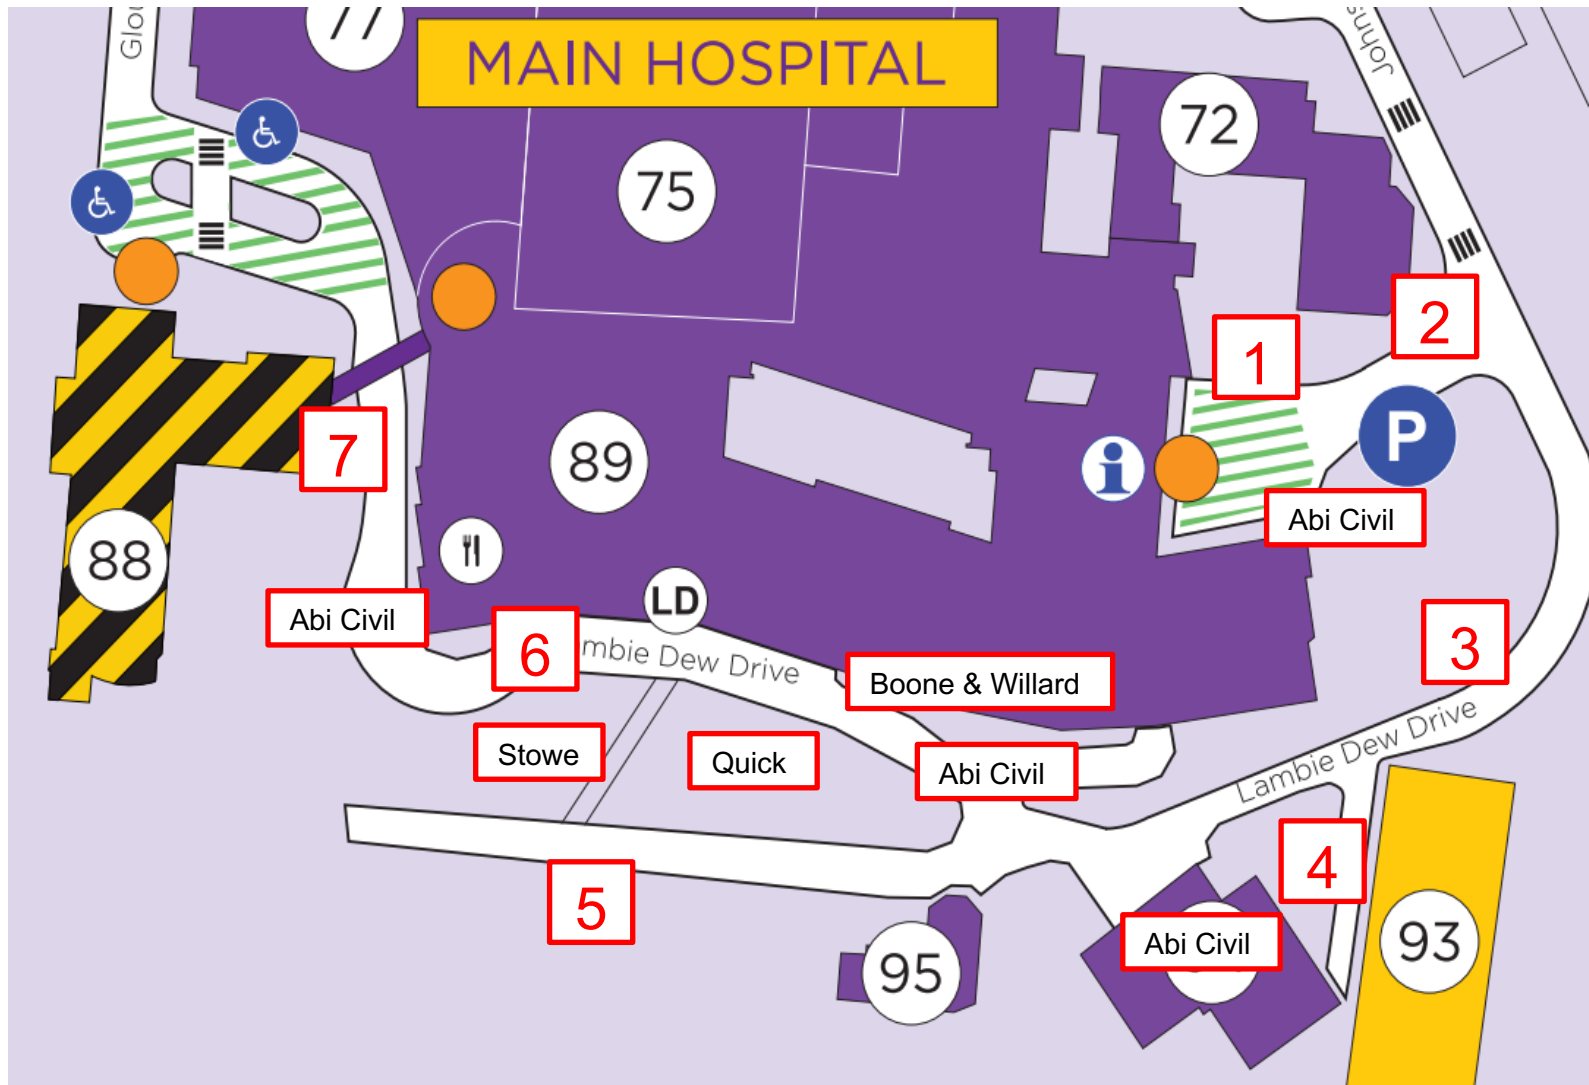


Figure 1. Air Monitoring Location.

TEST REPORT

October 09, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	04/10/24
Date of Analysis:	09/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1381	Redevelopment Works – Location 1	0656	1540	524	2.0	100	0	<0.01
70836 – 1382	Redevelopment Works – Location 2	0658	1538	520	2.0	100	0	<0.01
70836 – 1383	Redevelopment Works – Location 3	0654	1537	523	2.0	100	0	<0.01
70836 – 1384	Red4velopment Works – Location 4	0653	1536	523	2.0	100	0	<0.01
70836 – 1385	Redevelopment Works – Location 5	0702	1544	522	2.0	100	0	<0.01
70836 – 1386	Redevelopment Works – Location 6	0650	1532	522	2.0	100	0	<0.01
70836 – 1387	Redevelopment Works – Location 7	0649	1531	522	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

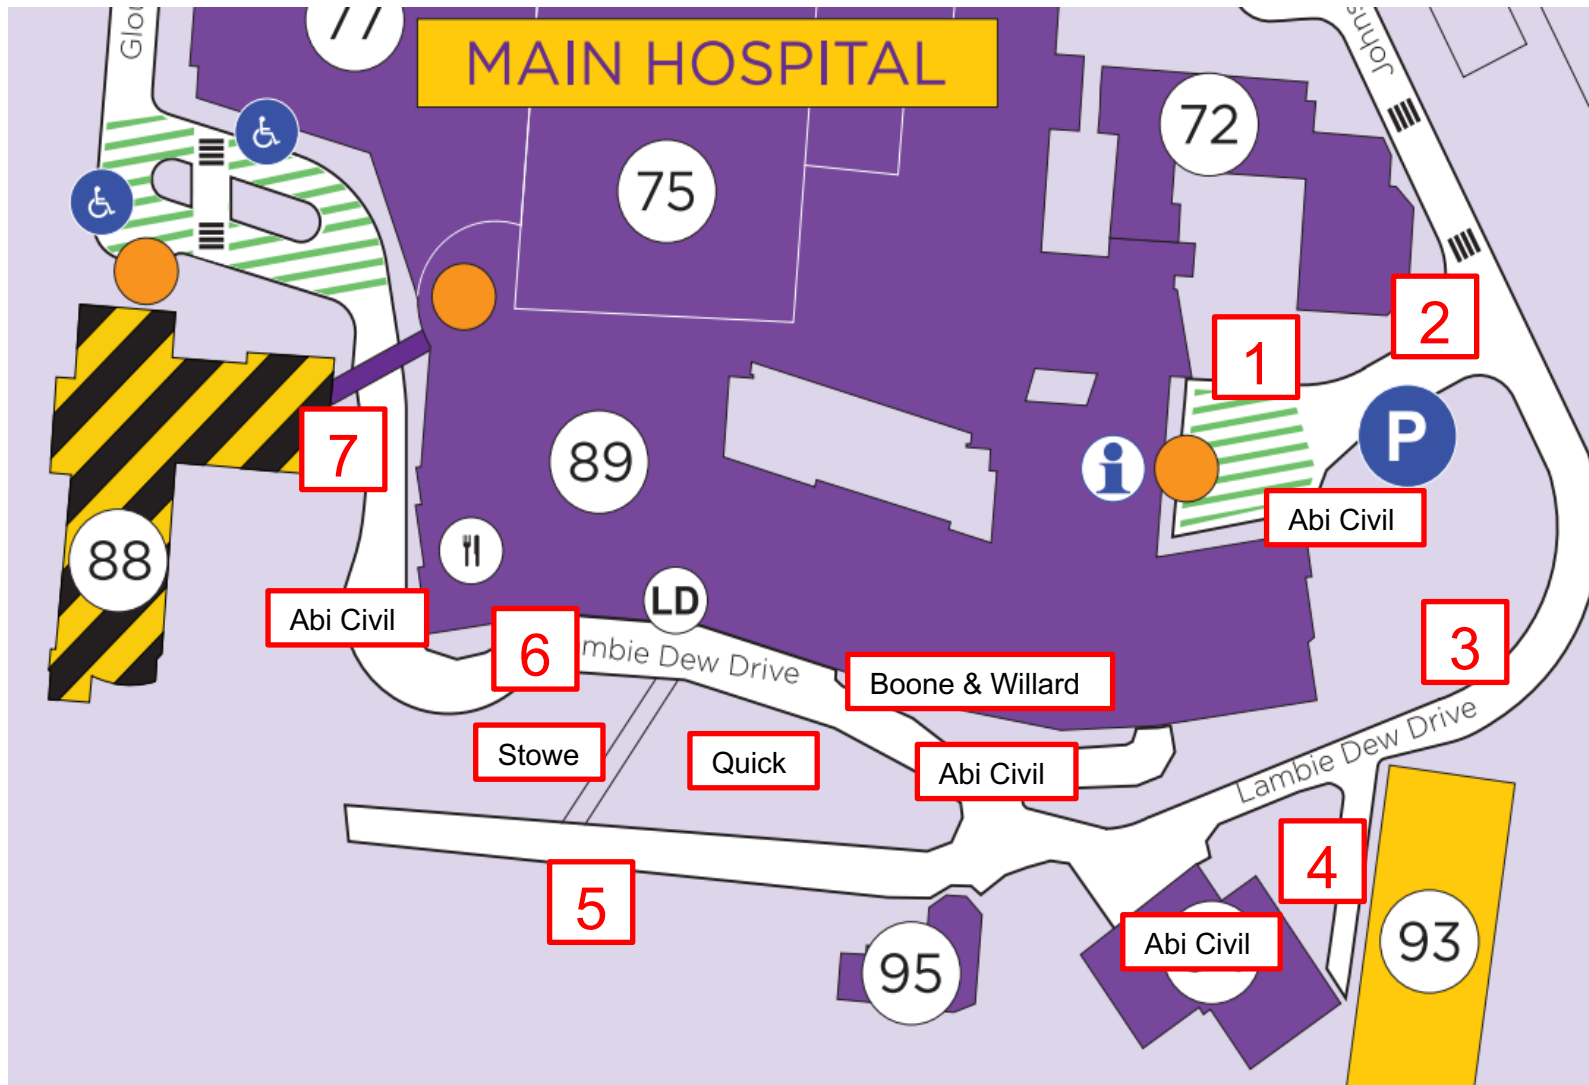


Figure 1. Air Monitoring Location.

TEST REPORT

October 10, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	09/10/24
Date of Analysis:	10/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1388	Redevelopment Works – Location 1	0656	1456	480	2.0	100	0	<0.01
70836 – 1389	Redevelopment Works – Location 2	0655	1455	480	2.0	100	0	<0.01
70836 – 1390	Redevelopment Works – Location 3	0654	1454	480	2.0	100	0	<0.01
70836 – 1391	Red4velopment Works – Location 4	0653	1453	480	2.0	100	0	<0.01
70836 – 1392	Redevelopment Works – Location 5	0659	1459	480	2.0	100	0	<0.01
70836 – 1393	Redevelopment Works – Location 6	0649	1449	480	2.0	100	0	<0.01
70836 – 1394	Redevelopment Works – Location 7	0647	1447	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

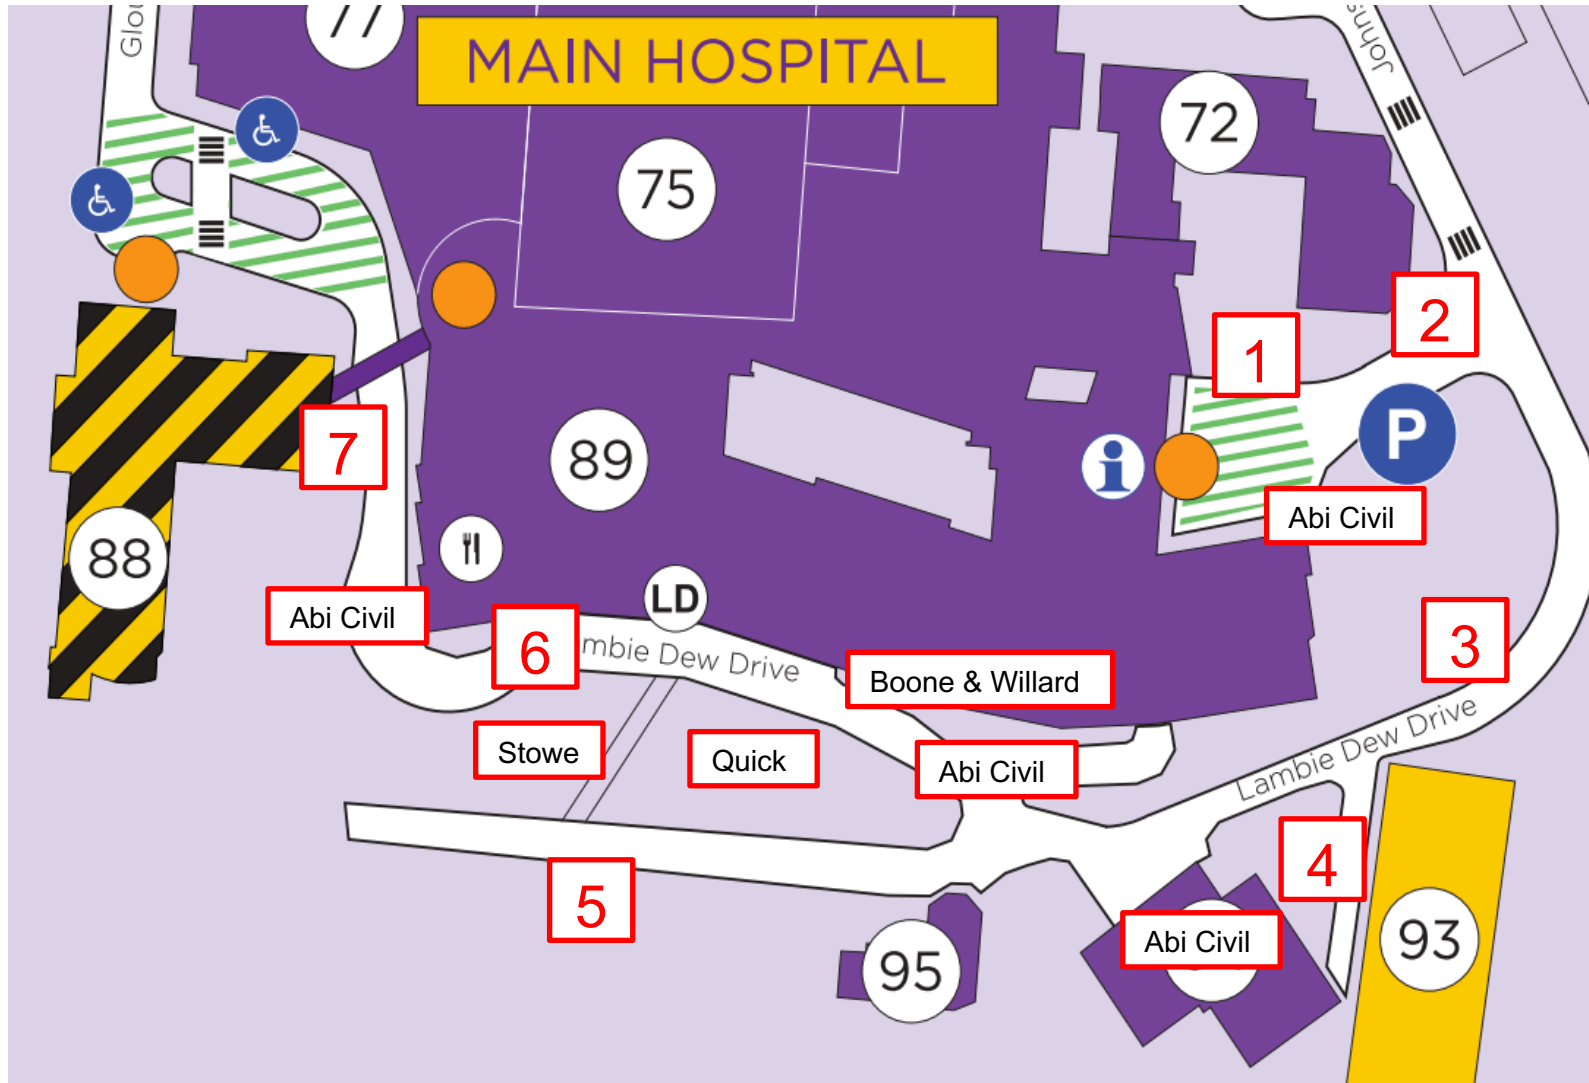


Figure 1. Air Monitoring Location.

TEST REPORT

October 11, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	10/10/24
Date of Analysis:	11/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1395	Redevelopment Works – Location 1	0706	1608	542	2.0	100	0	<0.01
70836 – 1396	Redevelopment Works – Location 2	0704	1609	545	2.0	100	0	<0.01
70836 – 1397	Redevelopment Works – Location 3	0703	1618	555	2.0	100	0	<0.01
70836 – 1398	Red4velopment Works – Location 4	0702	1617	555	2.0	100	0	<0.01
70836 – 1399	Redevelopment Works – Location 5	0713	1615	542	2.0	100	0	<0.01
70836 – 1400	Redevelopment Works – Location 6	0659	1620	561	2.0	100	0	<0.01
70836 – 1401	Redevelopment Works – Location 7	0658	1621	563	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

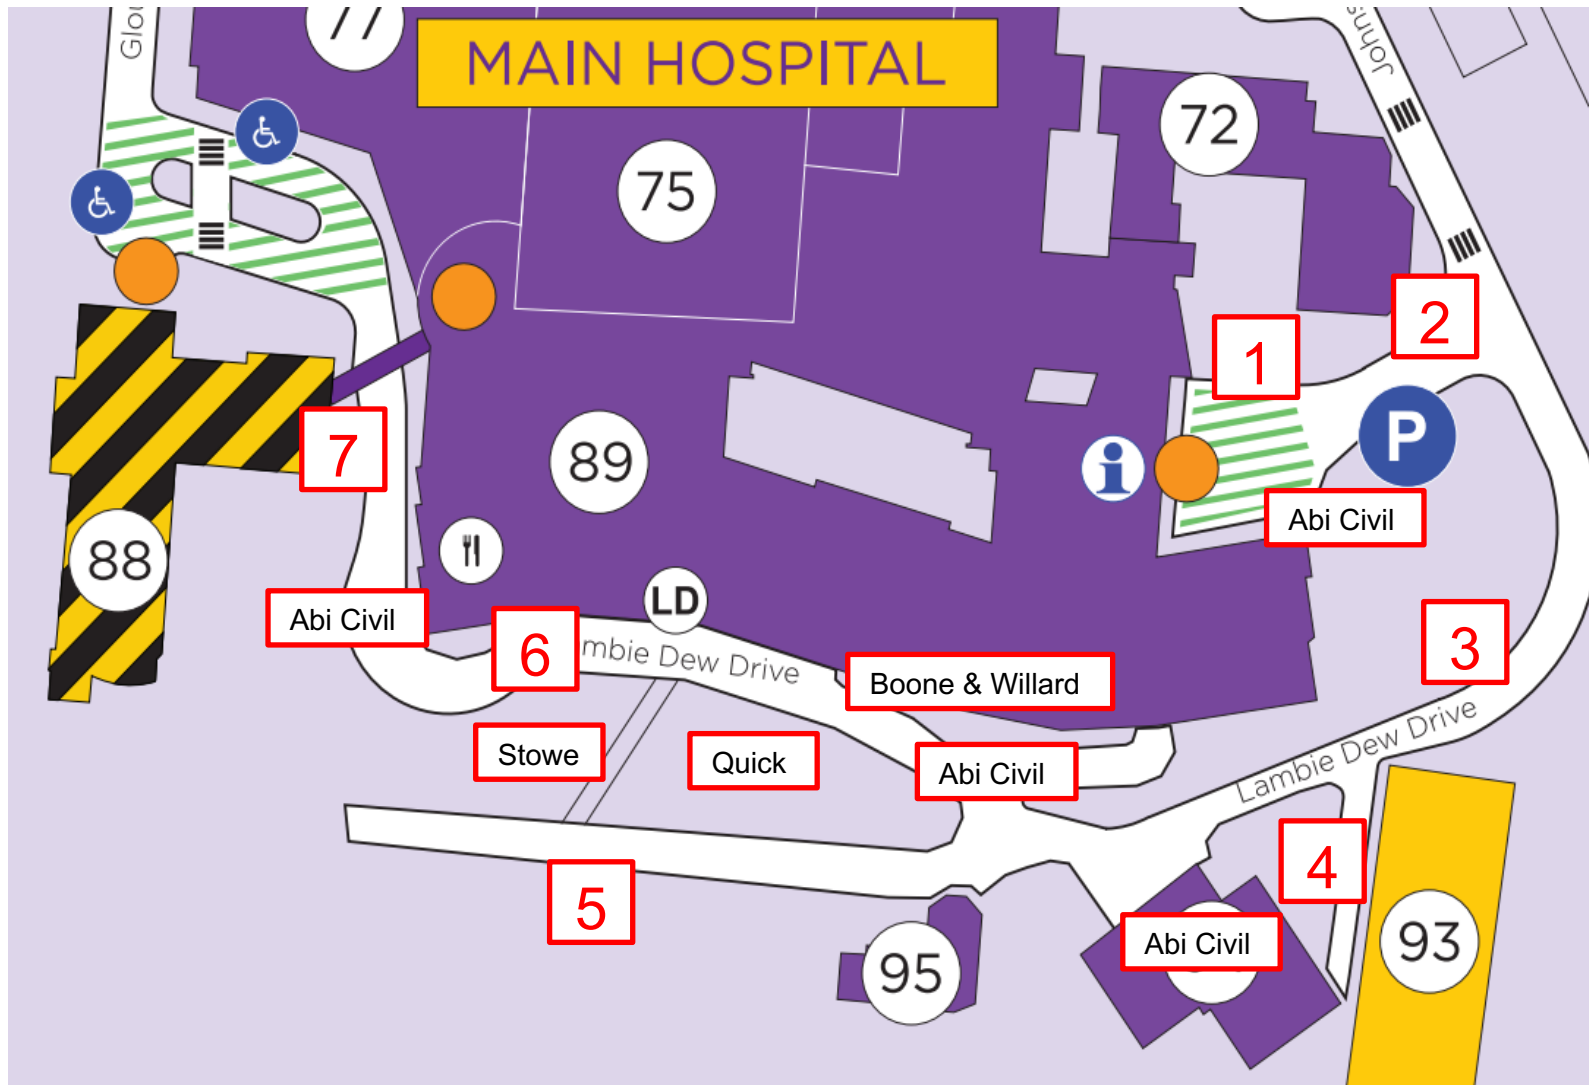


Figure 1. Air Monitoring Location.

TEST REPORT

October 14, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	11/10/24
Date of Analysis:	14/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1402	Redevelopment Works – Location 1	0707	1555	528	2.0	100	0	<0.01
70836 – 1403	Redevelopment Works – Location 2	0706	1554	528	2.0	100	0	<0.01
70836 – 1404	Redevelopment Works – Location 3	0705	1606	541	2.0	100	0	<0.01
70836 – 1405	Red4velopment Works – Location 4	0704	1607	543	2.0	100	0	<0.01
70836 – 1406	Redevelopment Works – Location 5	0711	1600	529	2.0	100	0	<0.01
70836 – 1407	Redevelopment Works – Location 6	0716	1550	514	2.0	100	0	<0.01
70836 – 1408	Redevelopment Works – Location 7	0717	1549	512	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

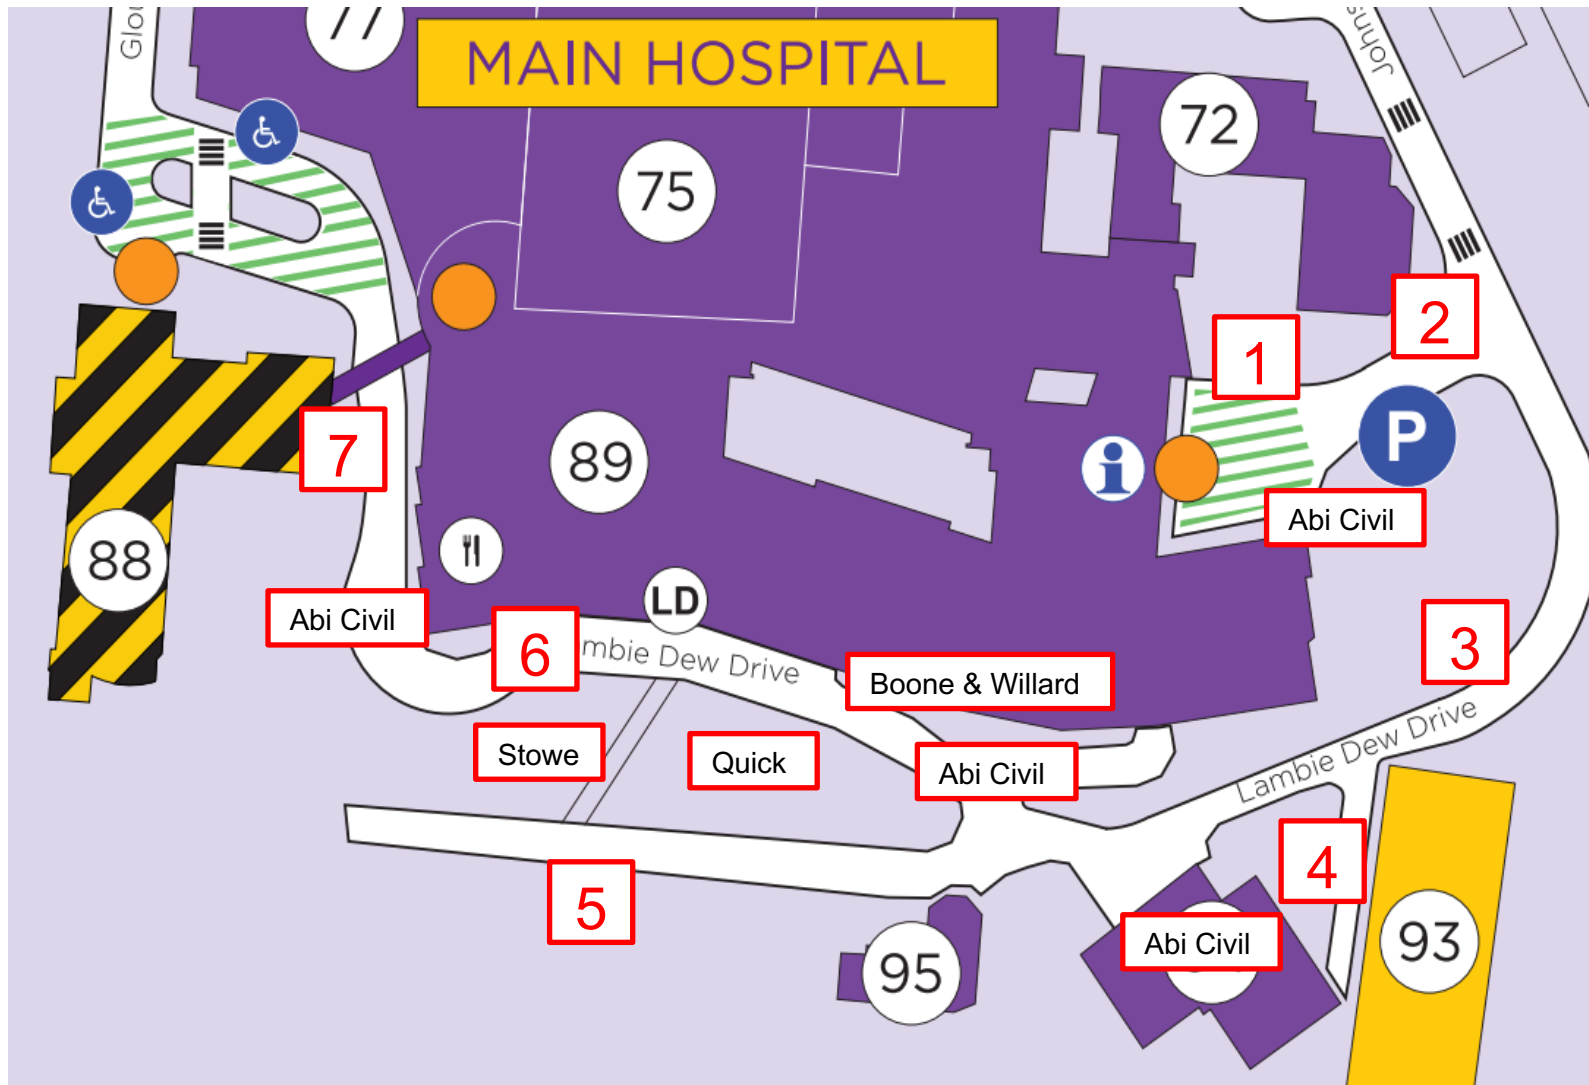


Figure 1. Air Monitoring Location.

TEST REPORT

October 15, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	14/10/24
Date of Analysis:	15/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1409	Redevelopment Works – Location 1	0712	1512	480	2.0	100	0	<0.01
70836 – 1410	Redevelopment Works – Location 2	0713	1513	480	2.0	100	0	<0.01
70836 – 1411	Redevelopment Works – Location 3	0711	1511	480	2.0	100	0	<0.01
70836 – 1412	Red4velopment Works – Location 4	0710	1510	480	2.0	100	0	<0.01
70836 – 1413	Redevelopment Works – Location 5	0716	1516	480	2.0	100	0	<0.01
70836 – 1414	Redevelopment Works – Location 6	0704	1504	480	2.0	100	0	<0.01
70836 – 1415	Redevelopment Works – Location 7	0705	1505	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

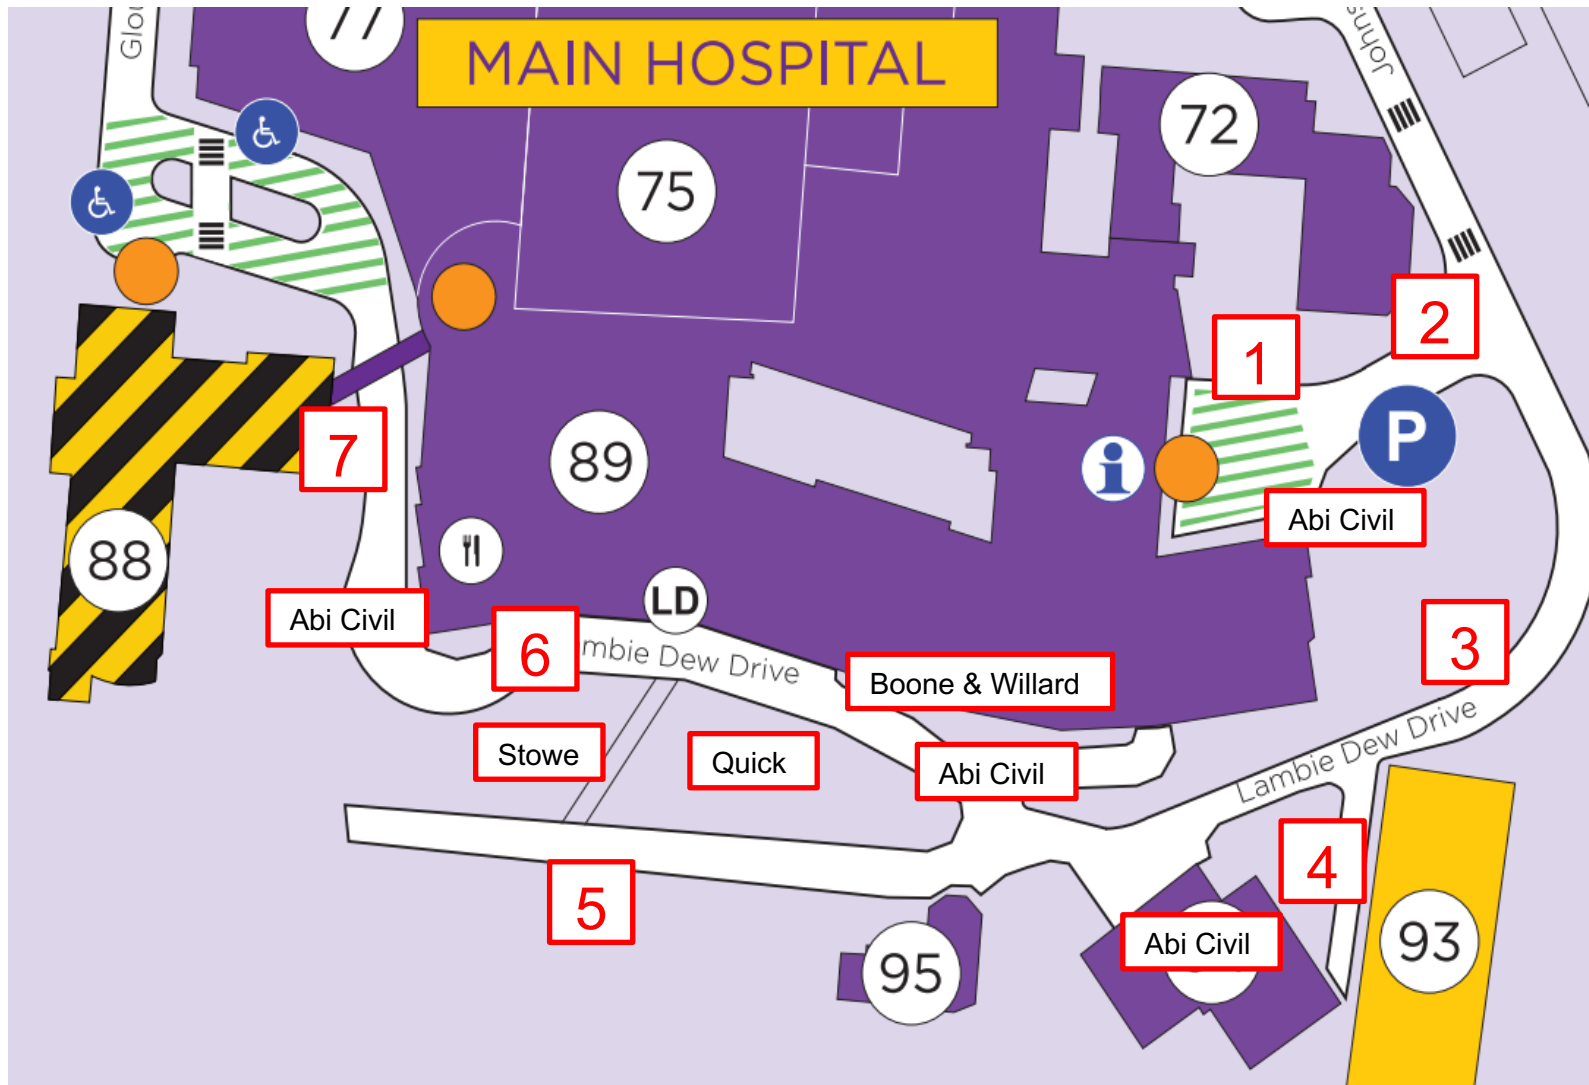


Figure 1. Air Monitoring Location.

TEST REPORT

October 16, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	15/10/24
Date of Analysis:	16/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1416	Redevelopment Works – Location 1	0656	1456	480	2.0	100	0	<0.01
70836 – 1417	Redevelopment Works – Location 2	0655	1455	480	2.0	100	0	<0.01
70836 – 1418	Redevelopment Works – Location 3	0653	1453	480	2.0	100	0	<0.01
70836 – 1419	Red4velopment Works – Location 4	0652	1452	480	2.0	100	0	<0.01
70836 – 1420	Redevelopment Works – Location 5	0700	1500	480	2.0	100	0	<0.01
70836 – 1421	Redevelopment Works – Location 6	0650	1450	480	2.0	100	0	<0.01
70836 – 1422	Redevelopment Works – Location 7	0706	1506	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

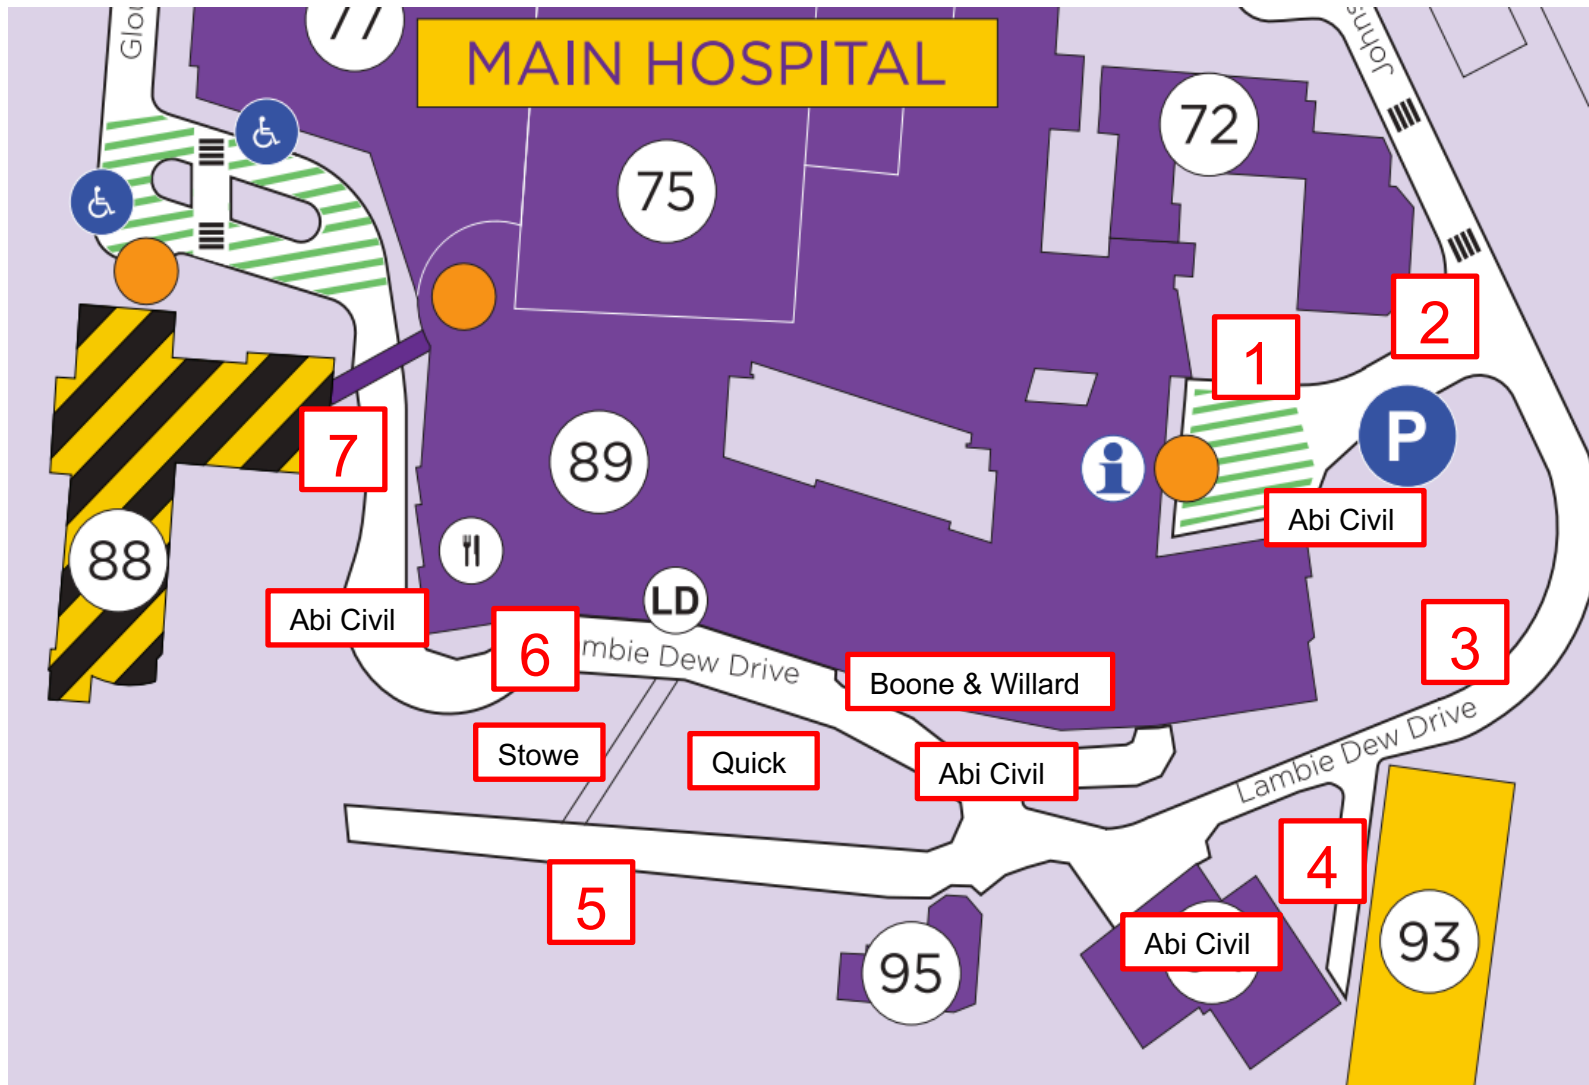


Figure 1. Air Monitoring Location.

TEST REPORT

October 17, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	16/10/24
Date of Analysis:	17/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1423	Redevelopment Works – Location 1	0655	1455	480	2.0	100	0	<0.01
70836 – 1424	Redevelopment Works – Location 2	0654	1454	480	2.0	100	0	<0.01
70836 – 1425	Redevelopment Works – Location 3	0652	1452	480	2.0	100	0	<0.01
70836 – 1426	Red4velopment Works – Location 4	0650	1450	480	2.0	100	0	<0.01
70836 – 1427	Redevelopment Works – Location 5	0654	1454	480	2.0	100	0	<0.01
70836 – 1428	Redevelopment Works – Location 6	0647	1447	480	2.0	100	0	<0.01
70836 – 1429	Redevelopment Works – Location 7	0658	1458	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full

SITE MAP

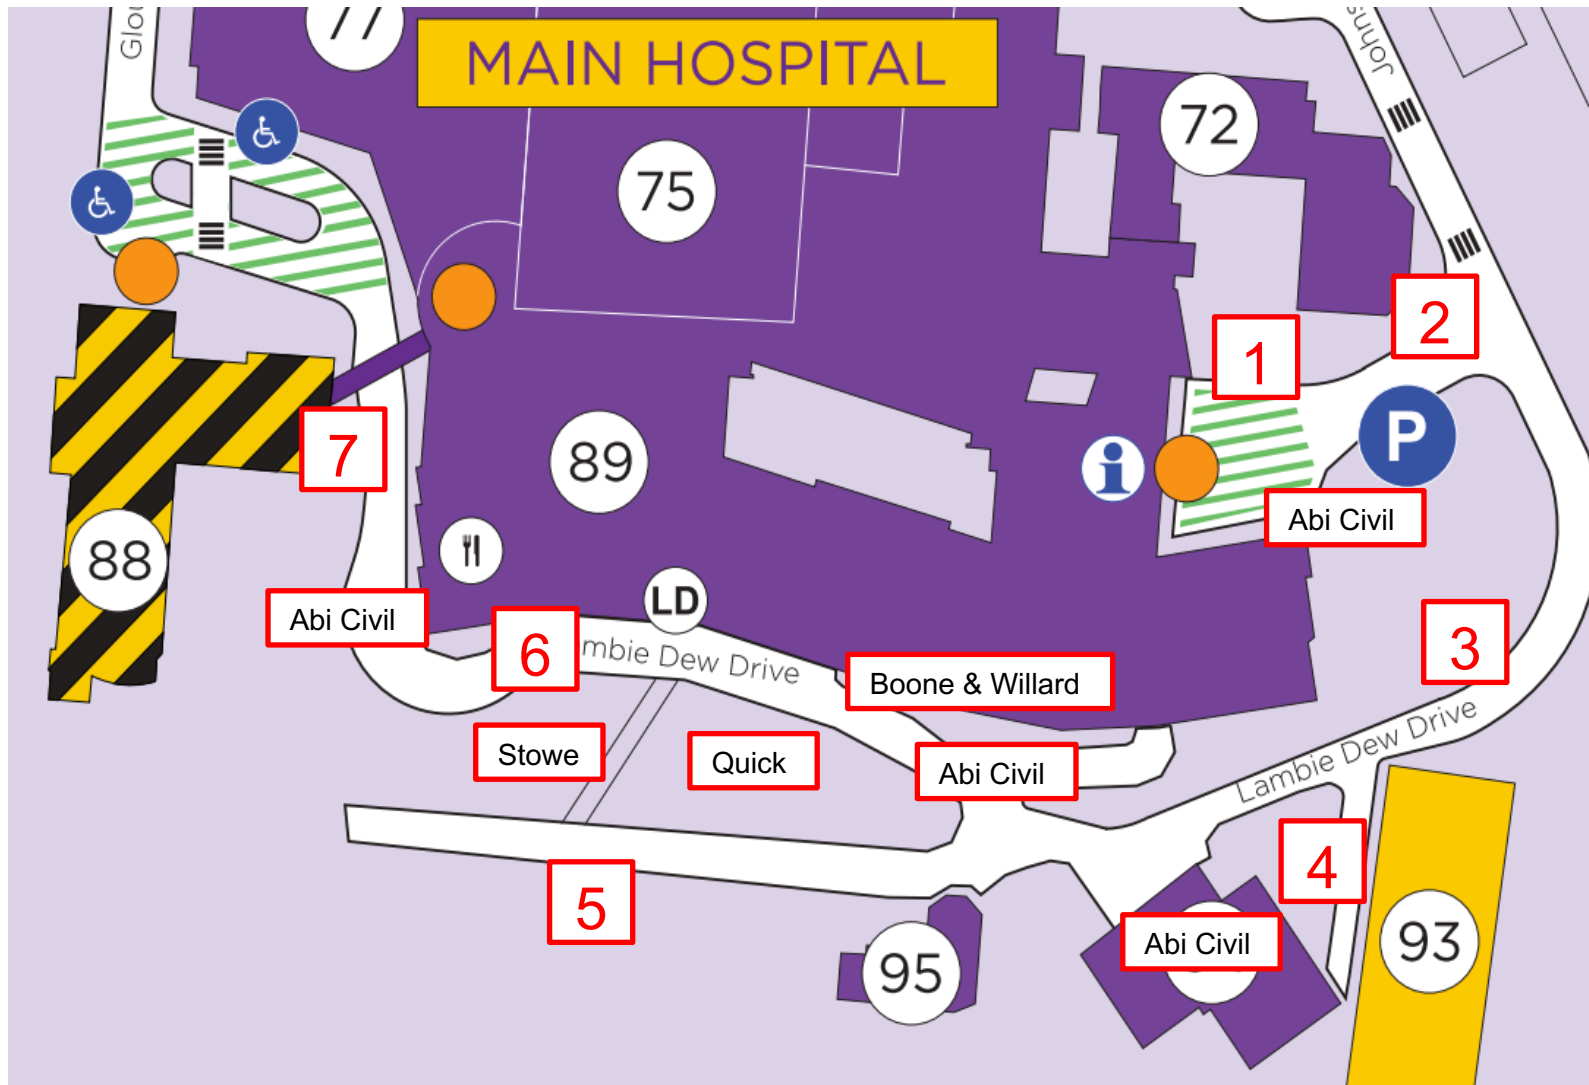


Figure 1. Air Monitoring Location.

TEST REPORT

October 18, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	17/10/24
Date of Analysis:	18/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1430	Redevelopment Works – Location 1	0655	1455	480	2.0	100	0	<0.01
70836 – 1431	Redevelopment Works – Location 2	0654	1454	480	2.0	100	0	<0.01
70836 – 1432	Redevelopment Works – Location 3	0653	1453	480	2.0	100	0	<0.01
70836 – 1433	Red4velopment Works – Location 4	0651	1451	480	2.0	100	0	<0.01
70836 – 1434	Redevelopment Works – Location 5	0659	1459	480	2.0	100	0	<0.01
70836 – 1435	Redevelopment Works – Location 6	0649	1449	480	2.0	100	0	<0.01
70836 – 1436	Redevelopment Works – Location 7	0648	1448	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

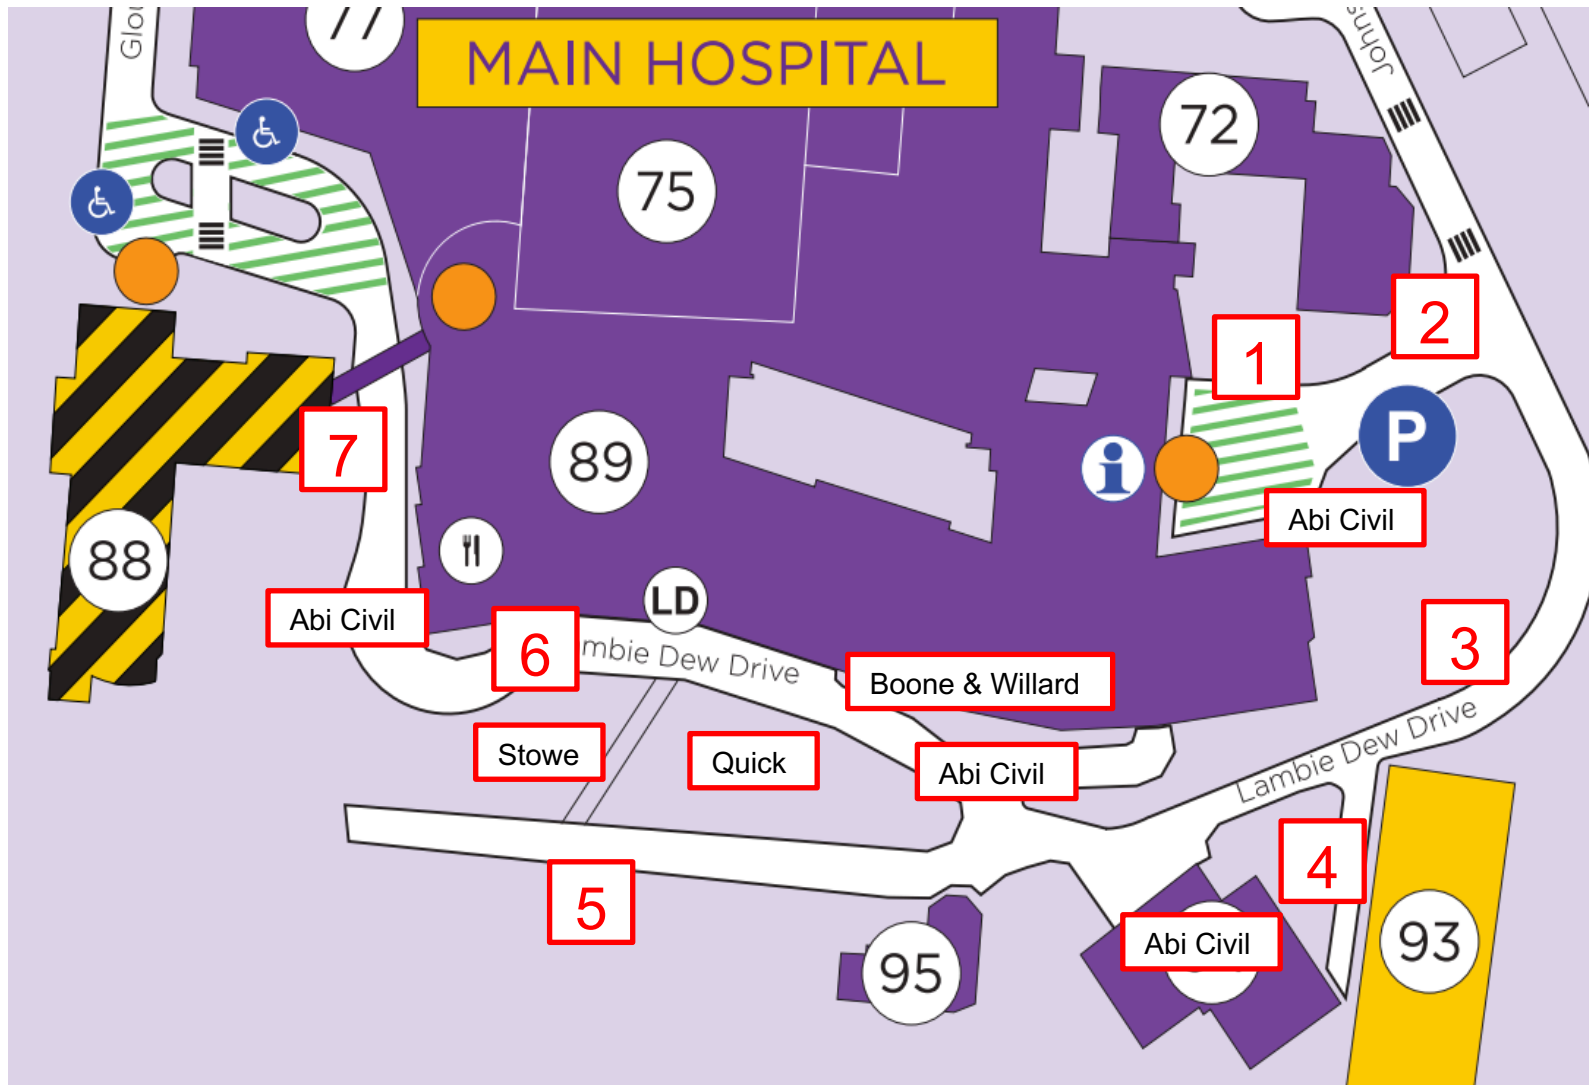


Figure 1. Air Monitoring Location.

TEST REPORT

October 21, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	18/10/24
Date of Analysis:	21/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1437	Redevelopment Works – Location 1	0704	1540	516	2.0	100	0	<0.01
70836 – 1438	Redevelopment Works – Location 2	0703	1541	518	2.0	100	0	<0.01
70836 – 1439	Redevelopment Works – Location 3	0701	1542	521	2.0	100	0	<0.01
70836 – 1440	Red4velopment Works – Location 4	0700	1549	529	2.0	100	0	<0.01
70836 – 1441	Redevelopment Works – Location 5	0709	1546	517	2.0	100	0	<0.01
70836 – 1442	Redevelopment Works – Location 6	0658	1552	534	2.0	100	0	<0.01
70836 – 1443	Redevelopment Works – Location 7	0656	1554	538	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

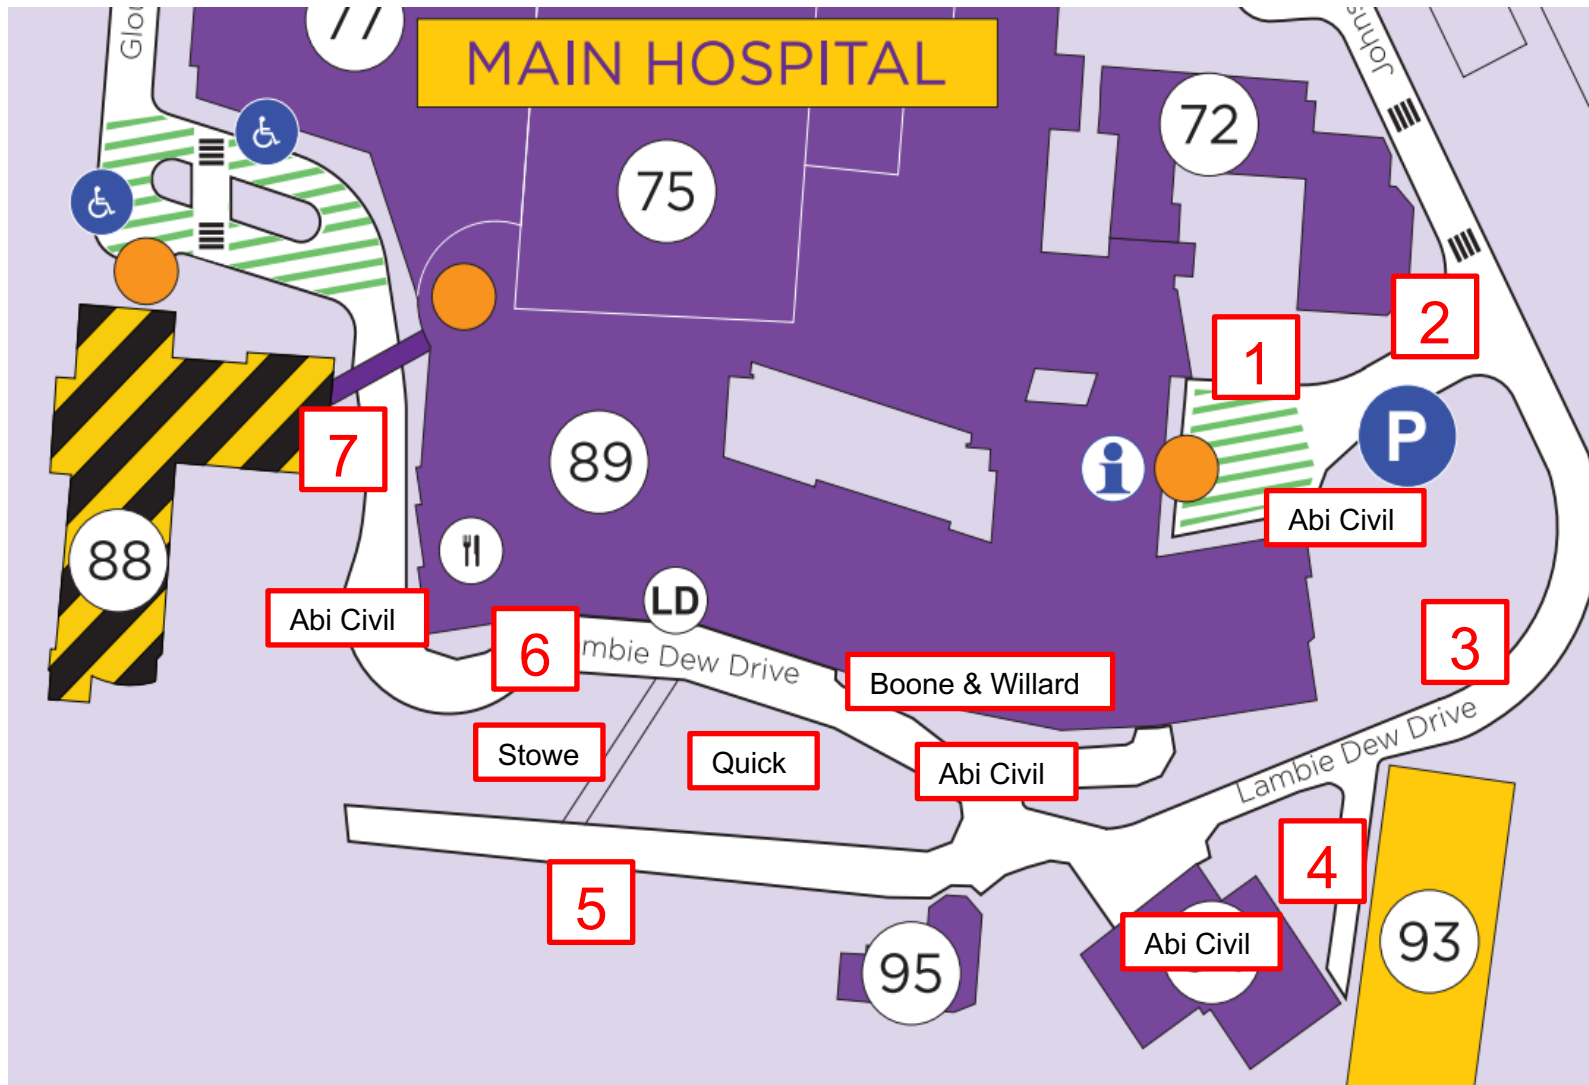


Figure 1. Air Monitoring Location.

TEST REPORT

October 22, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	21/10/24
Date of Analysis:	22/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1444	Redevelopment Works – Location 1	0701	1501	480	2.0	100	0	<0.01
70836 – 1445	Redevelopment Works – Location 2	0757	1457	480	2.0	100	0	<0.01
70836 – 1446	Redevelopment Works – Location 3	0655	1455	480	2.0	100	0	<0.01
70836 – 1447	Red4velopment Works – Location 4	0654	1454	480	2.0	100	0	<0.01
70836 – 1448	Redevelopment Works – Location 5	0704	1504	480	2.0	100	0	<0.01
70836 – 1449	Redevelopment Works – Location 6	0651	1451	480	2.0	100	0	<0.01
70836 – 1450	Redevelopment Works – Location 7	0650	1450	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

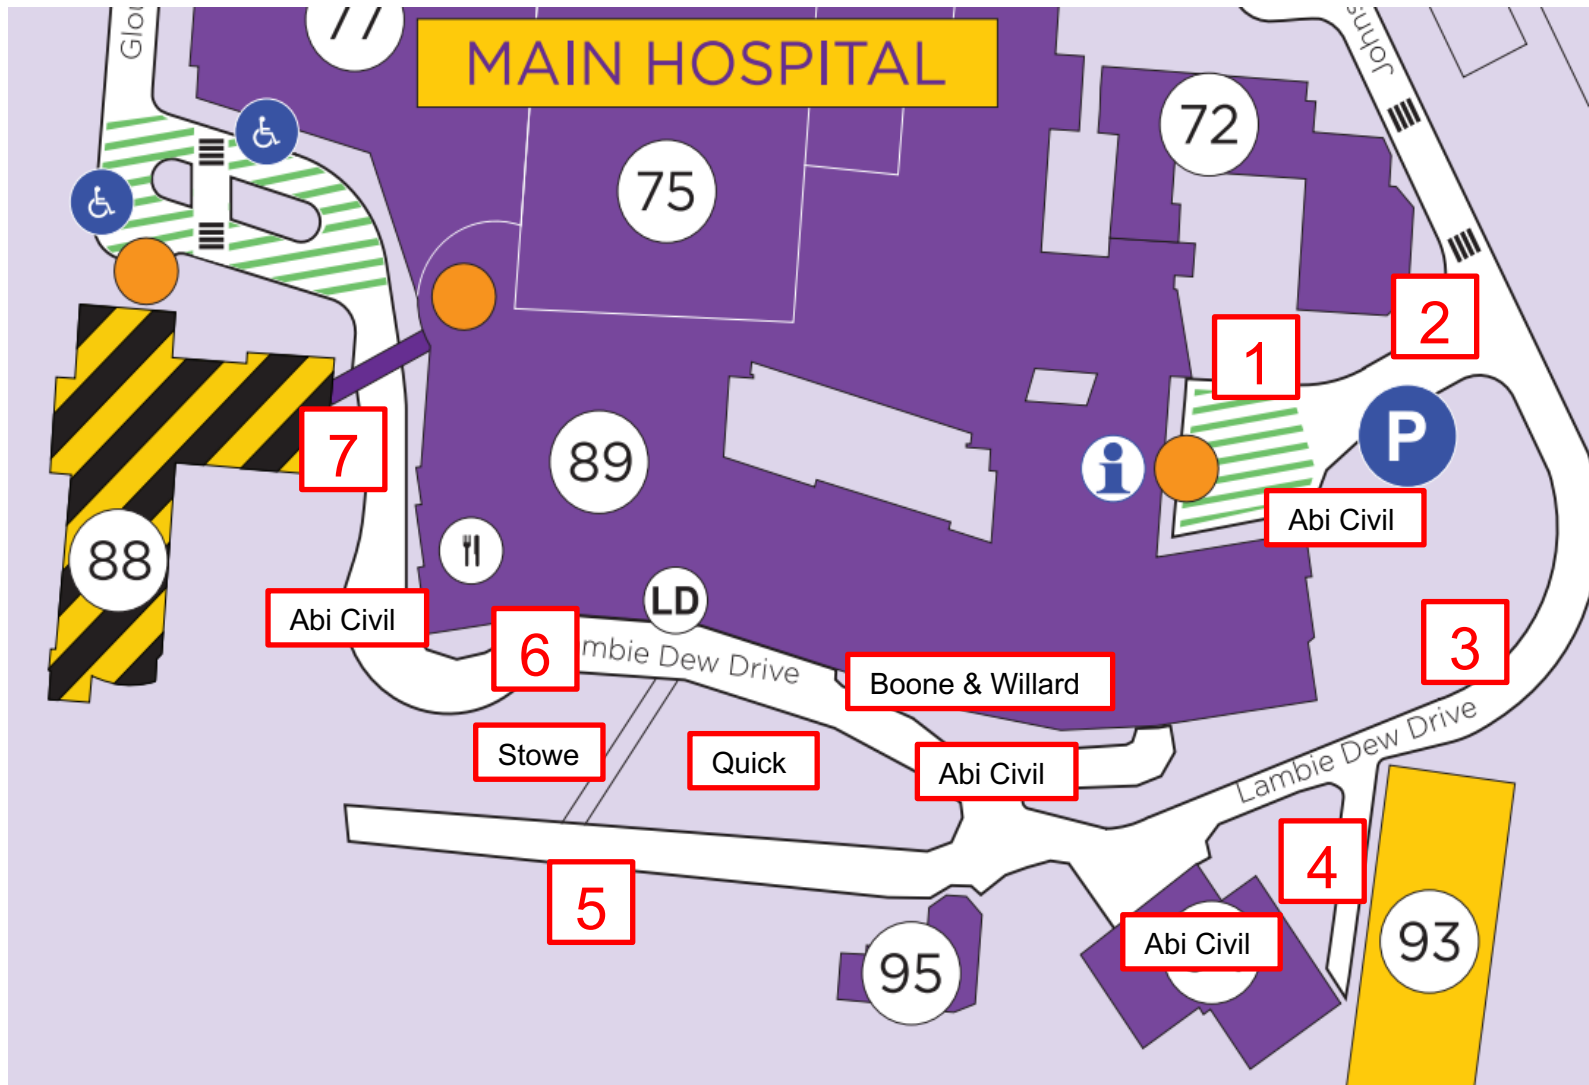


Figure 1. Air Monitoring Location.

TEST REPORT

October 23, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	22/10/24
Date of Analysis:	23/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1451	Redevelopment Works – Location 1	0703	1503	480	2.0	100	0	<0.01
70836 – 1452	Redevelopment Works – Location 2	0701	1501	480	2.0	100	0	<0.01
70836 – 1453	Redevelopment Works – Location 3	0700	1500	480	2.0	100	0	<0.01
70836 – 1454	Red4velopment Works – Location 4	0709	1509	480	2.0	100	0	<0.01
70836 – 1455	Redevelopment Works – Location 5	0706	1506	480	2.0	100	0	<0.01
70836 – 1456	Redevelopment Works – Location 6	0657	1457	480	2.0	100	0	<0.01
70836 – 1457	Redevelopment Works – Location 7	0655	1455	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

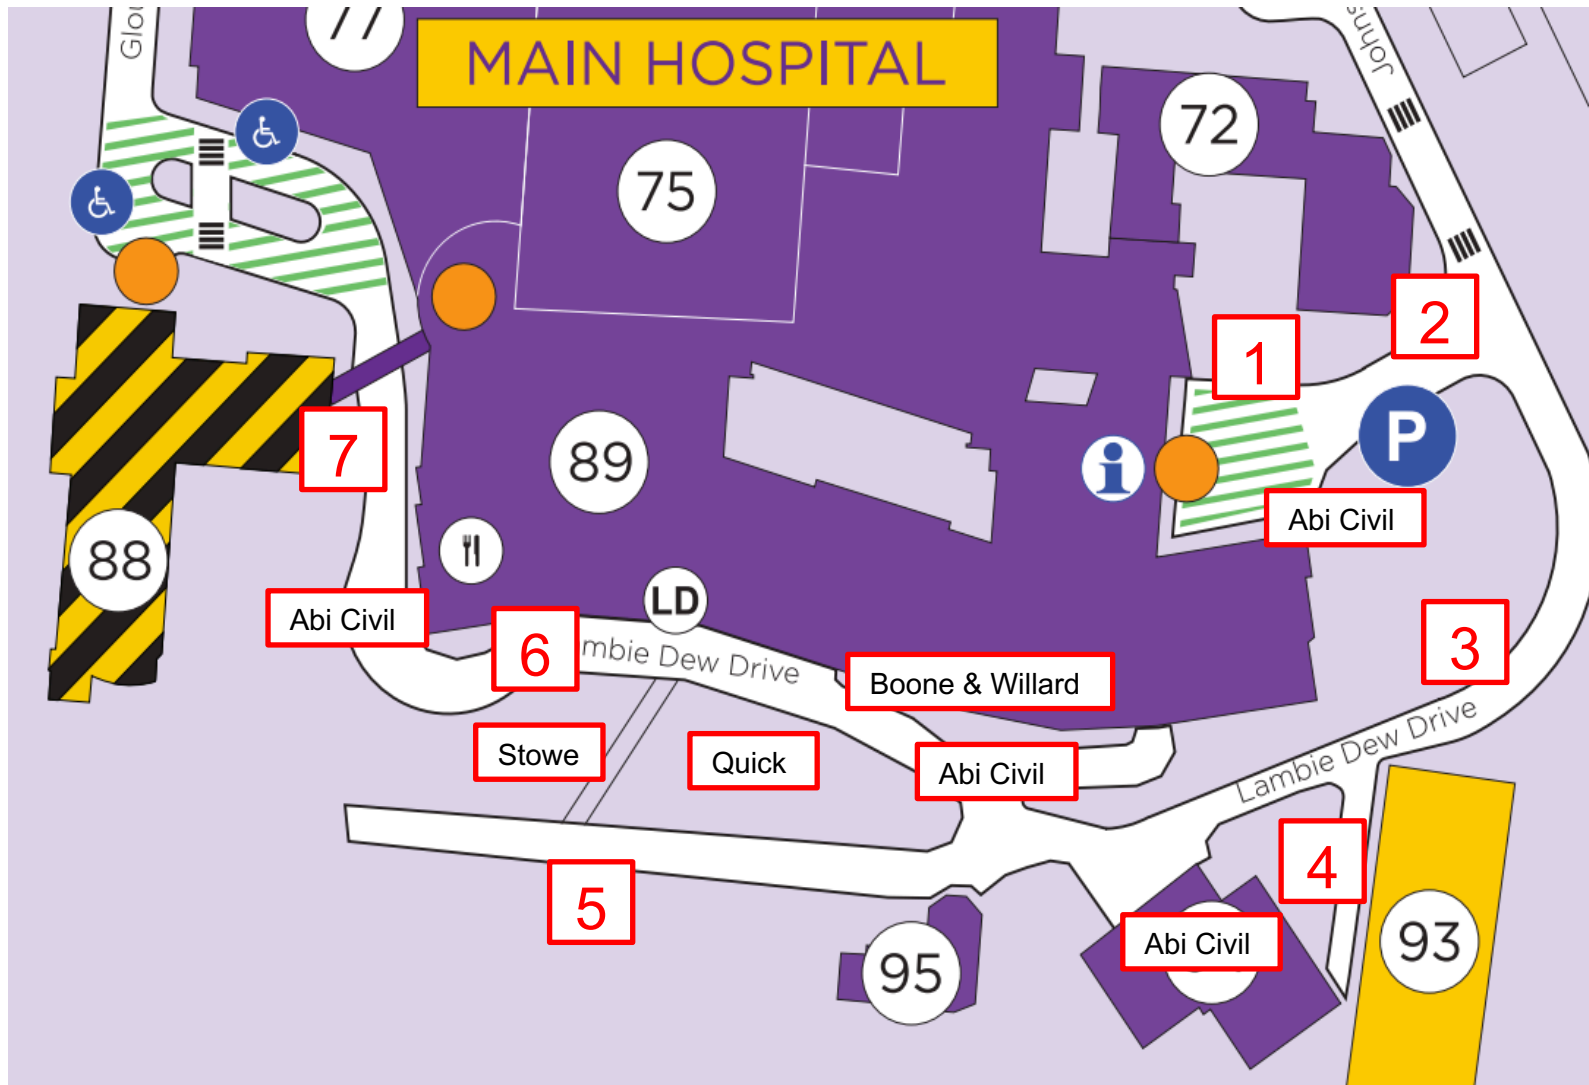


Figure 1. Air Monitoring Location.

TEST REPORT

October 24, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	23/10/24
Date of Analysis:	24/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1458	Redevelopment Works – Location 1	0653	1453	480	2.0	100	0	<0.01
70836 – 1459	Redevelopment Works – Location 2	0650	1450	480	2.0	100	0	<0.01
70836 – 1460	Redevelopment Works – Location 3	0648	1448	480	2.0	100	0	<0.01
70836 – 1461	Red4velopment Works – Location 4	0700	1500	480	2.0	100	0	<0.01
70836 – 1462	Redevelopment Works – Location 5	0657	1457	480	2.0	100	0	<0.01
70836 – 1463	Redevelopment Works – Location 6	0703	1503	480	2.0	100	0	<0.01
70836 – 1464	Redevelopment Works – Location 7	0705	1505	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

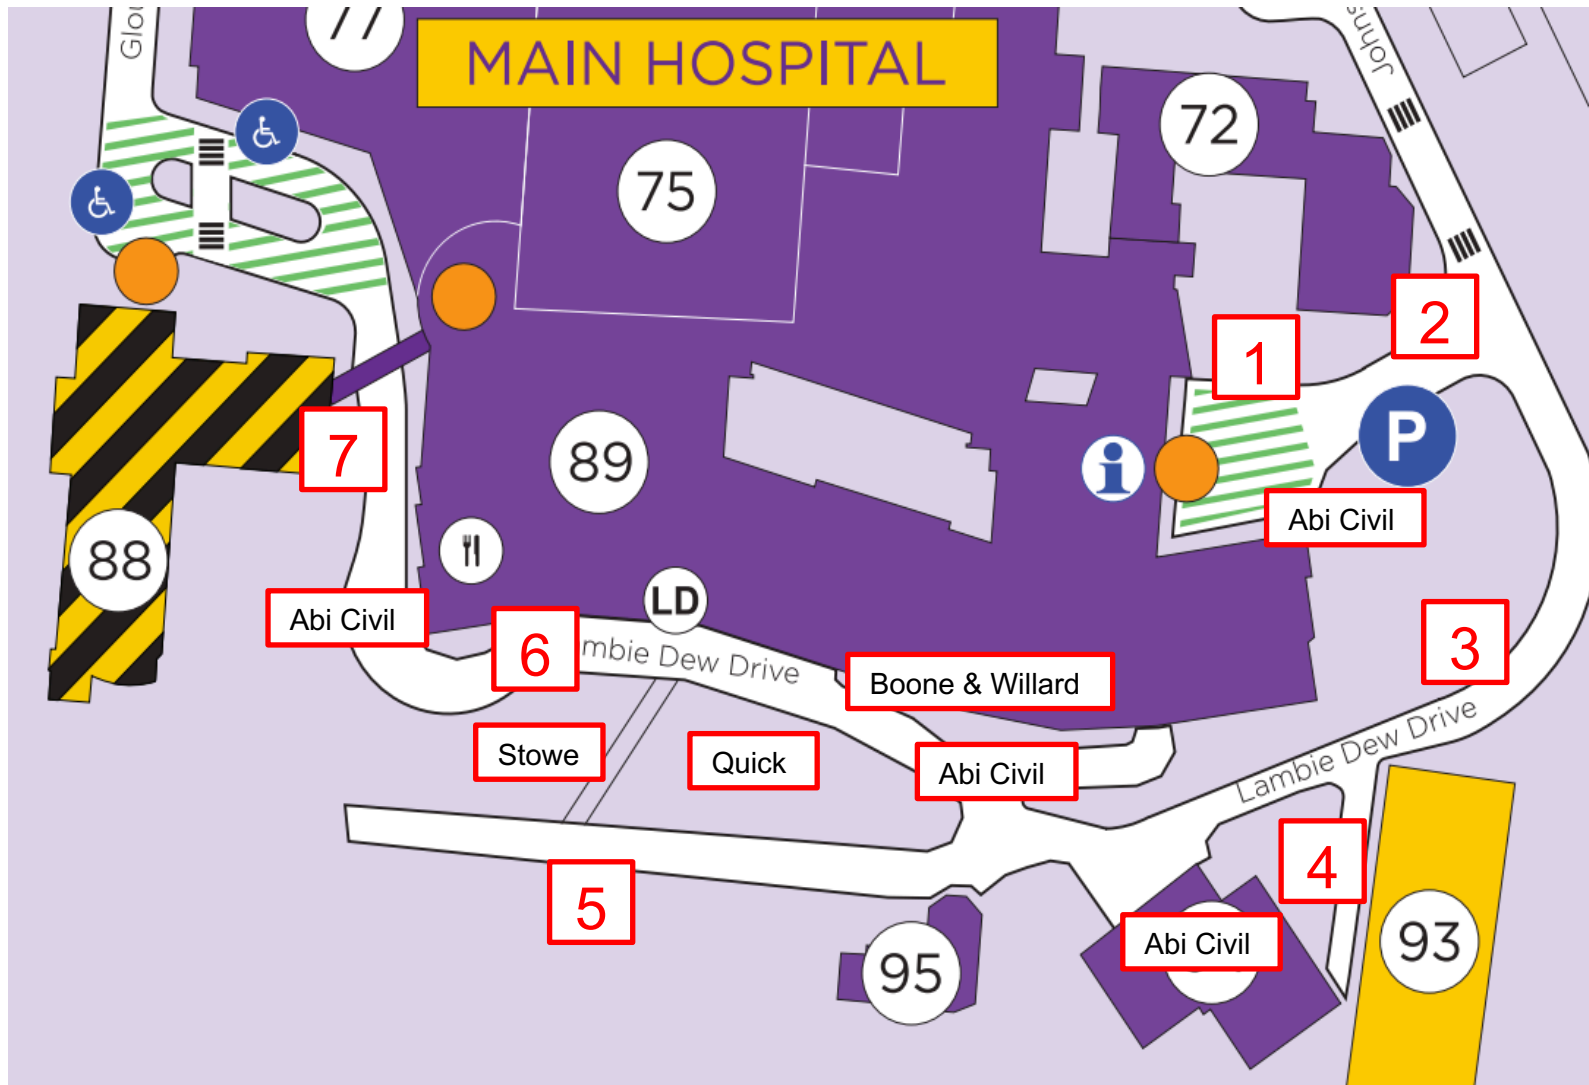


Figure 1. Air Monitoring Location.

TEST REPORT

October 25, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	24/10/24
Date of Analysis:	25/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1458	Redevelopment Works – Location 1	0750	1550	480	2.0	100	0	<0.01
70836 – 1459	Redevelopment Works – Location 2	0749	1549	480	2.0	100	0	<0.01
70836 – 1460	Redevelopment Works – Location 3	0648	1548	480	2.0	100	0	<0.01
70836 – 1461	Red4velopment Works – Location 4	0659	1559	480	2.0	100	0	<0.01
70836 – 1462	Redevelopment Works – Location 5	0654	1554	480	2.0	100	0	<0.01
70836 – 1463	Redevelopment Works – Location 6	0644	1544	480	2.0	100	0	<0.01
70836 – 1464	Redevelopment Works – Location 7	0643	1543	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

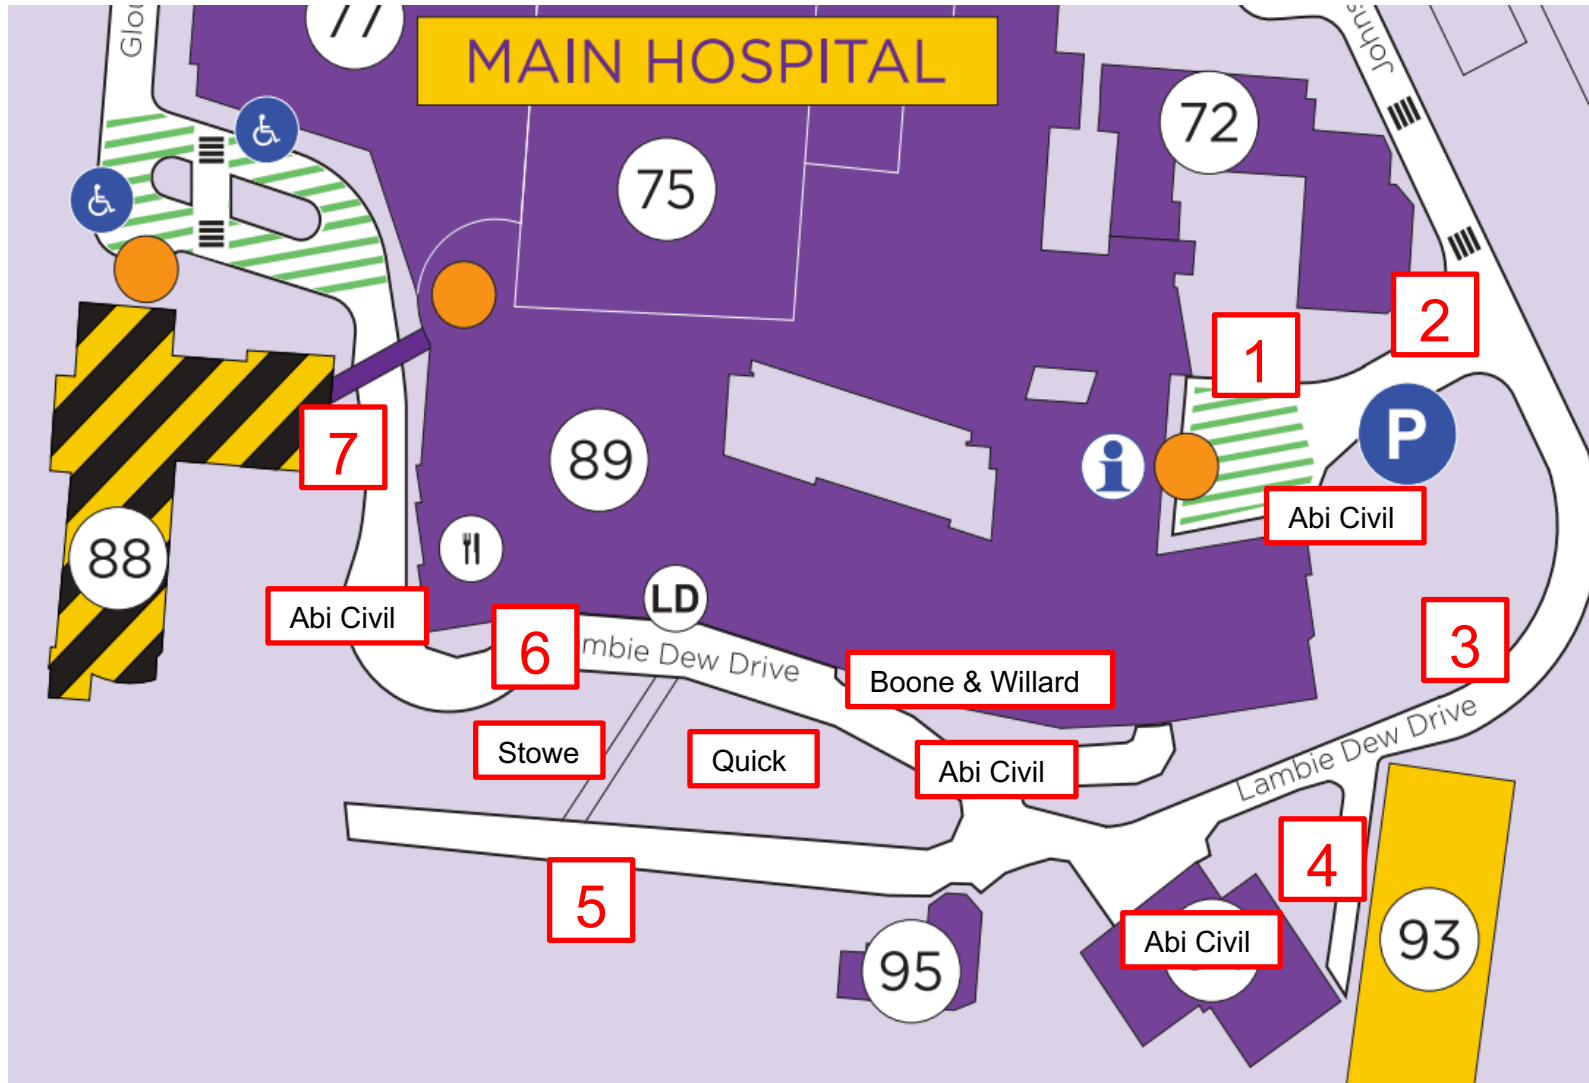


Figure 1. Air Monitoring Location.

TEST REPORT

October 28, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	25/10/24
Date of Analysis:	28/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1472	Redevelopment Works – Location 1	0654	1445	471	2.0	100	0	<0.01
70836 – 1473	Redevelopment Works – Location 2	0653	1447	474	2.0	100	0	<0.01
70836 – 1474	Redevelopment Works – Location 3	0651	1448	477	2.0	100	0	<0.01
70836 – 1475	Red4velopment Works – Location 4	0650	1448	478	2.0	100	0	<0.01
70836 – 1476	Redevelopment Works – Location 5	0657	1449	472	2.0	100	0	<0.01
70836 – 1477	Redevelopment Works – Location 6	0646	1452	486	2.0	100	0	<0.01
70836 – 1478	Redevelopment Works – Location 7	0647	1454	487	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

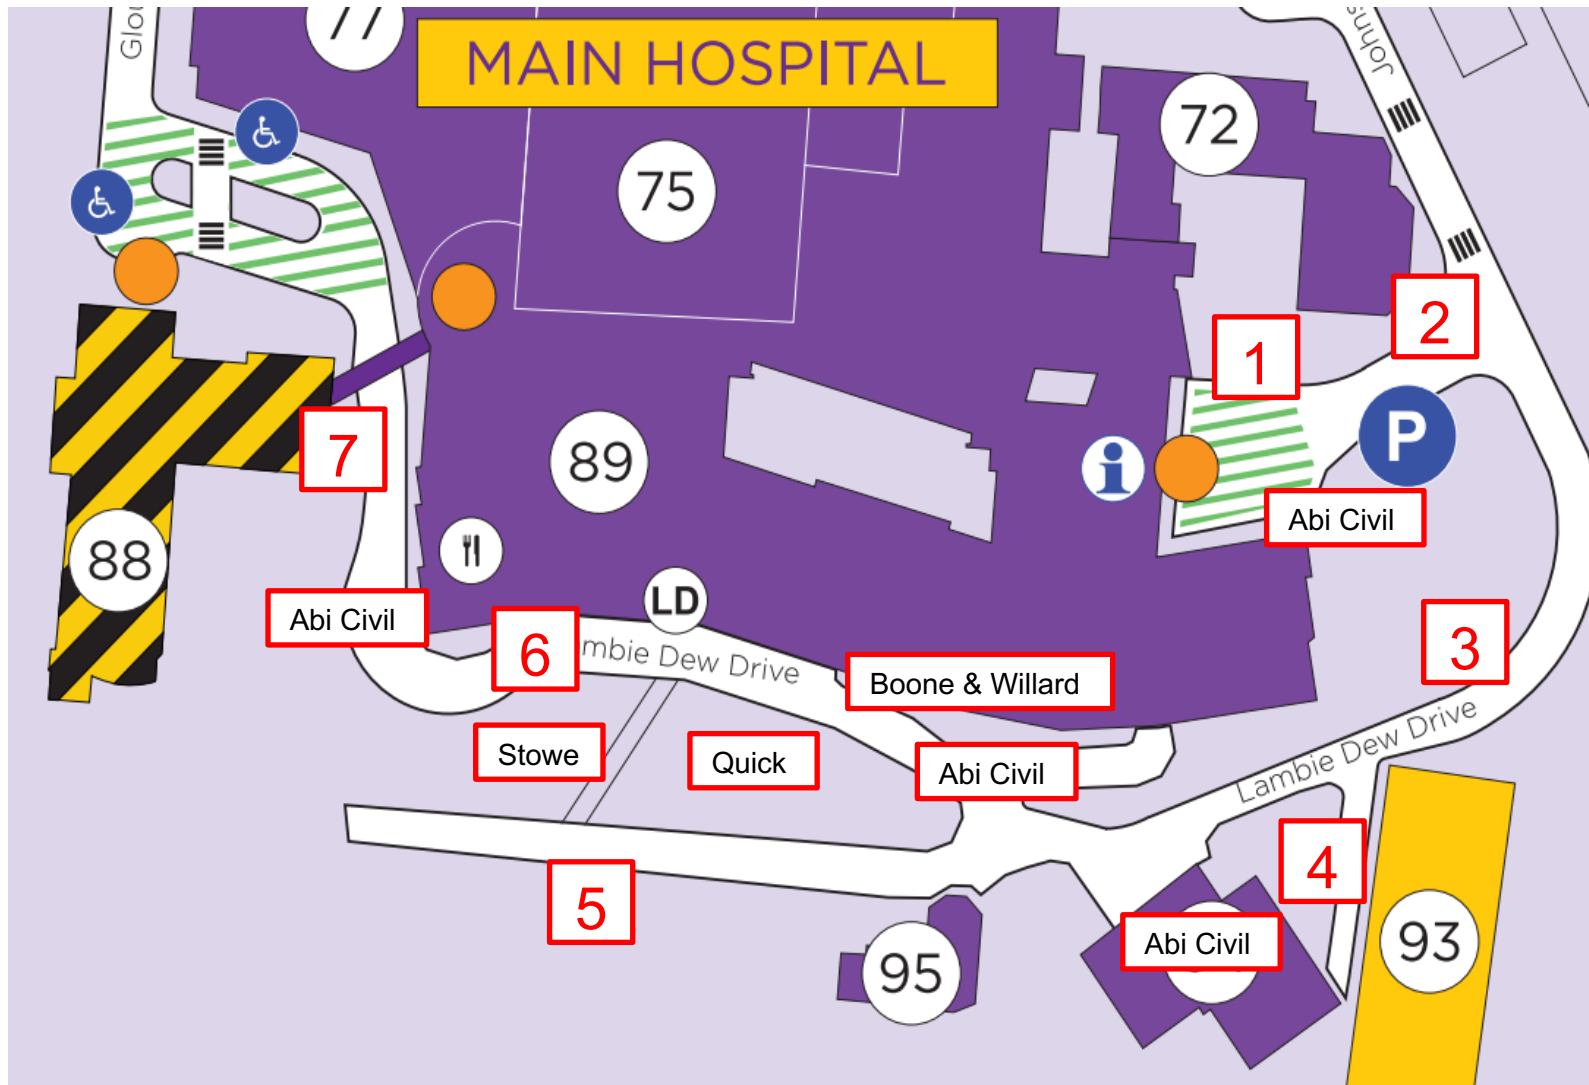


Figure 1. Air Monitoring Location.

TEST REPORT

October 29, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	28/10/24
Date of Analysis:	29/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1479	Redevelopment Works – Location 1	0636	1436	480	2.0	100	0	<0.01
70836 – 1480	Redevelopment Works – Location 2	0635	1435	480	2.0	100	0	<0.01
70836 – 1481	Redevelopment Works – Location 3	0634	1434	480	2.0	100	0	<0.01
70836 – 1482	Red4velopment Works – Location 4	0633	1433	480	2.0	100	0	<0.01
70836 – 1483	Redevelopment Works – Location 5	0639	1439	480	2.0	100	0	<0.01
70836 – 1484	Redevelopment Works – Location 6	0631	1431	480	2.0	100	0	<0.01
70836 – 1485	Redevelopment Works – Location 7	0630	1430	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

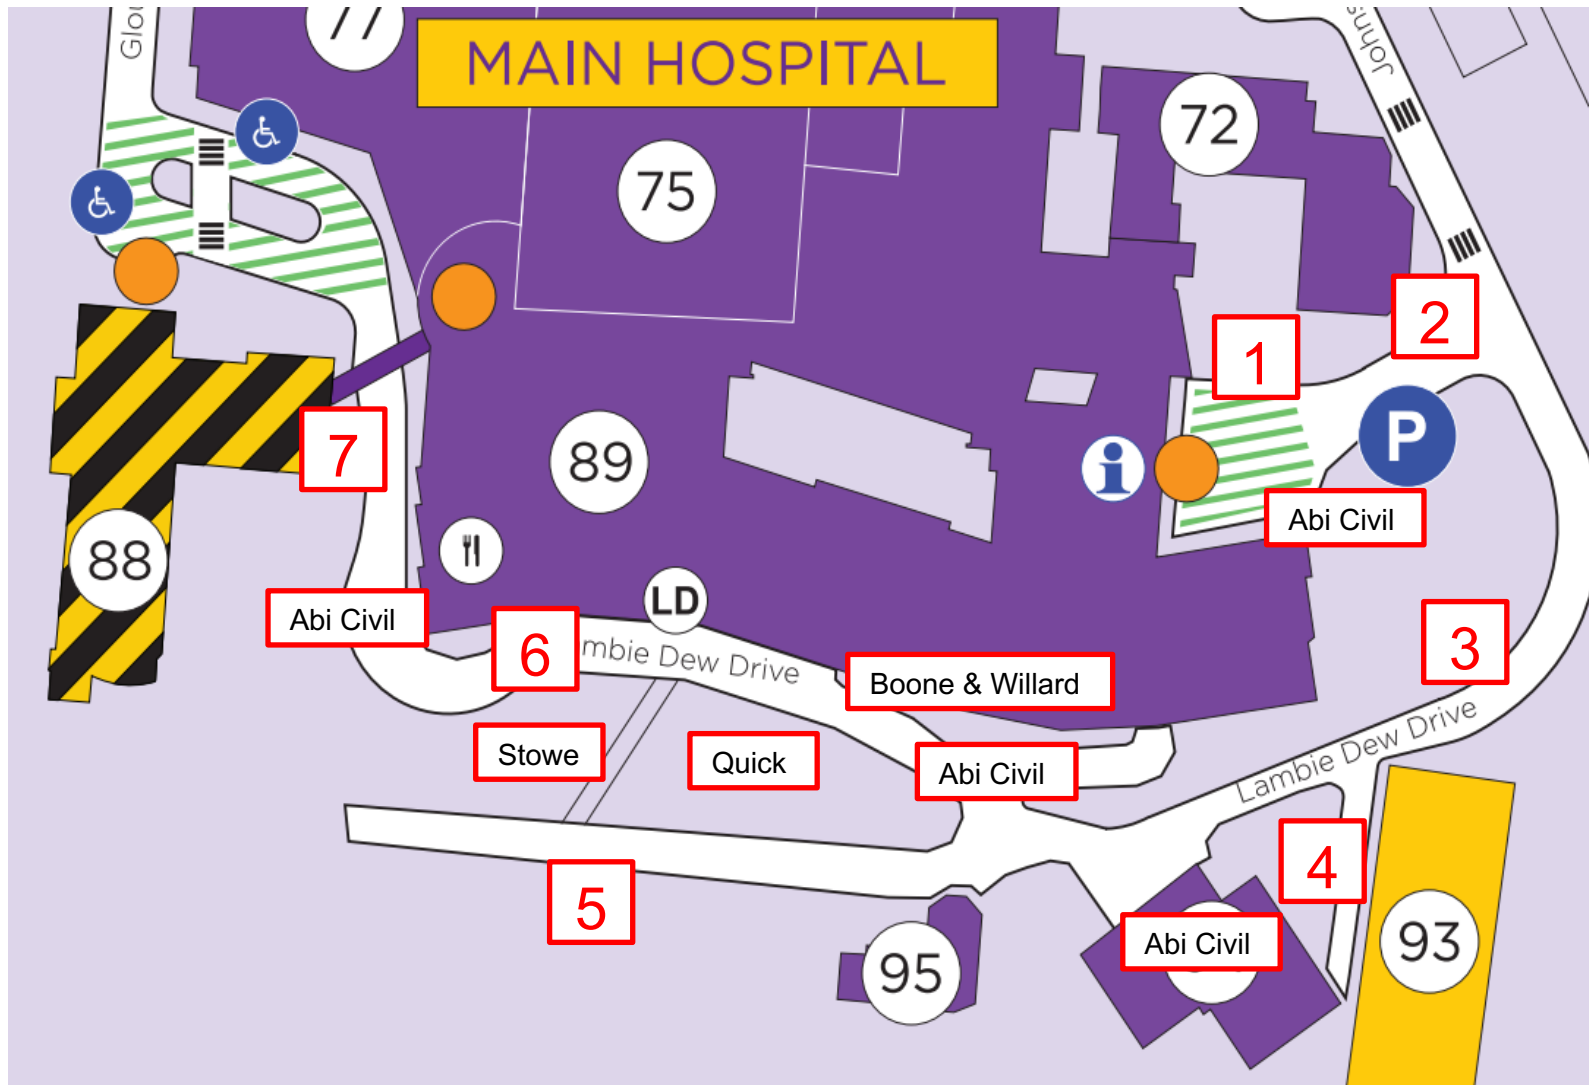


Figure 1. Air Monitoring Location.

TEST REPORT

October 31, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	30/10/24
Date of Analysis:	31/10/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1493	Redevelopment Works – Location 1	0703	1503	480	2.0	100	0	<0.01
70836 – 1494	Redevelopment Works – Location 2	0701	1501	480	2.0	100	0	<0.01
70836 – 1495	Redevelopment Works – Location 3	0659	1459	480	2.0	100	0	<0.01
70836 – 1496	Red4velopment Works – Location 4	0658	1458	480	2.0	100	0	<0.01
70836 – 1497	Redevelopment Works – Location 5	0706	1506	480	2.0	100	0	<0.01
70836 – 1498	Redevelopment Works – Location 6	0655	1455	480	2.0	100	0	<0.01
70836 – 1499	Redevelopment Works – Location 7	0652	1452	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

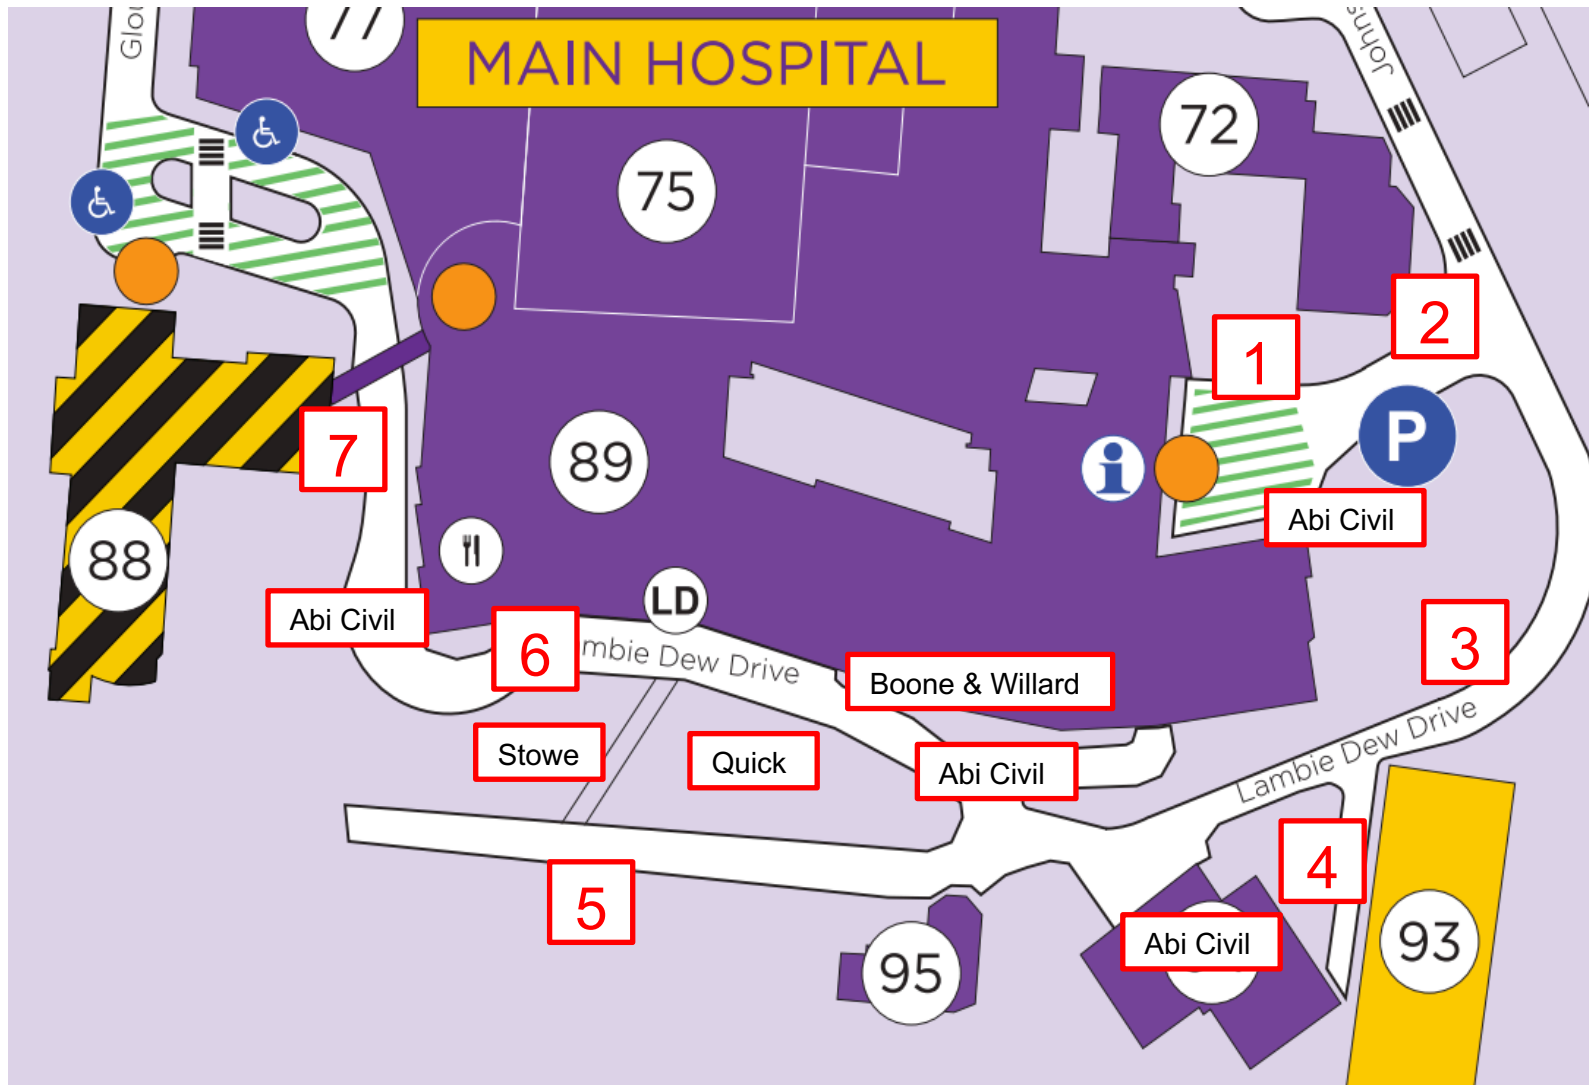


Figure 1. Air Monitoring Location.

TEST REPORT

November 01, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	31/10/24
Date of Analysis:	01/11/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1500	Redevelopment Works – Location 1	0700	1500	480	2.0	100	0	<0.01
70836 – 1501	Redevelopment Works – Location 2	0659	1459	480	2.0	100	0	<0.01
70836 – 1502	Redevelopment Works – Location 3	0657	1457	480	2.0	100	0	<0.01
70836 – 1503	Red4velopment Works – Location 4	0656	1456	480	2.0	100	0	<0.01
70836 – 1504	Redevelopment Works – Location 5	0704	1504	480	2.0	100	0	<0.01
70836 – 1505	Redevelopment Works – Location 6	0652	1452	480	2.0	100	0	<0.01
70836 – 1506	Redevelopment Works – Location 7	0650	1450	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

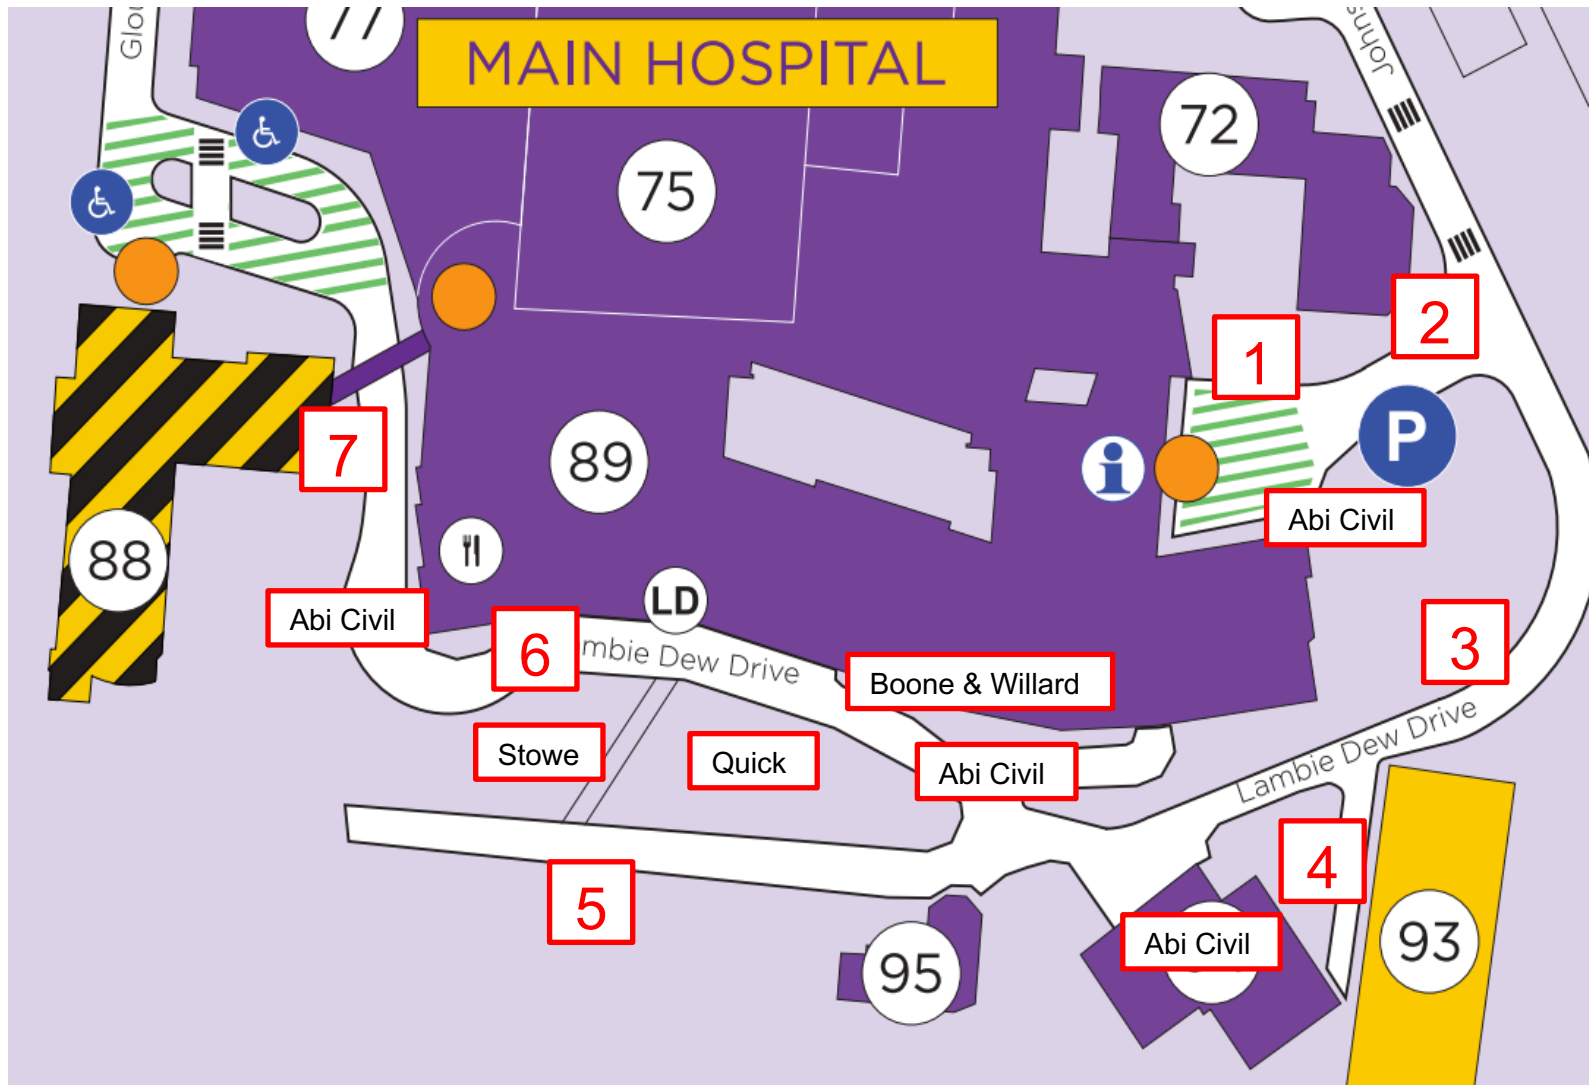


Figure 1. Air Monitoring Location.