

JBS&G (65686 – 162,696)

AMR282 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

2 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR282: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Tuesday 01 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025–Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1144615-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 01, 2024
Date Reported Oct 01, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 01, 2024
Report 1144615-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0001555	DI485158	AC142	LOC1: LP7, NE ADJ TO LP6 + P14	7:06	15:00	2.0	2.0	0/100	< 0.01
24-Oc0001556	DI485159	AC257	LOC2: BIRSB, WEST ADJ TO P14	7:08	15:02	2.0	2.0	0/100	< 0.01
24-Oc0001557	DI485164	AC248	LOC3: BIRSB, CENTRE OPPOSITE MAINTAINING WALL	7:10	15:04	2.0	2.0	0/100	< 0.01
24-Oc0001558	DI485161	AC172	LOC4: BIRSB, SW ADJ TO P14 + LP8	7:12	15:06	2.0	2.0	0/100	< 0.01
24-Oc0001559	DI485188	AC152	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:14	15:08	2.0	2.0	0/100	< 0.01
24-Oc0001560	DI485162	AC027	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:16	15:10	2.0	2.0	0/100	< 0.01
24-Oc0001561	DI485169	AC119	LOC7: BIRSB, EAST ADJ TO CCC	7:19	15:13	2.0	2.0	0/100	< 0.01
24-Oc0001562	DI485185	AC035	LOC8: LP7, SW ADJ TO SITE SHED	7:24	15:17	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0001563	DI485192	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 01, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079
---	--	--	--	---	--

Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370	Perth ProMicro 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2561 Site# 2554
---	--

Auckland 35 O'Rorke Road Penrose, Auckland 1061 +64 9 526 4551 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--

web: www.eurofins.com.au
email: EnviroSales@eurofins.com

Company Name: JBS & G Australia (NSW) P/L	Order No.:	Received: Oct 1, 2024 4:02 PM
Address: Level 1, 50 Margaret St Sydney NSW 2000	Report #: 1144615	Due: Oct 1, 2024
Project Name: IMHC WESTMEAD	Phone: 02 8245 0300	Priority: Same day
Project ID: 65686	Fax:	Contact Name: Milad Noujaim
Eurofins Analytical Services Manager : Andrew Black		

Sample Detail	Asbestos Fibre Count & Concentration
----------------------	--------------------------------------

Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DI485158	Oct 01, 2024	3:00PM	Air	S24-Oc0001555	X
2	DI485159	Oct 01, 2024	3:02PM	Air	S24-Oc0001556	X
3	DI485164	Oct 01, 2024	3:04PM	Air	S24-Oc0001557	X
4	DI485161	Oct 01, 2024	3:06PM	Air	S24-Oc0001558	X
5	DI485188	Oct 01, 2024	3:08PM	Air	S24-Oc0001559	X
6	DI485162	Oct 01, 2024	3:10PM	Air	S24-Oc0001560	X
7	DI485169	Oct 01, 2024	3:13PM	Air	S24-Oc0001561	X
8	DI485185	Oct 01, 2024	3:17PM	Air	S24-Oc0001562	X
9	DI485192	Oct 01, 2024		Air	S24-Oc0001563	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Geronimo Jr Abrot Senior Analyst-Asbestos

Authorised by:

Sayed Abu Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

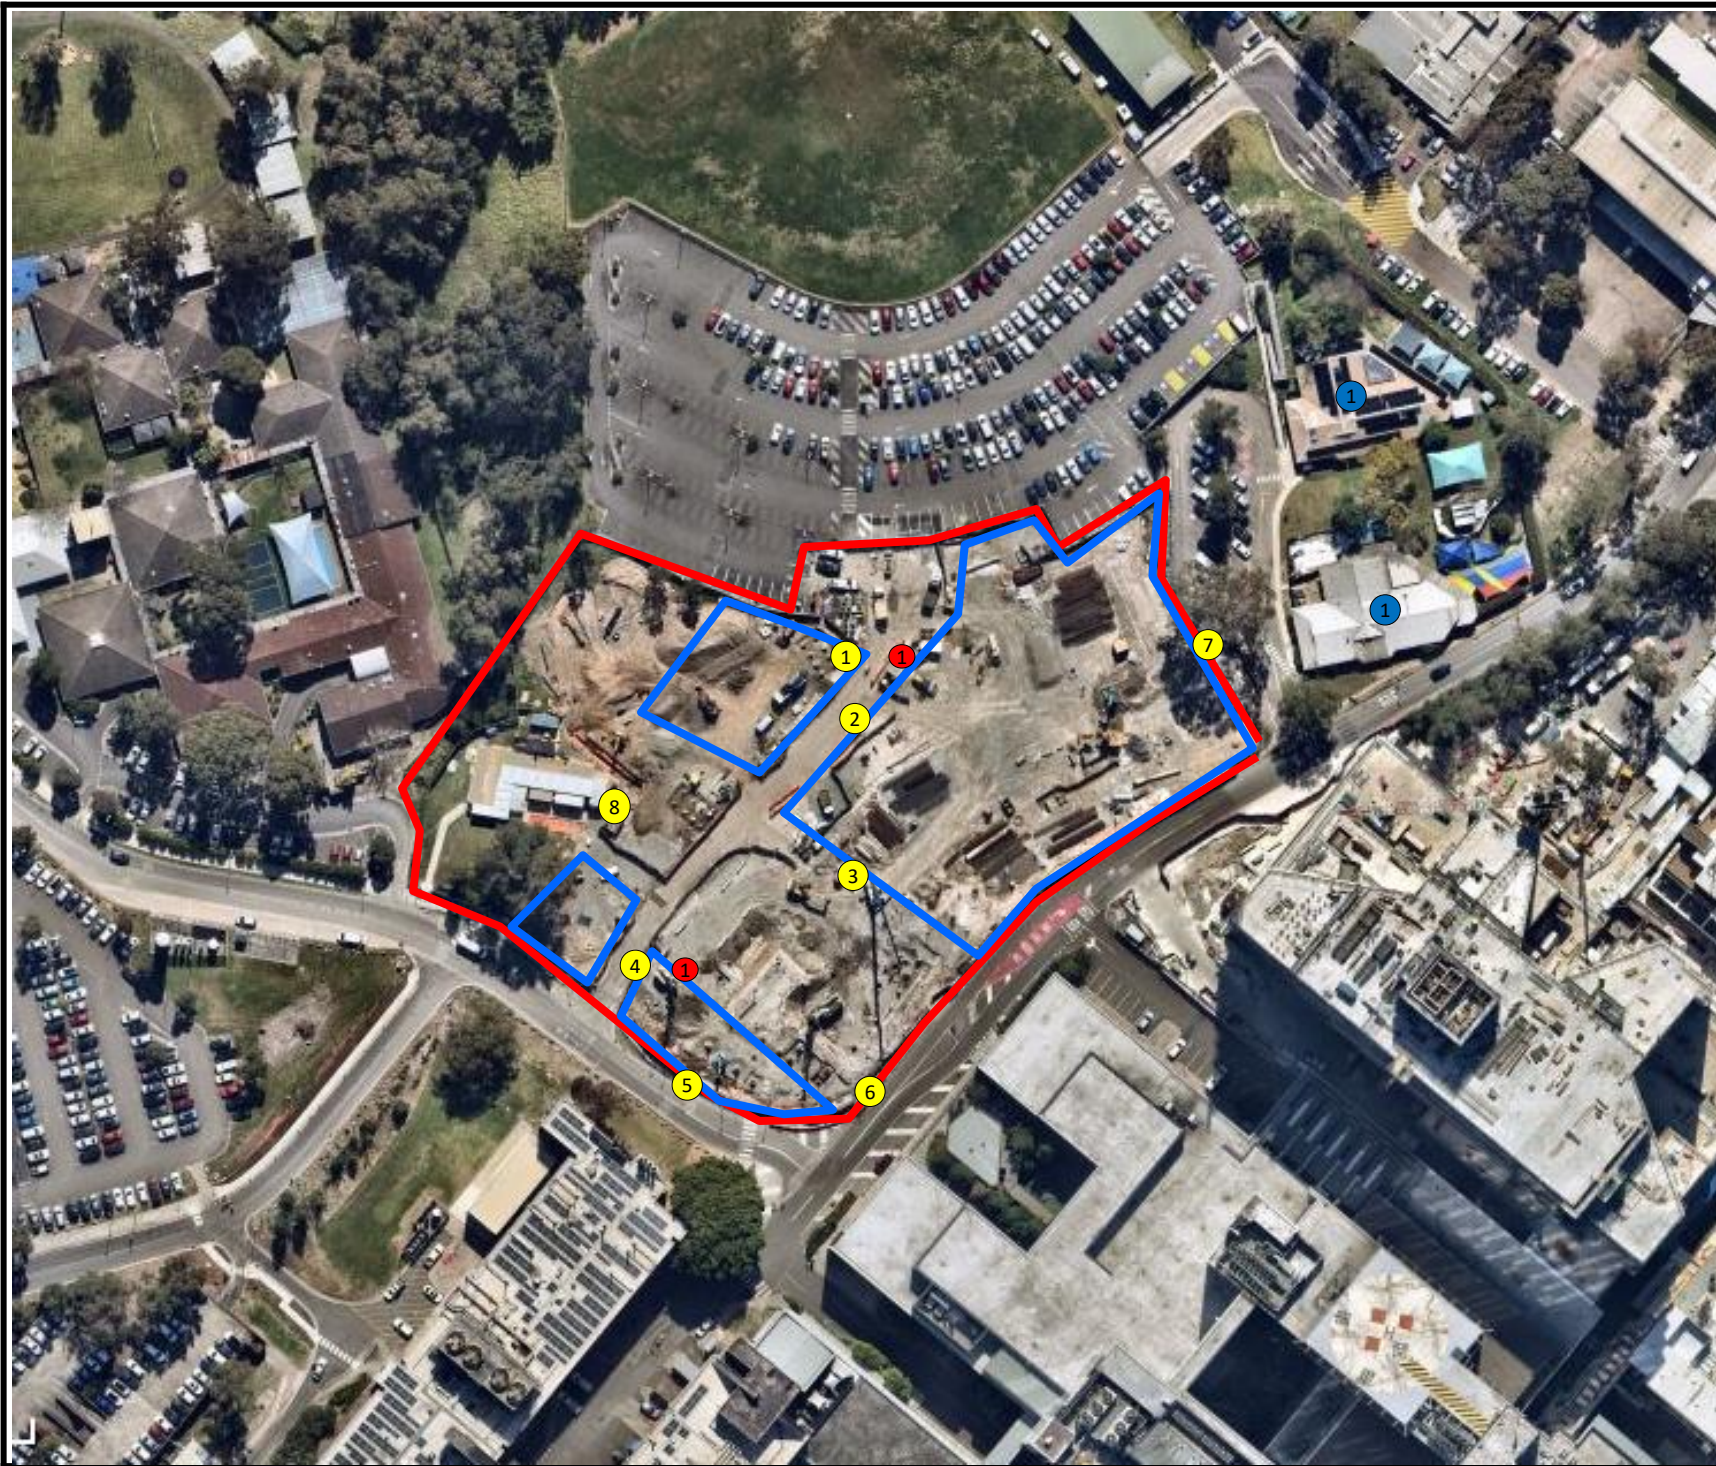

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- 1 Decontamination Unit
- 1 Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 01/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 162,697)

AMR283 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

3 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR283: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Wednesday 02 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1145029-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 02, 2024
Date Reported Oct 02, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 02, 2024
Report 1145029-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0004670	DJ300628	AC106	LOC1: LP7, NE ADJ TO LP6 + P14	7:07	15:03	2.0	2.0	0/100	< 0.01
24-Oc0004671	DJ300601	AC119	LOC2: BIRSB, WEST ADJ TO P14	7:09	15:05	2.0	2.0	0/100	< 0.01
24-Oc0004672	DJ300612	AC027	LOC3: BIRSB, CENTRE OPPOSITE MAINTAINING WALL	7:11	15:07	2.0	2.0	0/100	< 0.01
24-Oc0004673	DJ300673	AC248	LOC4: BIRSB, SW ADJ TO P14 + LP8	7:13	15:09	2.0	2.0	0/100	< 0.01
24-Oc0004674	DJ300627	AC172	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:15	15:11	2.0	2.0	0/100	< 0.01
24-Oc0004675	DJ300688	AC152	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:17	15:13	2.0	2.0	0/100	< 0.01
24-Oc0004676	DJ300680	AC142	LOC7: BIRSB, EAST ADJ TO CCC	7:20	15:16	2.0	2.0	0/100	< 0.01
24-Oc0004677	DJ300685	AC257	LOC8: LP7, SW ADJ TO SITE SHED	7:25	15:20	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0004678	DJ300626	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 02, 2024	Indefinite

web: www.eurofins.com.au
 email: EnviroSales@eurofins.com

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1145029
Phone: 02 8245 0300
Fax:

Received: Oct 2, 2024 3:50 PM
Due: Oct 2, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300628	Oct 02, 2024	3:03PM	Air	S24-Oc0004670	X
2	DJ300601	Oct 02, 2024	3:05PM	Air	S24-Oc0004671	X
3	DJ300612	Oct 02, 2024	3:07PM	Air	S24-Oc0004672	X
4	DJ300673	Oct 02, 2024	3:09PM	Air	S24-Oc0004673	X
5	DJ300627	Oct 02, 2024	3:11PM	Air	S24-Oc0004674	X
6	DJ300688	Oct 02, 2024	3:13PM	Air	S24-Oc0004675	X
7	DJ300680	Oct 02, 2024	3:16PM	Air	S24-Oc0004676	X
8	DJ300685	Oct 02, 2024	3:20PM	Air	S24-Oc0004677	X
9	DJ300626	Oct 02, 2024		Air	S24-Oc0004678	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Geronimo Jr Abrot Senior Analyst-Asbestos

Authorised by:

Sayed Abu Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

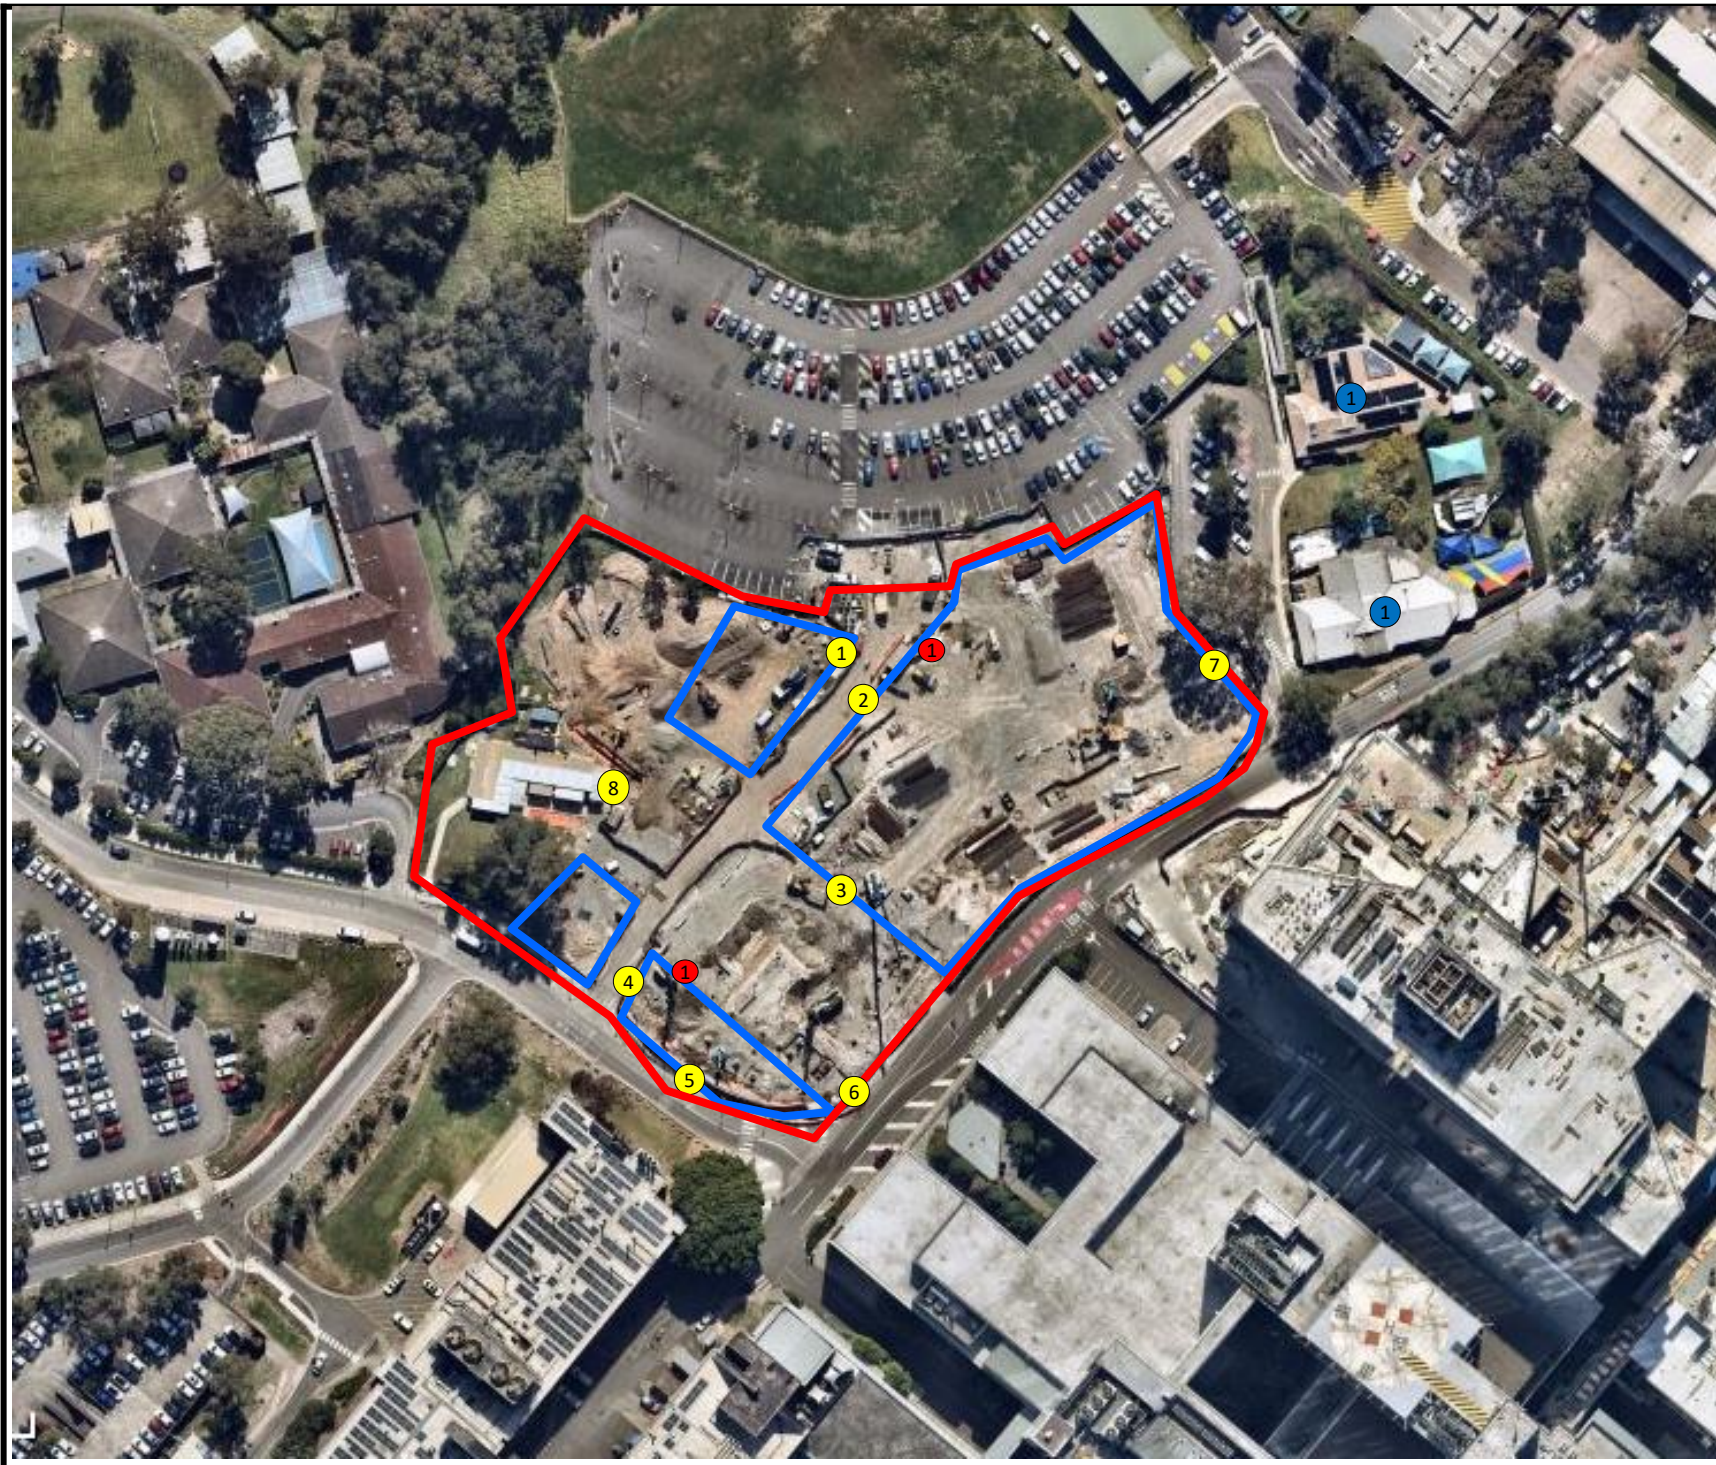

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 02/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 162,942)

AMR284 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

4 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR284: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Thursday 03 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1145538-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 03, 2024
Date Reported Oct 03, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 03, 2024
Report 1145538-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0008234	DJ300603	AC027	LOC1: LP7, NE ADJ TO LP6 + P14	11:31	16:14	2.0	2.0	0/100	< 0.01
24-Oc0008235	DJ300620	AC119	LOC2: BIRSB, WEST ADJ TO P14	11:34	16:17	2.0	2.0	0/100	< 0.01
24-Oc0008236	DJ300613	AC172	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	11:37	16:20	2.0	2.0	0/100	< 0.01
24-Oc0008237	DJ300638	AC257	LOC4: BIRSB, SW ADJ TO P14 + LP8	11:40	16:22	2.0	2.0	0/100	< 0.01
24-Oc0008238	DJ300605	AC042	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	11:42	16:24	2.0	2.0	0/100	< 0.01
24-Oc0008239	DJ300633	AC142	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	11:44	16:27	2.0	2.0	0/100	< 0.01
24-Oc0008240	DJ300615	AC106	LOC7: BIRSB, EAST ADJ TO CCC	11:46	16:29	2.0	2.0	0/100	< 0.01
24-Oc0008241	DJ300617	AC152	LOC8: LP7, SW ADJ TO SITE SHED	11:50	16:33	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0008242	DJ300629	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 03, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L	Order No.:	Received: Oct 3, 2024 5:10 PM
Address: Level 1, 50 Margaret St Sydney NSW 2000	Report #: 1145538	Due: Oct 3, 2024
	Phone: 02 8245 0300	Priority: Same day
	Fax:	Contact Name: Milad Noujaim
Project Name: IMHC WESTMEAD	Eurofins Analytical Services Manager : Andrew Black	
Project ID: 65686		

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300603	Oct 03, 2024		Air	S24-Oc0008234	X
2	DJ300620	Oct 03, 2024		Air	S24-Oc0008235	X
3	DJ300613	Oct 03, 2024		Air	S24-Oc0008236	X
4	DJ300638	Oct 03, 2024		Air	S24-Oc0008237	X
5	DJ300605	Oct 03, 2024		Air	S24-Oc0008238	X
6	DJ300633	Oct 03, 2024		Air	S24-Oc0008239	X
7	DJ300615	Oct 03, 2024		Air	S24-Oc0008240	X
8	DJ300617	Oct 03, 2024		Air	S24-Oc0008241	X
9	DJ300629	Oct 03, 2024		Air	S24-Oc0008242	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : Milad Noujaim, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	N/A
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Geronimo Jr Abrot Senior Analyst-Asbestos

Authorised by:

Sayed Abu Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

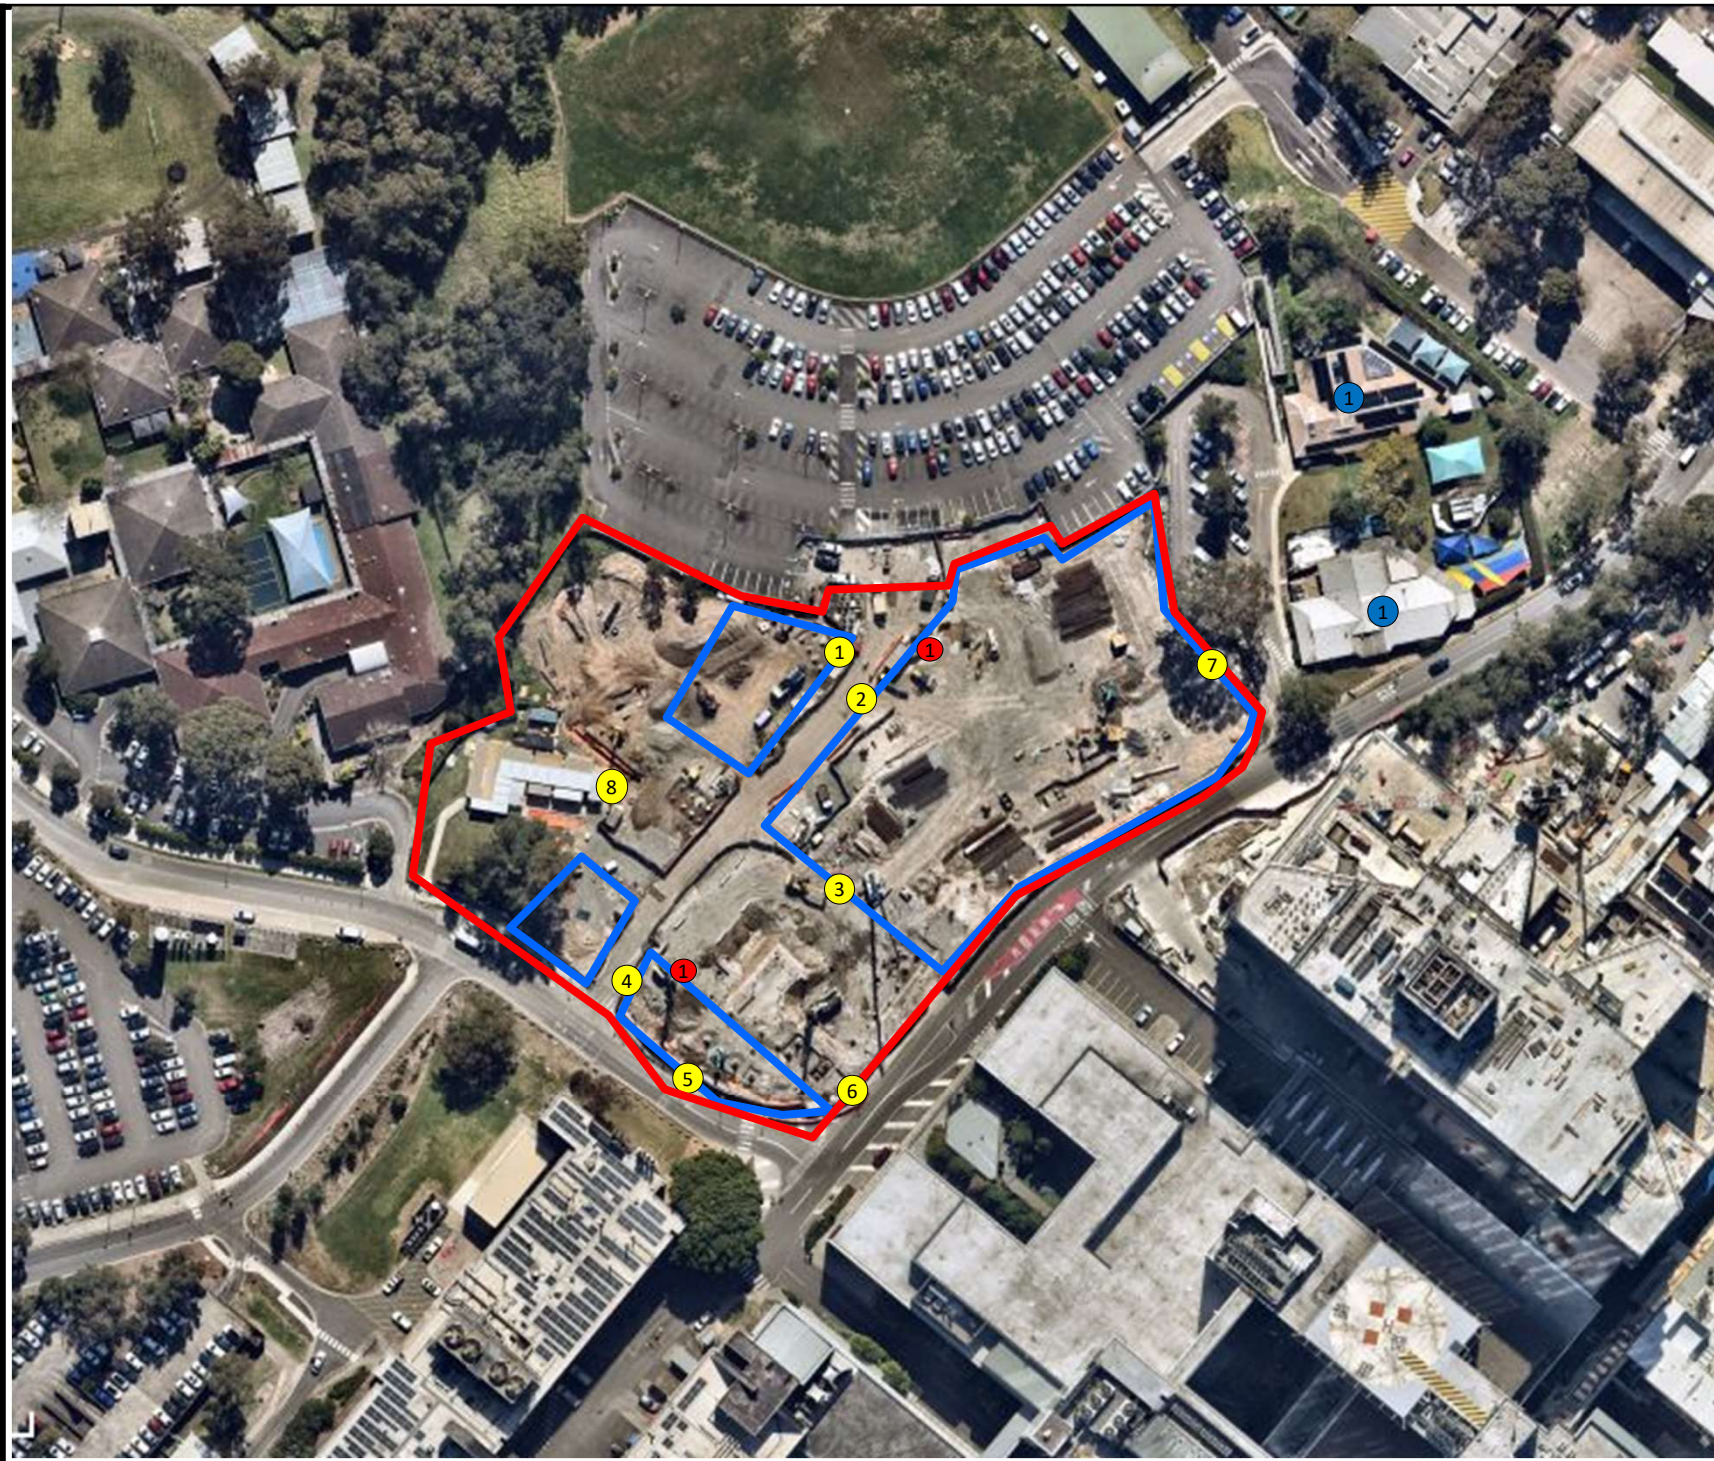

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 03/10/2024

Drawn By: MN

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 162,943)

AMR285 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

9 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR285: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Friday 04 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1145990-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 04, 2024
Date Reported Oct 04, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 04, 2024
Report 1145990-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0012111	DJ300637	AC106	LOC1: LP7, NE ADJ TO LP6 + P14	7:02	13:01	2.0	2.0	0/100	< 0.01
24-Oc0012112	DJ300621	AC042	LOC2: BIRSB, WEST ADJ TO P14	7:04	13:03	2.0	2.0	0/100	< 0.01
24-Oc0012113	DJ300641	AC027	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:06	13:05	2.0	2.0	0/100	< 0.01
24-Oc0012114	DJ300642	AC119	LOC4: BIRSB, SW ADJ TO P14 + LP9	7:08	13:07	2.0	2.0	0/100	< 0.01
24-Oc0012115	DJ300614	AC142	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DRIVE	7:10	13:09	2.0	2.0	0/100	< 0.01
24-Oc0012116	DJ300623	AC152	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:12	13:12	2.0	2.0	0/100	< 0.01
24-Oc0012117	DJ300631	AC172	LOC7: BIRSB, EAST ADJ TO CCC	7:15	13:15	2.0	2.0	0/100	< 0.01
24-Oc0012118	DJ300632	AC257	LOC8: LP7, SW ADJ TO SITE SHED	7:18	13:18	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0012119	DJ300647	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 04, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	--	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1145990
Phone: 02 8245 0300
Fax:

Received: Oct 4, 2024 3:31 PM
Due: Oct 4, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300637	Oct 04, 2024	7:02AM	Air	S24-Oc0012111	X
2	DJ300621	Oct 04, 2024	7:04AM	Air	S24-Oc0012112	X
3	DJ300641	Oct 04, 2024	7:06AM	Air	S24-Oc0012113	X
4	DJ300642	Oct 04, 2024	7:08AM	Air	S24-Oc0012114	X
5	DJ300614	Oct 04, 2024	7:10AM	Air	S24-Oc0012115	X
6	DJ300623	Oct 04, 2024	7:12AM	Air	S24-Oc0012116	X
7	DJ300631	Oct 04, 2024	7:15AM	Air	S24-Oc0012117	X
8	DJ300632	Oct 04, 2024	7:18AM	Air	S24-Oc0012118	X
9	DJ300647	Oct 04, 2024		Air	S24-Oc0012119	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos

Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 *Appendix 2*, else assumed to be 15% in accordance with WA DOH *Appendix 2 (PA)*. This estimate is not NATA-accredited.

ACM

Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.

AF

Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".

AFM

Airborne Fibre Monitoring, e.g., by the MFM.

Amosite

Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.

AS

Australian Standard.

Asbestos Content (as asbestos) Total %w/w asbestos content in asbestos-containing finds in a soil sample (**% w/w**).

Chrysotile

Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

COC

Chain of Custody.

Crocidolite

Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Dry

Sample is dried by heating prior to analysis.

DS

Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.

FA

Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.

Fibre Count

Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003

Fibre ID

Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.

Friable

Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.

HSG248

UK HSE HSG248, *Asbestos: The Analysts Guide*, 2nd Edition (2021), ISBN: 9780616667079.

HSG264

UK HSE HSG264, *Asbestos: The Survey Guide* (2012), ISBN: 9780717665020

ISO (also ISO/IEC)

International Organization for Standardization / International Electrotechnical Commission.

K Factor

Microscope constant (**K**) as derived from the effective filter area of the given AFM membrane used for collecting the sample (**A**) and the projected eyepiece graticule area of the specific microscope used for the analysis (**a**).

LOR

Limit of Reporting.

MFM (also NOHSC:3003)

Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres*, 2nd Edition [NOHSC:3003(2005)].

MMVF

Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).

NEPM (also ASC NEPM)

National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).

Organic

Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

PCM

Phase Contrast Microscopy. This is used for fibre counting according to the MFM.

PLM

Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Sampling

Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.

SRA

Sample Receipt Advice.

Trace Analysis

An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.

UK HSE HSG

United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.

UMF

Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.

WA DOH

Reference document for the NEPM. Government of Western Australia, *Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia* (updated 2021), including Appendix Four: *Laboratory analysis*

Weighted Average

Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (**%_{WA}**).

Comments

Volume Measurement : MILAD NOUJAIM, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Geronimo Jr Abrot Senior Analyst-Asbestos

Authorised by:

Sayed Abu Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

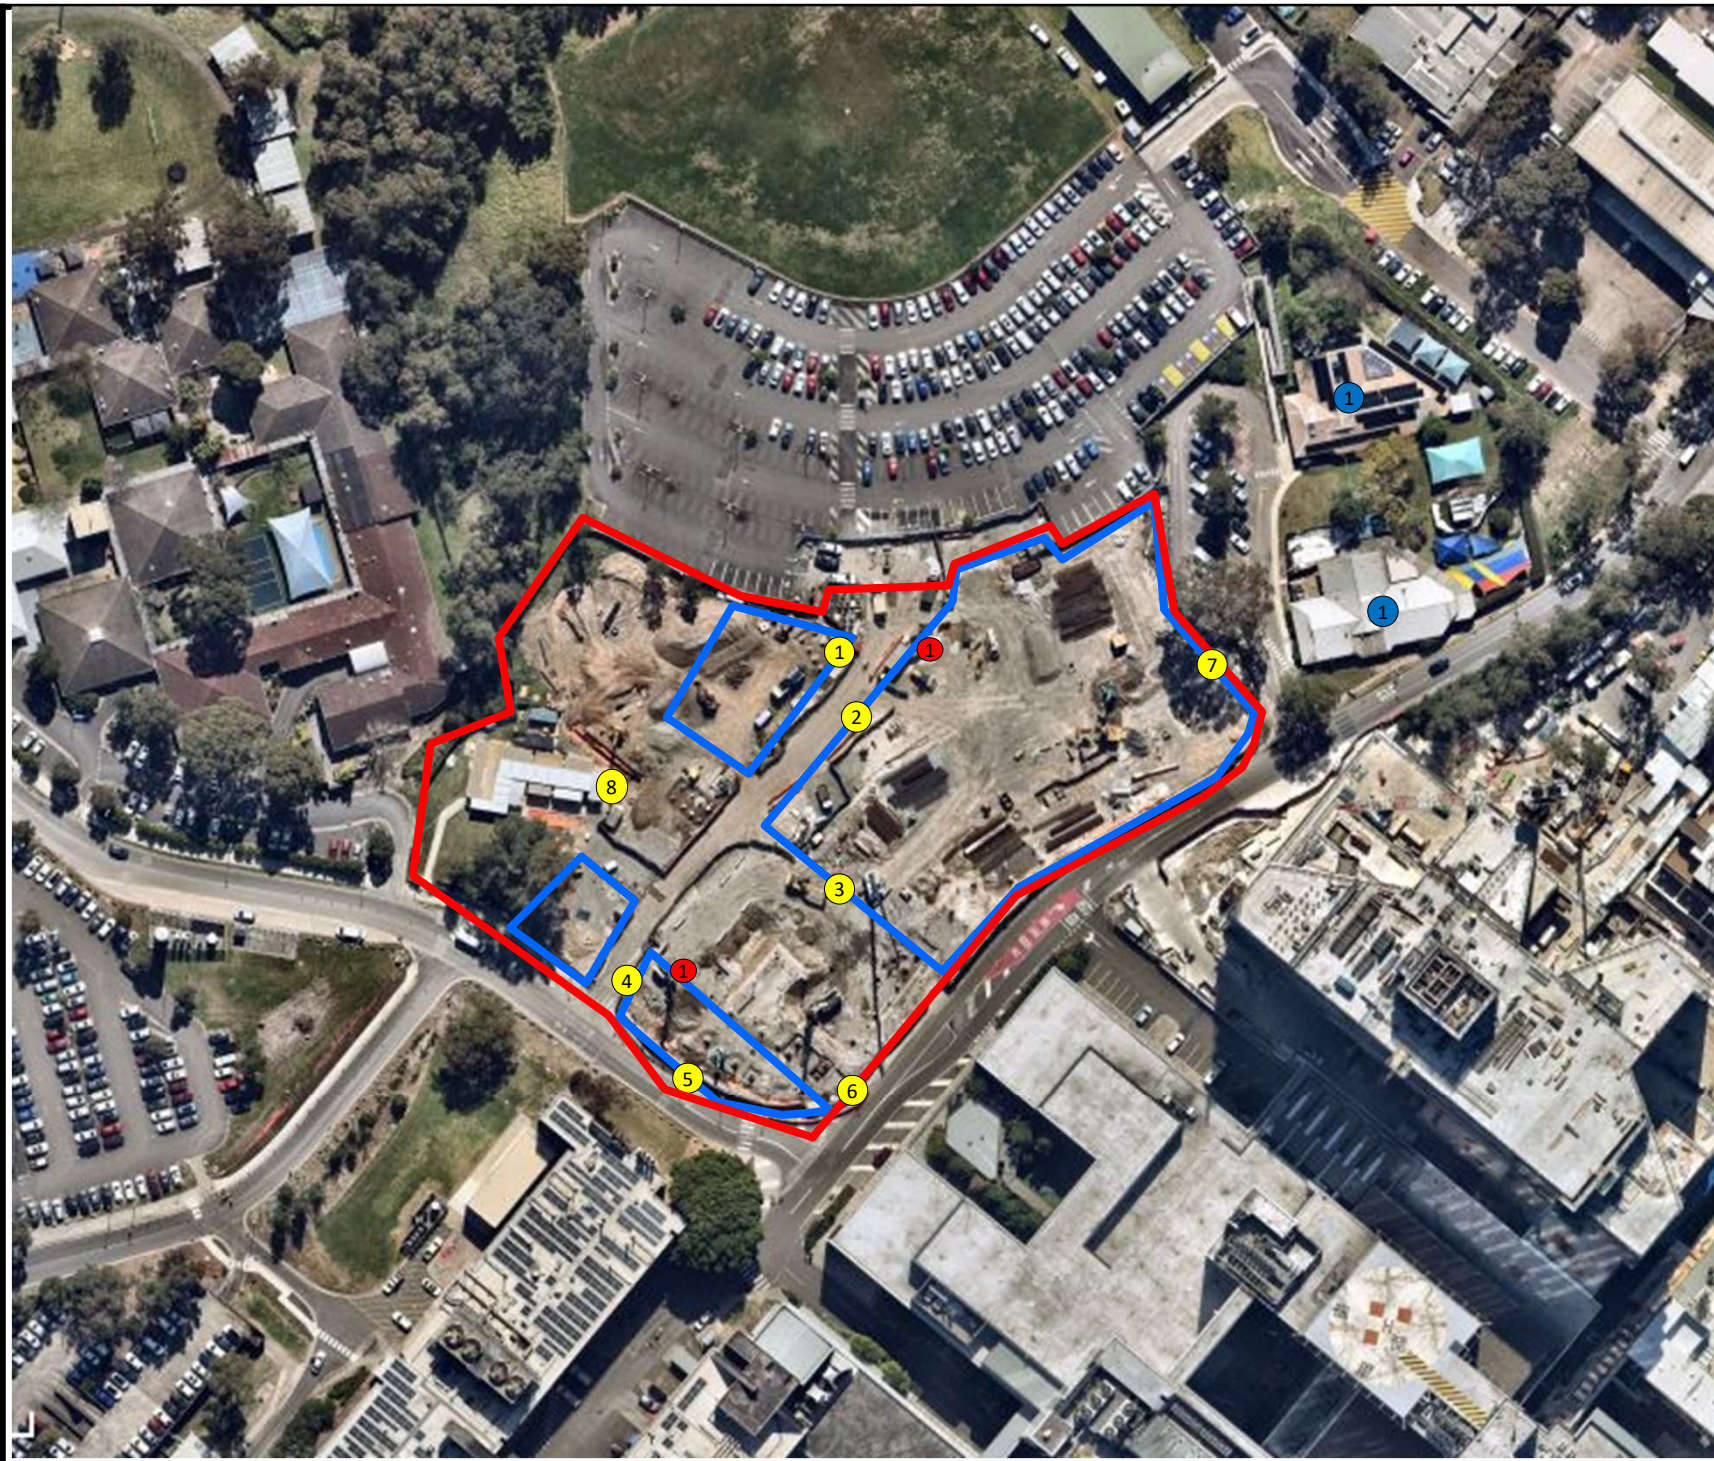

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 04/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 162,944)

AMR286 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

10 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR286: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Wednesday 09 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1147102-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 09, 2024
Date Reported Oct 09, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 09, 2024
Report 1147102-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0020516	DJ300618	AC257	LOC 1: LP7, NE ADJ TO LP6 + P14	7:09	15:08	2.0	2.0	0/100	< 0.01
24-Oc0020517	DJ300622	AC027	LOC 2: BIRSB, WEST ADJ TO P14	7:11	15:10	2.0	2.0	0/100	< 0.01
24-Oc0020518	DJ300625	AC106	LOC 3 : BIRSB, CENTRE OPPOSITE RETAINING WALL	7:14	15:12	2.0	2.0	0/100	< 0.01
24-Oc0020519	DJ300644	AC152	LOC 4 : BIRSB, SW ADJ TO P14 + LP8	7:18	15:14	2.0	2.0	0/100	< 0.01
24-Oc0020520	DJ300609	AC119	LOC 5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:20	15:16	2.0	2.0	0/100	< 0.01
24-Oc0020521	DJ300634	AC035	LOC 6: BIRSB, SOUTH ADJ TO REDBANK RD	7:22	15:18	2.0	2.0	0/100	< 0.01
24-Oc0020522	DJ300646	AC142	LOC 7: BIRSB, EAST ADJ TO CCC	7:25	15:21	2.0	2.0	0/100	< 0.01
24-Oc0020523	DJ300639	AC248	LOC 8: SW ADJ TO SITE SHED	7:29	15:25	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0020524	DJ300645	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 09, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1147102
Phone: 02 8245 0300
Fax:

Received: Oct 9, 2024 4:30 PM
Due: Oct 9, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300618	Oct 09, 2024	3:08PM	Air	S24-Oc0020516	X
2	DJ300622	Oct 09, 2024	3:10PM	Air	S24-Oc0020517	X
3	DJ300625	Oct 09, 2024	3:12PM	Air	S24-Oc0020518	X
4	DJ300644	Oct 09, 2024	3:14PM	Air	S24-Oc0020519	X
5	DJ300609	Oct 09, 2024	3:16PM	Air	S24-Oc0020520	X
6	DJ300634	Oct 09, 2024	3:18PM	Air	S24-Oc0020521	X
7	DJ300646	Oct 09, 2024	3:21PM	Air	S24-Oc0020522	X
8	DJ300639	Oct 09, 2024	3:25PM	Air	S24-Oc0020523	X
9	DJ300645	Oct 09, 2024		Air	S24-Oc0020524	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Geronimo Jr Abrot Senior Analyst-Asbestos

Authorised by:

Sayed Abu Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

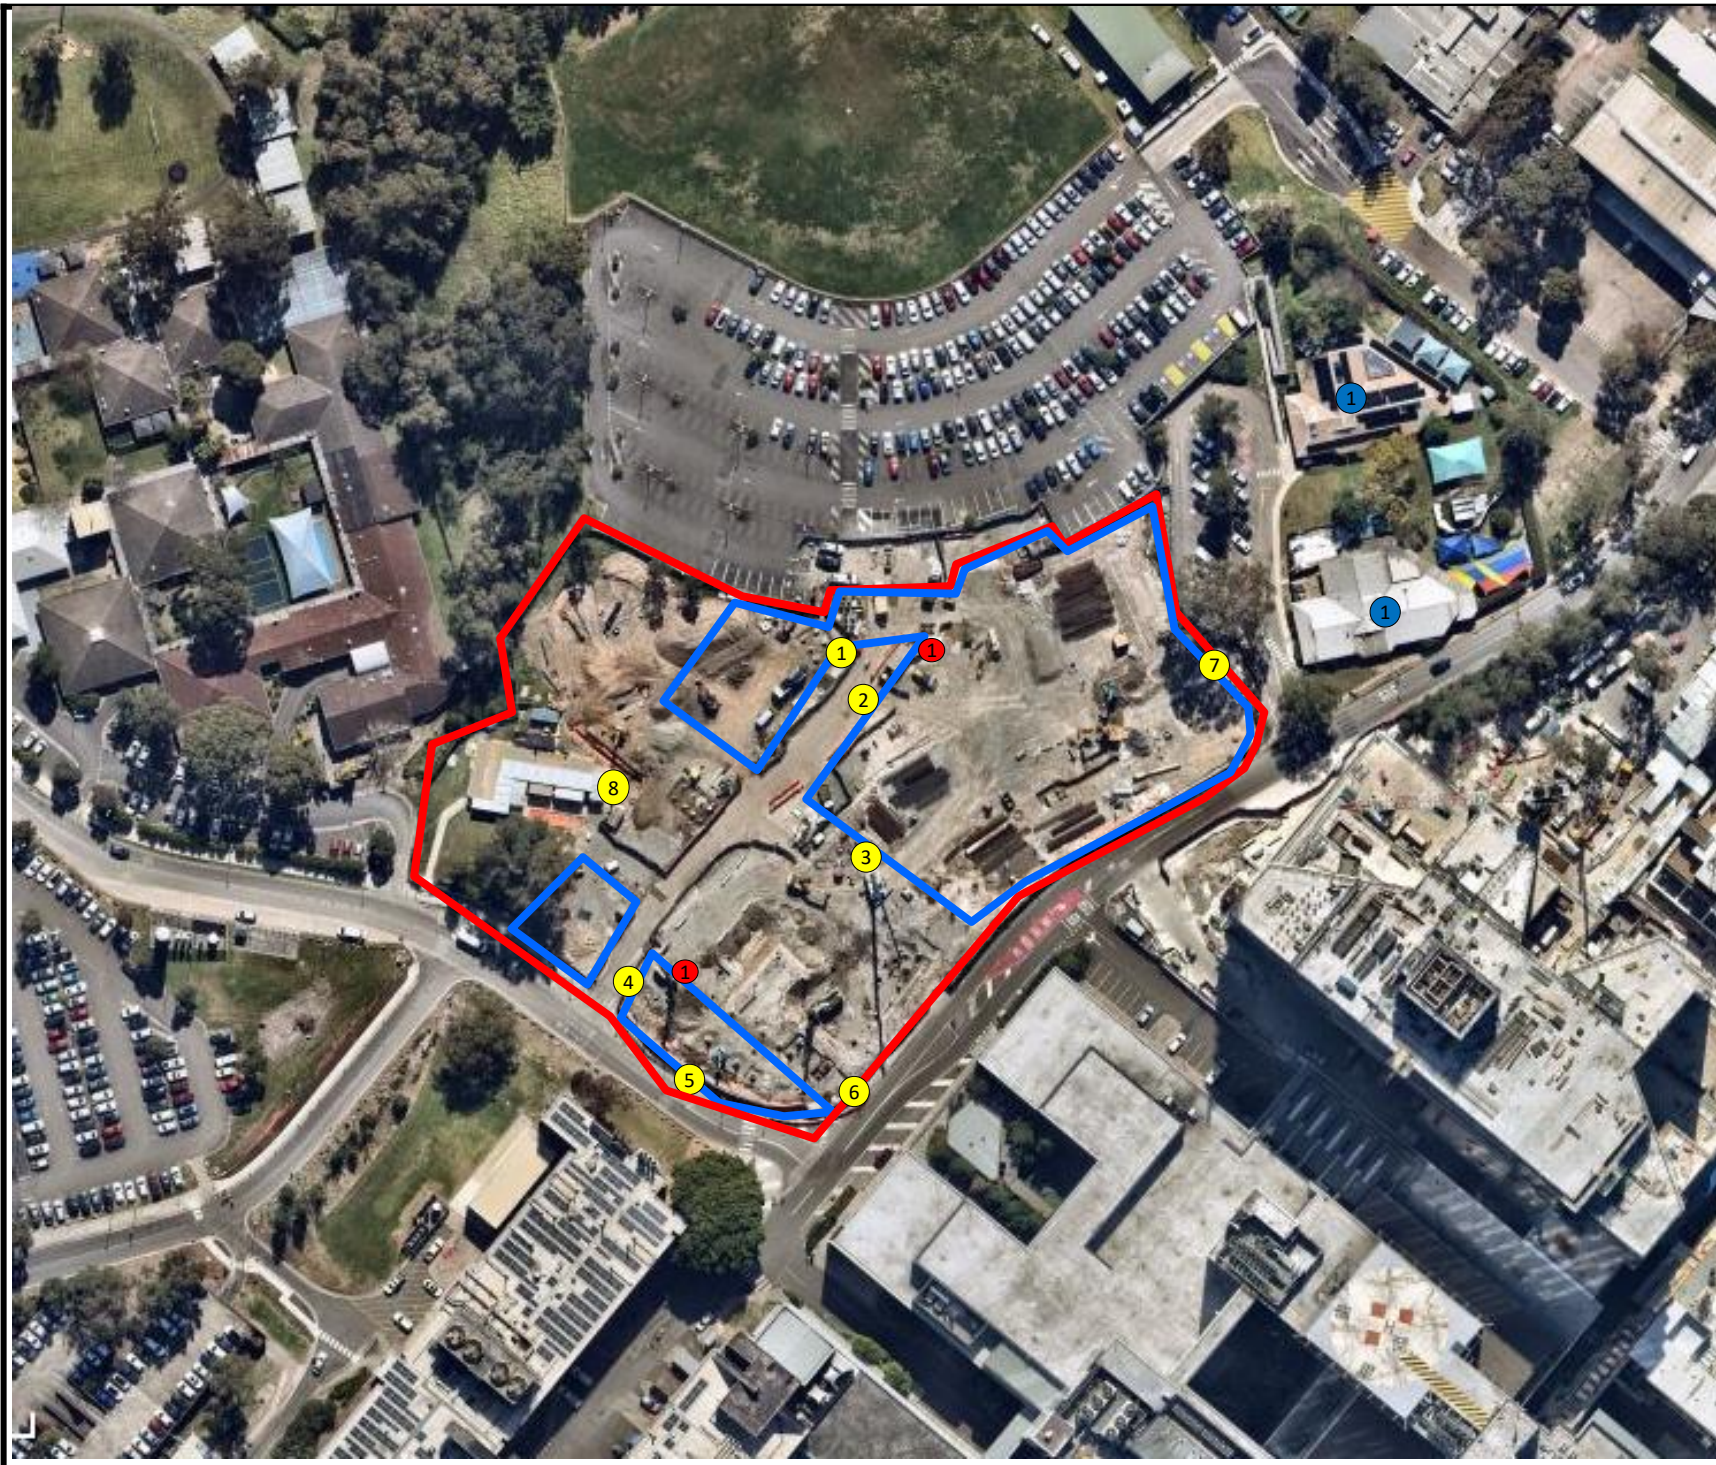

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 09/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 162,945)

AMR287 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

11 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR287: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Thursday 10 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1147626-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 10, 2024
Date Reported Oct 10, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 10, 2024
Report 1147626-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0024352	DJ300610	AC142	LOC1: LP7, NE ADJ TO LP6 + P14	7:14	15:13	2.0	2.0	0/100	< 0.01
24-Oc0024353	DJ300611	AC119	LOC2: BIRSB, WEST ADJ TO P14	7:16	15:15	2.0	2.0	0/100	< 0.01
24-Oc0024354	DJ300648	AC152	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:18	15:17	2.0	2.0	0/100	< 0.01
24-Oc0024355	DJ300607	AC035	LOC4: BIRSB, SW ADJ TO P14 + LP9	7:20	15:19	2.0	2.0	0/100	< 0.01
24-Oc0024356	DJ300624	AC248	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:22	15:21	2.0	2.0	0/100	< 0.01
24-Oc0024357	DJ300640	AC257	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:24	15:23	2.0	2.0	0/100	< 0.01
24-Oc0024358	DJ300616	AC106	LOC7: BIRSB, EAST ADJ TO CCC	7:27	15:26	2.0	2.0	0/100	< 0.01
24-Oc0024359	DJ300635	AC027	LOC8: LP7, SW ADJ TO SITE SHED	7:31	15:31	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0024360	DJ300606	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 10, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	--	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1147626
Phone: 02 8245 0300
Fax:

Received: Oct 10, 2024 4:03 PM
Due: Oct 10, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300610	Oct 10, 2024	7:14AM	Air	S24-Oc0024352	X
2	DJ300611	Oct 10, 2024	7:16AM	Air	S24-Oc0024353	X
3	DJ300648	Oct 10, 2024	7:18AM	Air	S24-Oc0024354	X
4	DJ300607	Oct 10, 2024	7:20AM	Air	S24-Oc0024355	X
5	DJ300624	Oct 10, 2024	7:22AM	Air	S24-Oc0024356	X
6	DJ300640	Oct 10, 2024	7:24AM	Air	S24-Oc0024357	X
7	DJ300616	Oct 10, 2024	7:27AM	Air	S24-Oc0024358	X
8	DJ300635	Oct 10, 2024	7:31AM	Air	S24-Oc0024359	X
9	DJ300606	Oct 10, 2024		Air	S24-Oc0024360	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos

Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 *Appendix 2*, else assumed to be 15% in accordance with WA DOH *Appendix 2 (PA)*. This estimate is not NATA-accredited.

ACM

Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.

AF

Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".

AFM

Airborne Fibre Monitoring, e.g., by the MFM.

Amosite

Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.

AS

Australian Standard.

Asbestos Content (as asbestos) Total %w/w asbestos content in asbestos-containing finds in a soil sample (**% w/w**).

Chrysotile

Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

COC

Chain of Custody.

Crocidolite

Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Dry

Sample is dried by heating prior to analysis.

DS

Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.

FA

Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.

Fibre Count

Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003

Fibre ID

Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.

Friable

Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.

HSG248

UK HSE HSG248, *Asbestos: The Analysts Guide*, 2nd Edition (2021), ISBN: 9780616667079.

HSG264

UK HSE HSG264, *Asbestos: The Survey Guide* (2012), ISBN: 9780717665020

ISO (also ISO/IEC)

International Organization for Standardization / International Electrotechnical Commission.

K Factor

Microscope constant (**K**) as derived from the effective filter area of the given AFM membrane used for collecting the sample (**A**) and the projected eyepiece graticule area of the specific microscope used for the analysis (**a**).

LOR

Limit of Reporting.

MFM (also NOHSC:3003)

Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres*, 2nd Edition [NOHSC:3003(2005)].

MMVF

Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).

NEPM (also ASC NEPM)

National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).

Organic

Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

PCM

Phase Contrast Microscopy. This is used for fibre counting according to the MFM.

PLM

Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Sampling

Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.

SRA

Sample Receipt Advice.

Trace Analysis

An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.

UK HSE HSG

United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.

UMF

Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.

WA DOH

Reference document for the NEPM. Government of Western Australia, *Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia* (updated 2021), including Appendix Four: *Laboratory analysis*

Weighted Average

Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (**%_{WA}**).

Comments

Volume Measurement : DAIVD EDWARDS-DAVIS, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Geronimo Jr Abrot Senior Analyst-Asbestos

Authorised by:

Sayeed Abu Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

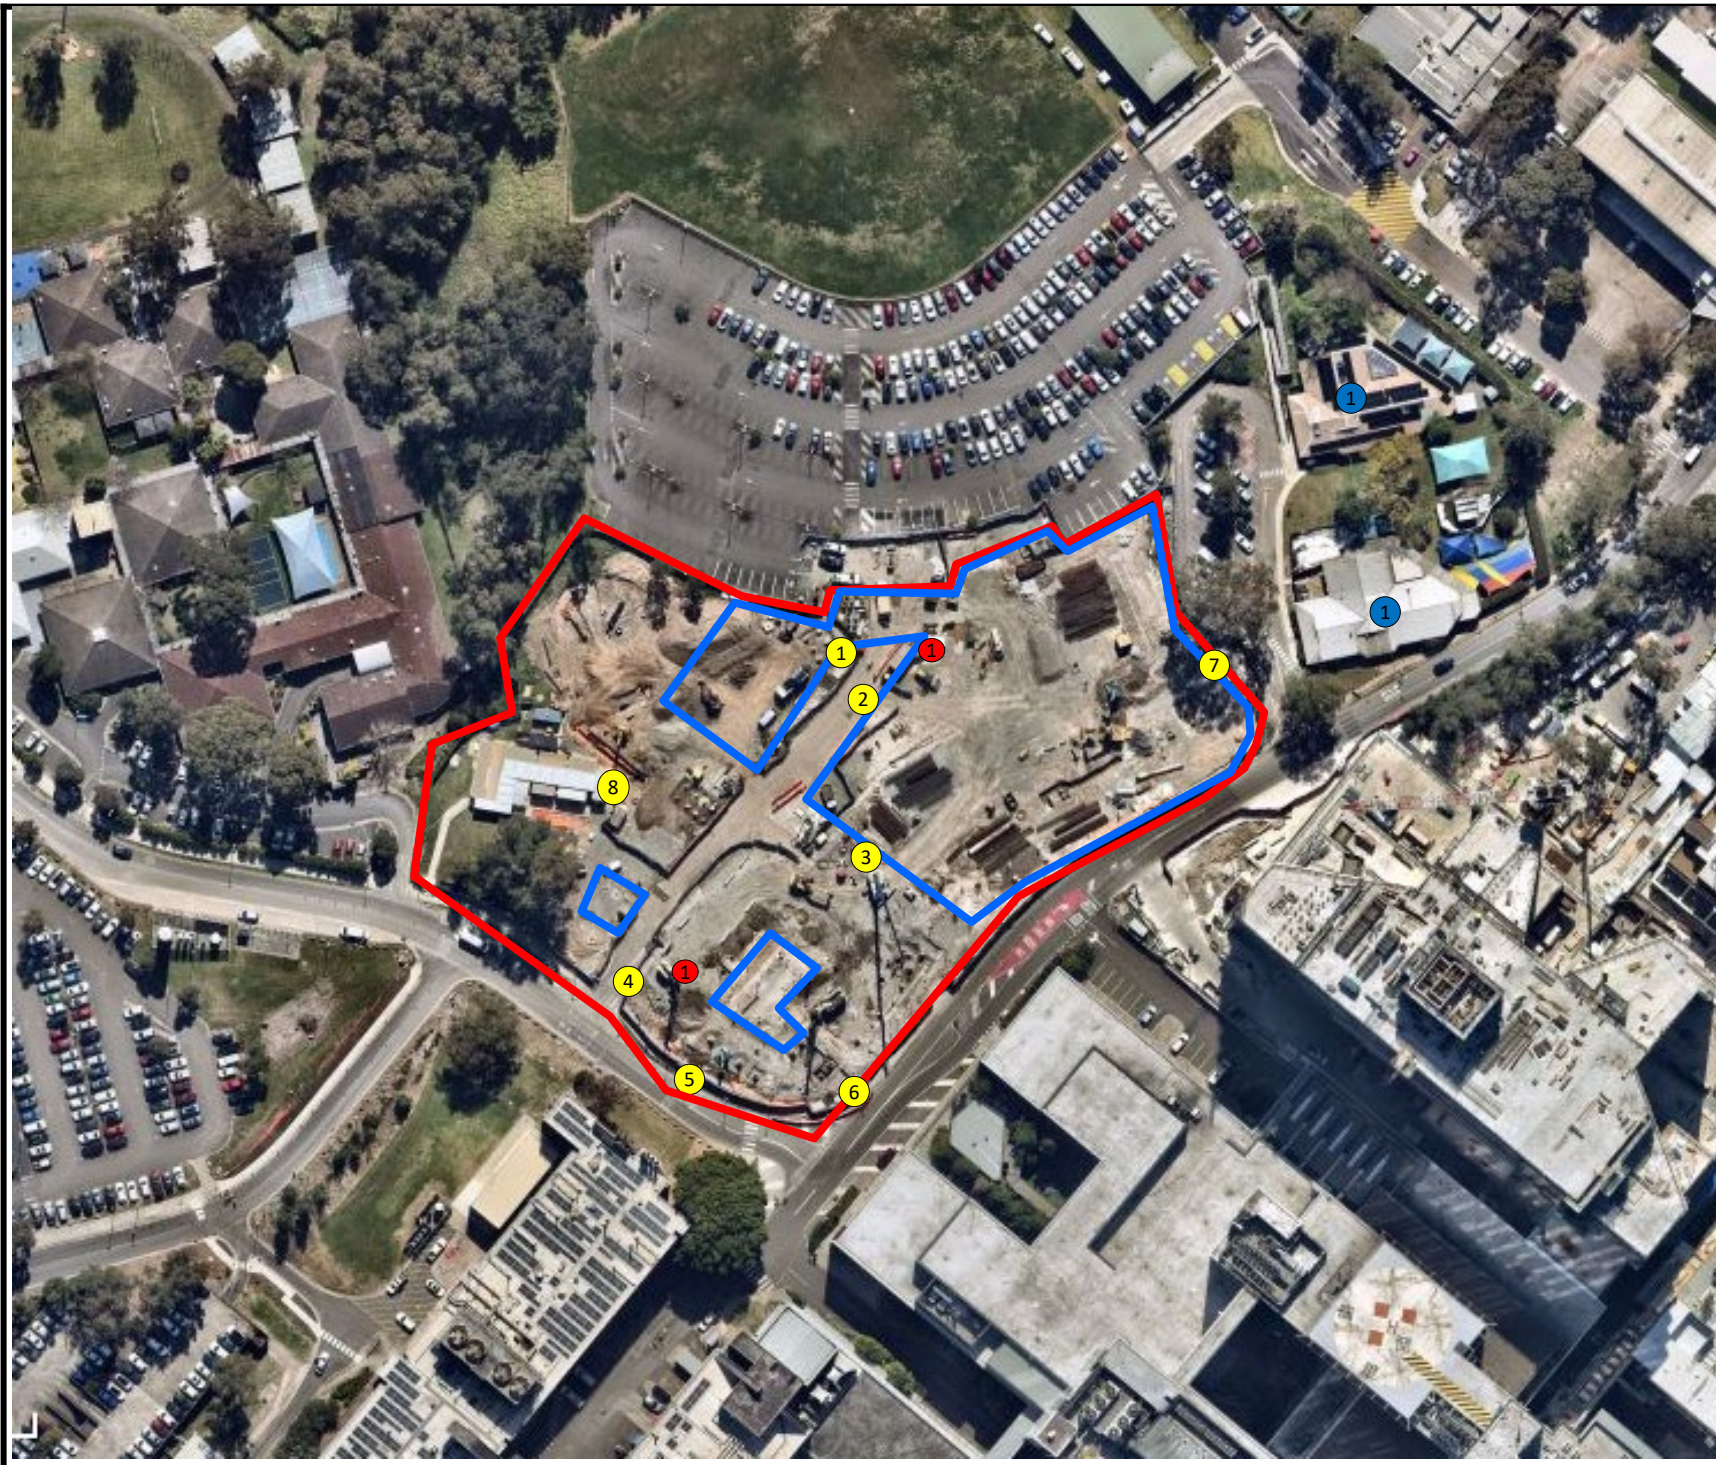

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- 1 Decontamination Unit
- 1 Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 10/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 162,946)

AMR288 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

14 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR288: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Friday 11 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1148208-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 11, 2024
Date Reported Oct 11, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition, [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 11, 2024
Report 1148208-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0028510	DJ300816	AC027	LOC1: LP7, NE ADJ TO LP6 & P14	7:01	14:57	2.0	2.0	0/100	< 0.01
24-Oc0028511	DJ300719	AC119	LOC2: BIRSB, WEST ADJ TO P14	7:03	14:59	2.0	2.0	0/100	< 0.01
24-Oc0028512	DJ300702	AC035	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:05	15:02	2.0	2.0	0/100	< 0.01
24-Oc0028513	DJ300725	AC106	LOC4: BIRSB, SW ADJ TO P14 & LP9	7:07	15:04	2.0	2.0	0/100	< 0.01
24-Oc0028514	DJ300710	AC248	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DRIVE	7:09	15:06	2.0	2.0	0/100	< 0.01
24-Oc0028515	DJ300709	AC152	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:12	15:08	2.0	2.0	0/100	< 0.01
24-Oc0028516	DJ300713	AC257	LOC7: BIRSB, EAST ADJ TO CCC	7:14	15:11	2.0	2.0	0/100	< 0.01
24-Oc0028517	DJ300738	AC142	LOC8: LP7, SW ADJ TO SITE SHED	7:17	15:15	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0028518	DJ300698	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 11, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1148208
Phone: 02 8245 0300
Fax:

Received: Oct 11, 2024 4:05 PM
Due: Oct 11, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300816	Oct 11, 2024	2:57PM	Air	S24-Oc0028510	X
2	DJ300719	Oct 11, 2024	2:59PM	Air	S24-Oc0028511	X
3	DJ300702	Oct 11, 2024	3:02PM	Air	S24-Oc0028512	X
4	DJ300725	Oct 11, 2024	3:04PM	Air	S24-Oc0028513	X
5	DJ300710	Oct 11, 2024	3:06PM	Air	S24-Oc0028514	X
6	DJ300709	Oct 11, 2024	3:08PM	Air	S24-Oc0028515	X
7	DJ300713	Oct 11, 2024	3:11PM	Air	S24-Oc0028516	X
8	DJ300738	Oct 11, 2024	3:15PM	Air	S24-Oc0028517	X
9	DJ300698	Oct 11, 2024		Air	S24-Oc0028518	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : Milad Noujaim, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Geronimo Jr Abrot Senior Analyst-Asbestos

Authorised by:

Sayed Abu Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

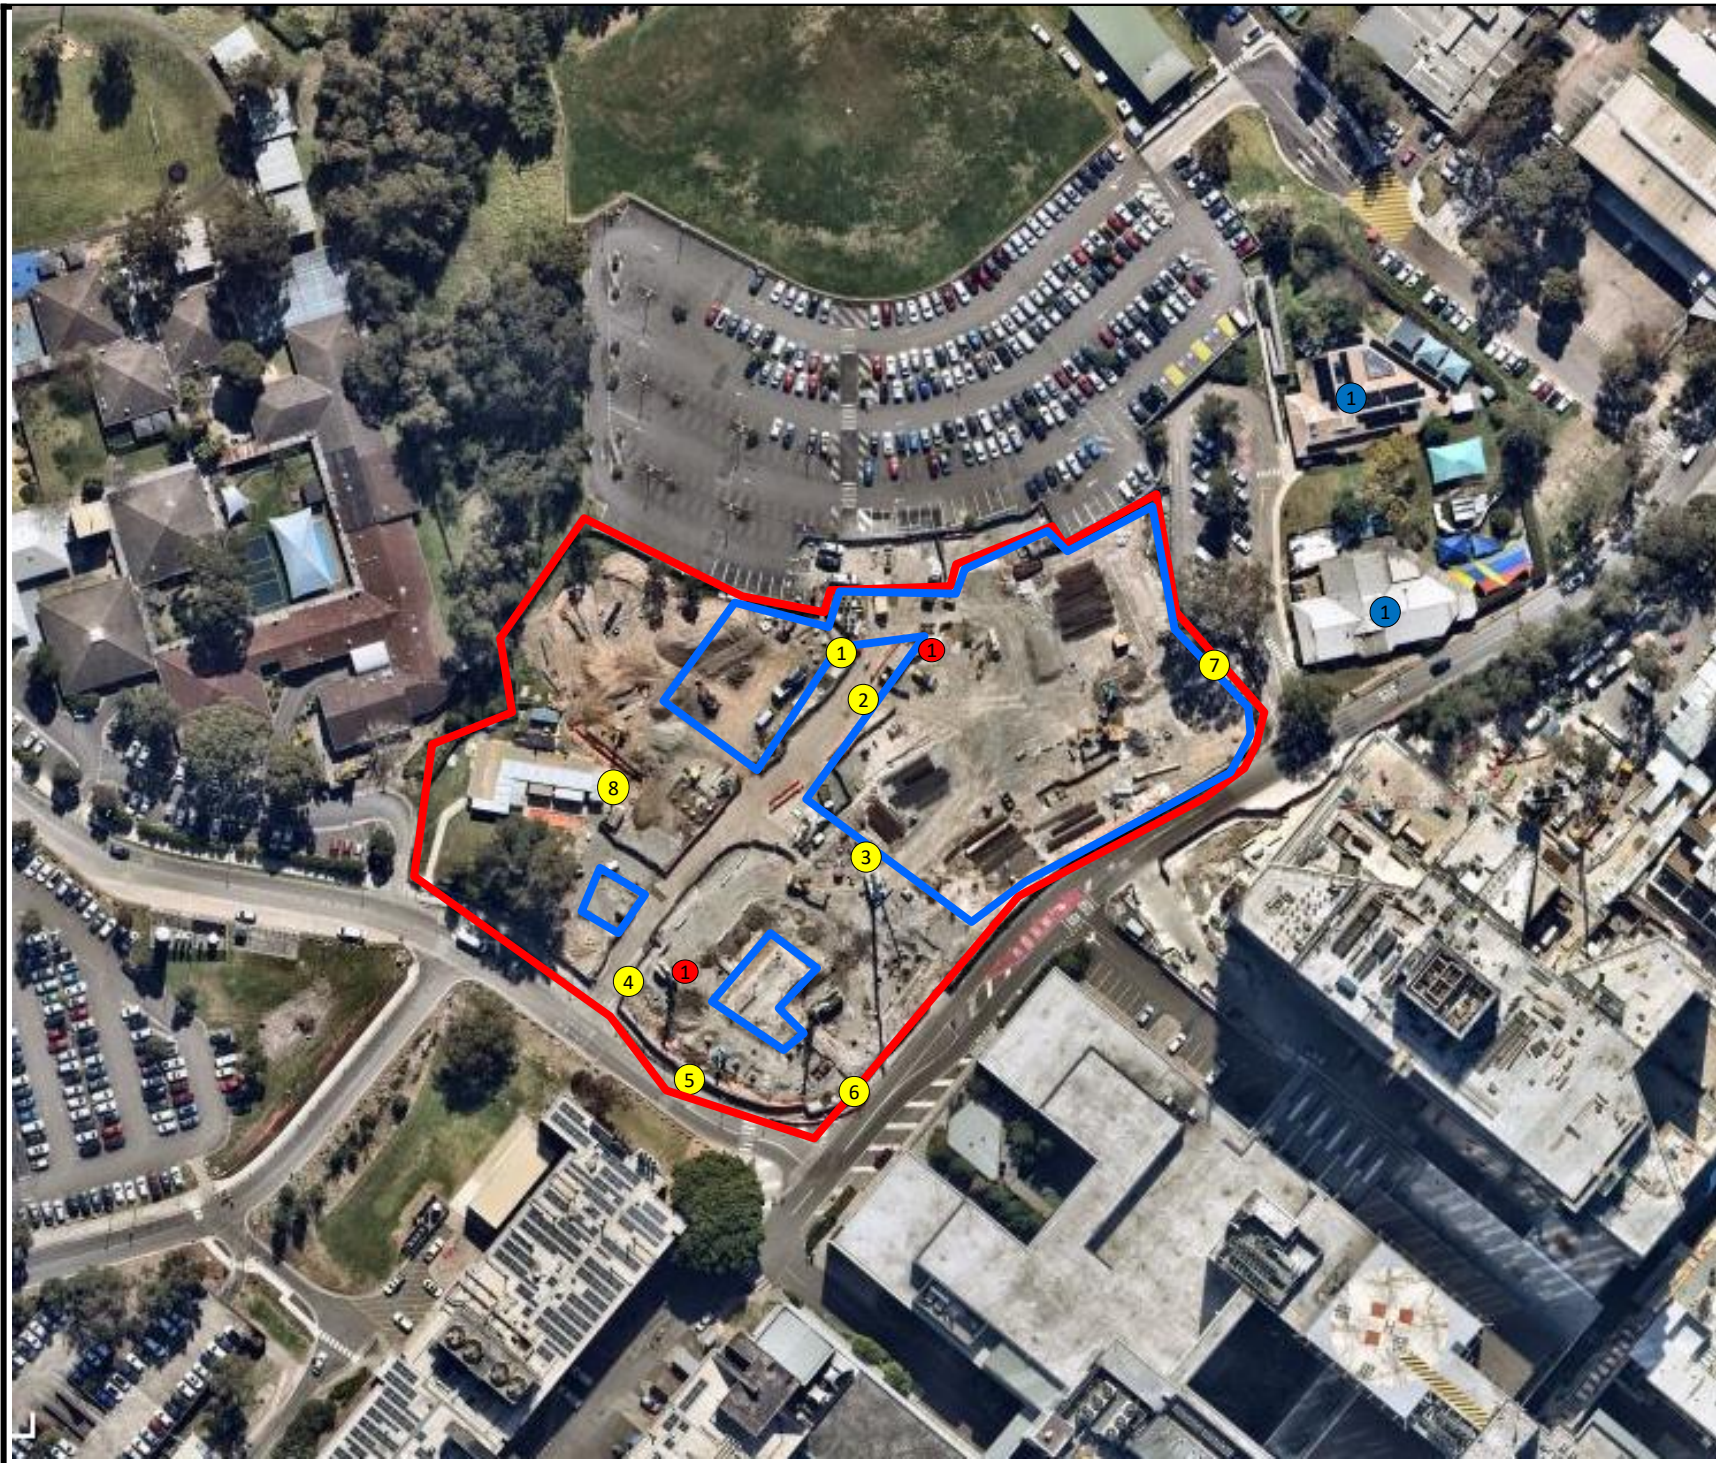

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 10/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 162,947)

AMR289 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

15 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR289: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Monday 14 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025–Testing
 NATA is a signatory to the ILAC Mutual Recognition
 Arrangement for the mutual recognition of the
 equivalence of testing, medical testing, calibration,
 inspection, proficiency testing scheme providers and
 reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1148684-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 14, 2024
Date Reported Oct 14, 2024

METHODOLOGY:

Asbestos Sampling	Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.
Pump Calibration	Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.
Asbestos Counting	Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 14, 2024
Report 1148684-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0032326	DJ300752	AC119	LOC 1: LP7, NE ADJ TO LP6 + P14	7:03	15:02	2.0	2.0	0/100	< 0.01
24-Oc0032327	DJ300829	AC106	LOC 2: BIRSB, WEST ADJ TO P14	7:05	15:04	2.0	2.0	0/100	< 0.01
24-Oc0032328	DJ300706	AC152	LOC 3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:07	15:06	2.0	2.0	0/100	< 0.01
24-Oc0032329	DJ300718	AC035	LOC 4: BIRSB, SW ADJ TO P14 + LP9	7:09	15:08	2.0	2.0	0/100	< 0.01
24-Oc0032330	DJ300730	AC027	LOC 5: BIRSB, SOUTH ADJ TO DRAGON FLY DR	7:11	15:10	2.0	2.0	0/100	< 0.01
24-Oc0032331	DJ300749	AC142	LOC 6: BIRSB, SOUTH ADJ TO REDBANK RD	7:13	15:12	2.0	2.0	0/100	< 0.01
24-Oc0032332	DJ300762	AC248	LOC 7: BIRSB, EAST ADJ TO CCC	7:16	15:15	2.0	2.0	0/100	< 0.01
24-Oc0032333	DJ300818	AC257	LOC 8: LP7, SW ADJ TO SITE SHED	7:20	15:20	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0032334	DJ300715	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 14, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	--	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1148684
Phone: 02 8245 0300
Fax:

Received: Oct 14, 2024 3:38 PM
Due: Oct 14, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300752	Oct 14, 2024	3:02PM	Air	S24-Oc0032326	X
2	DJ300829	Oct 14, 2024	3:04PM	Air	S24-Oc0032327	X
3	DJ300706	Oct 14, 2024	3:06PM	Air	S24-Oc0032328	X
4	DJ300718	Oct 14, 2024	3:06PM	Air	S24-Oc0032329	X
5	DJ300730	Oct 14, 2024	3:10PM	Air	S24-Oc0032330	X
6	DJ300749	Oct 14, 2024	3:12PM	Air	S24-Oc0032331	X
7	DJ300762	Oct 14, 2024	3:15PM	Air	S24-Oc0032332	X
8	DJ300818	Oct 14, 2024	3:20PM	Air	S24-Oc0032333	X
9	DJ300715	Oct 14, 2024		Air	S24-Oc0032334	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos

Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 *Appendix 2*, else assumed to be 15% in accordance with WA DOH *Appendix 2 (PA)*. This estimate is not NATA-accredited.

ACM

Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.

AF

Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".

AFM

Airborne Fibre Monitoring, e.g., by the MFM.

Amosite

Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.

AS

Australian Standard.

Asbestos Content (as asbestos) Total %w/w asbestos content in asbestos-containing finds in a soil sample (**% w/w**).

Chrysotile

Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

COC

Chain of Custody.

Crocidolite

Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Dry

Sample is dried by heating prior to analysis.

DS

Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.

FA

Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.

Fibre Count

Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003

Fibre ID

Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.

Friable

Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.

HSG248

UK HSE HSG248, *Asbestos: The Analysts Guide*, 2nd Edition (2021), ISBN: 9780616667079.

HSG264

UK HSE HSG264, *Asbestos: The Survey Guide* (2012), ISBN: 9780717665020

ISO (also ISO/IEC)

International Organization for Standardization / International Electrotechnical Commission.

K Factor

Microscope constant (**K**) as derived from the effective filter area of the given AFM membrane used for collecting the sample (**A**) and the projected eyepiece graticule area of the specific microscope used for the analysis (**a**).

LOR

Limit of Reporting.

MFM (also NOHSC:3003)

Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres*, 2nd Edition [NOHSC:3003(2005)].

MMVF

Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).

NEPM (also ASC NEPM)

National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).

Organic

Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

PCM

Phase Contrast Microscopy. This is used for fibre counting according to the MFM.

PLM

Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Sampling

Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.

SRA

Sample Receipt Advice.

Trace Analysis

An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.

UK HSE HSG

United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.

UMF

Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.

WA DOH

Reference document for the NEPM. Government of Western Australia, *Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia* (updated 2021), including Appendix Four: *Laboratory analysis*

Weighted Average

Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (**%_{WA}**).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Chamath JHM Annakkage Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

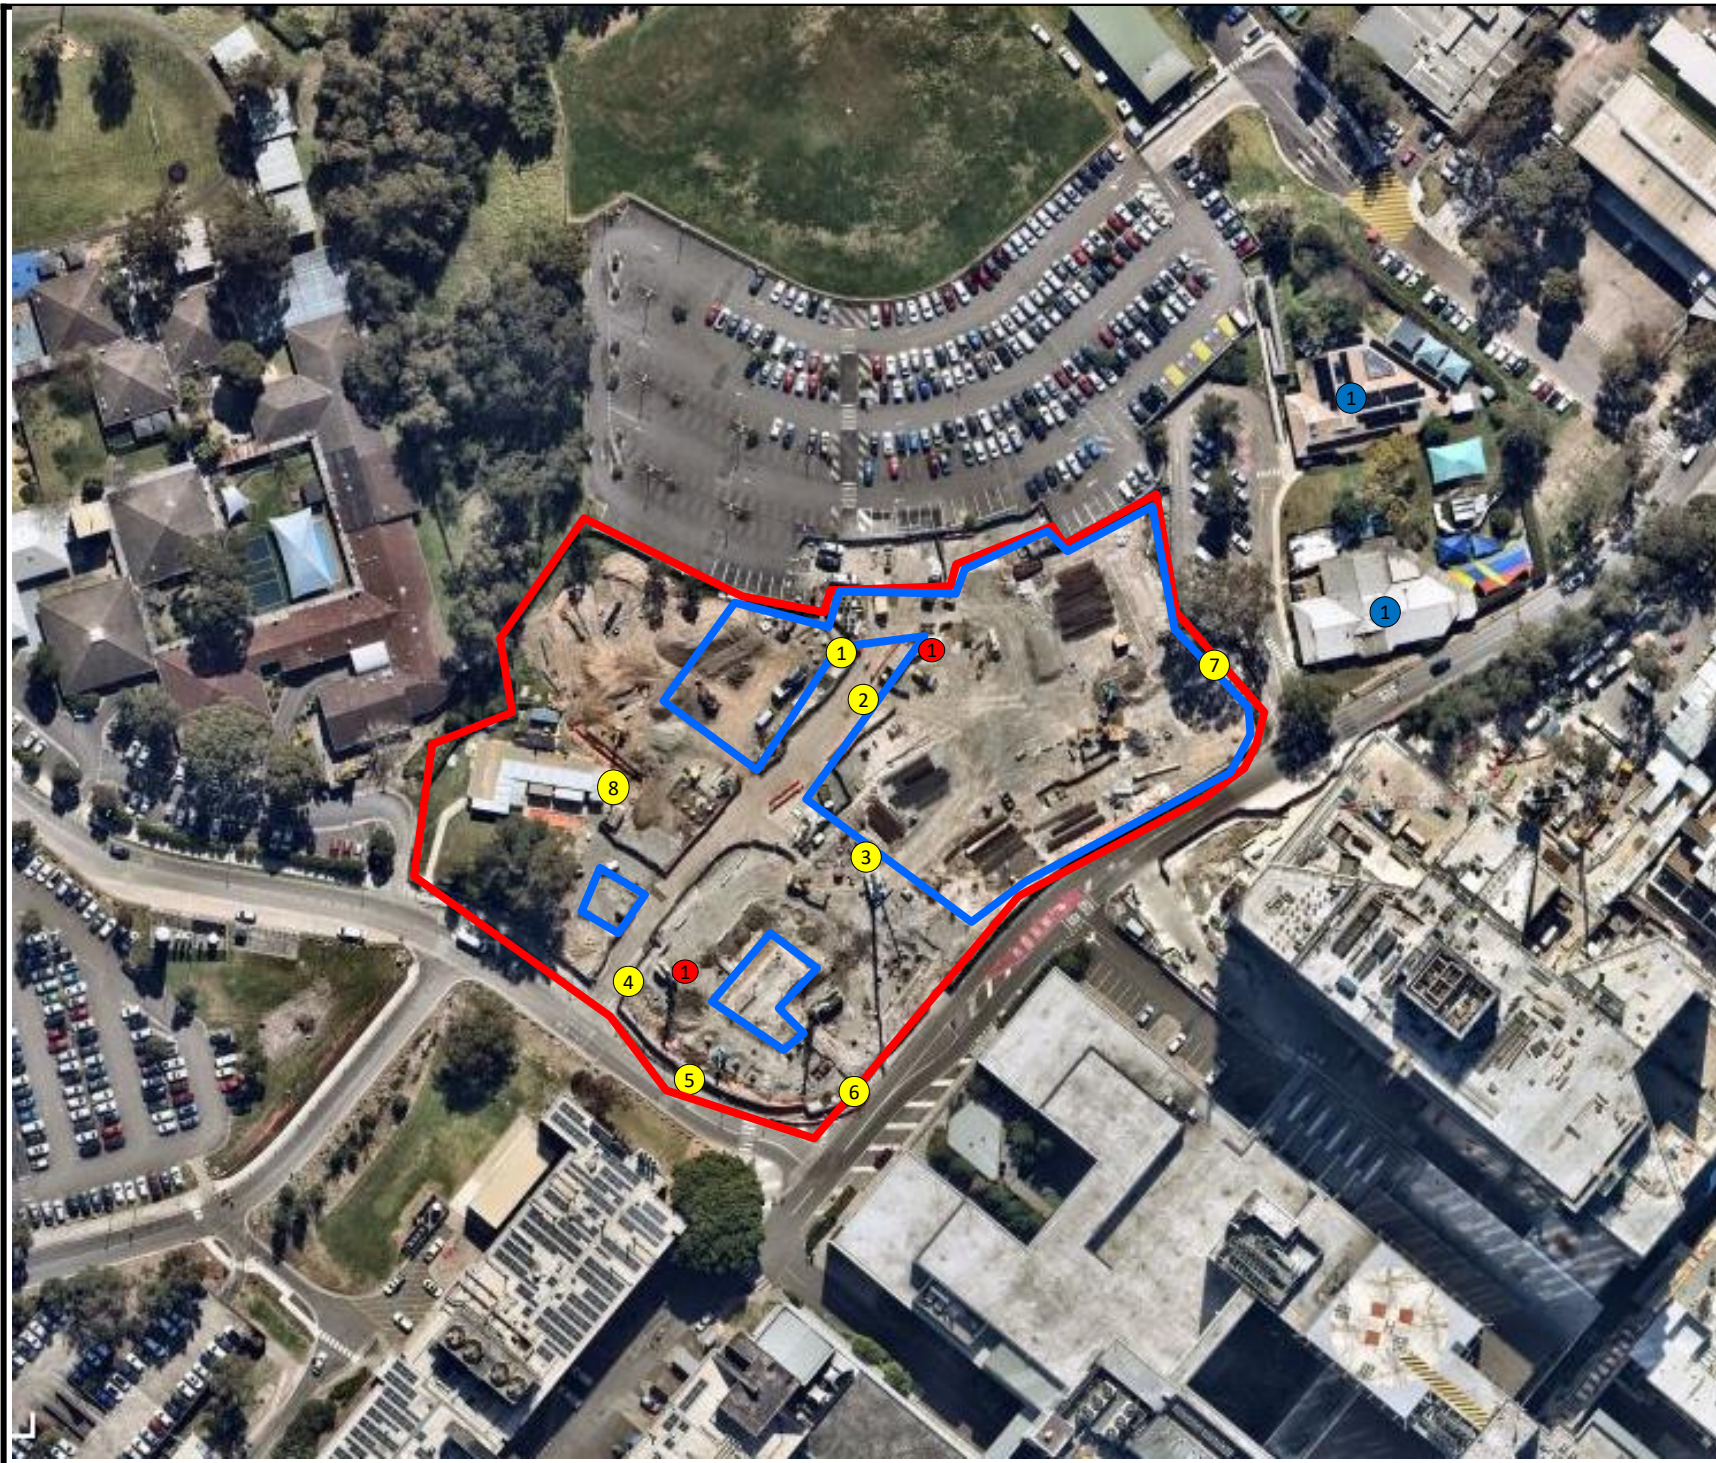

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 14/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,170)

AMR290 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

16 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR290: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Tuesday 15 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1149168-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 15, 2024
Date Reported Oct 15, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 15, 2024
Report 1149168-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0035729	DJ300733	AC248	LOC1: LP7, NE ADJ TO LP6 + P14	8:05	15:08	2.0	2.0	0/100	< 0.01
24-Oc0035730	DJ300726	AC257	LOC2: BIRSB, WEST ADJ TO P14	8:07	15:10	2.0	2.0	0/100	< 0.01
24-Oc0035731	DJ300692	AC152	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	8:09	15:12	2.0	2.0	0/100	< 0.01
24-Oc0035732	DJ300704	AC142	LOC4: BIRSB, SW ADJ TO P14 + LP9	8:11	15:14	2.0	2.0	0/100	< 0.01
24-Oc0035733	DJ300740	AC106	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	8:13	15:16	2.0	2.0	0/100	< 0.01
24-Oc0035734	DJ300722	AC027	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	8:15	15:18	2.0	2.0	0/100	< 0.01
24-Oc0035735	DJ300734	AC035	LOC7: BIRSB, EAST ADJ TO CCC	8:18	15:21	2.0	2.0	0/100	< 0.01
24-Oc0035736	DJ300723	AC119	LOC8: LP7, SW ADJ TO SITE SHED	8:22	15:24	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0035737	DJ300737	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 15, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	--	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L	Order No.:	Received: Oct 15, 2024 3:50 PM
Address: Level 1, 50 Margaret St Sydney NSW 2000	Report #: 1149168	Due: Oct 15, 2024
Project Name: IMHC WESTMEAD	Phone: 02 8245 0300	Priority: Same day
Project ID: 65686	Fax:	Contact Name: Milad Noujaim
Eurofins Analytical Services Manager : Andrew Black		

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300733	Oct 15, 2024	3:05PM	Air	S24-Oc0035729	X
2	DJ300726	Oct 15, 2024	3:10PM	Air	S24-Oc0035730	X
3	DJ300692	Oct 15, 2024	3:12PM	Air	S24-Oc0035731	X
4	DJ300704	Oct 15, 2024	3:14PM	Air	S24-Oc0035732	X
5	DJ300740	Oct 15, 2024	3:16PM	Air	S24-Oc0035733	X
6	DJ300722	Oct 15, 2024	3:18PM	Air	S24-Oc0035734	X
7	DJ300734	Oct 15, 2024	3:21PM	Air	S24-Oc0035735	X
8	DJ300723	Oct 15, 2024	3:24PM	Air	S24-Oc0035736	X
9	DJ300737	Oct 15, 2024		Air	S24-Oc0035737	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Chamath JHM Annakkage Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

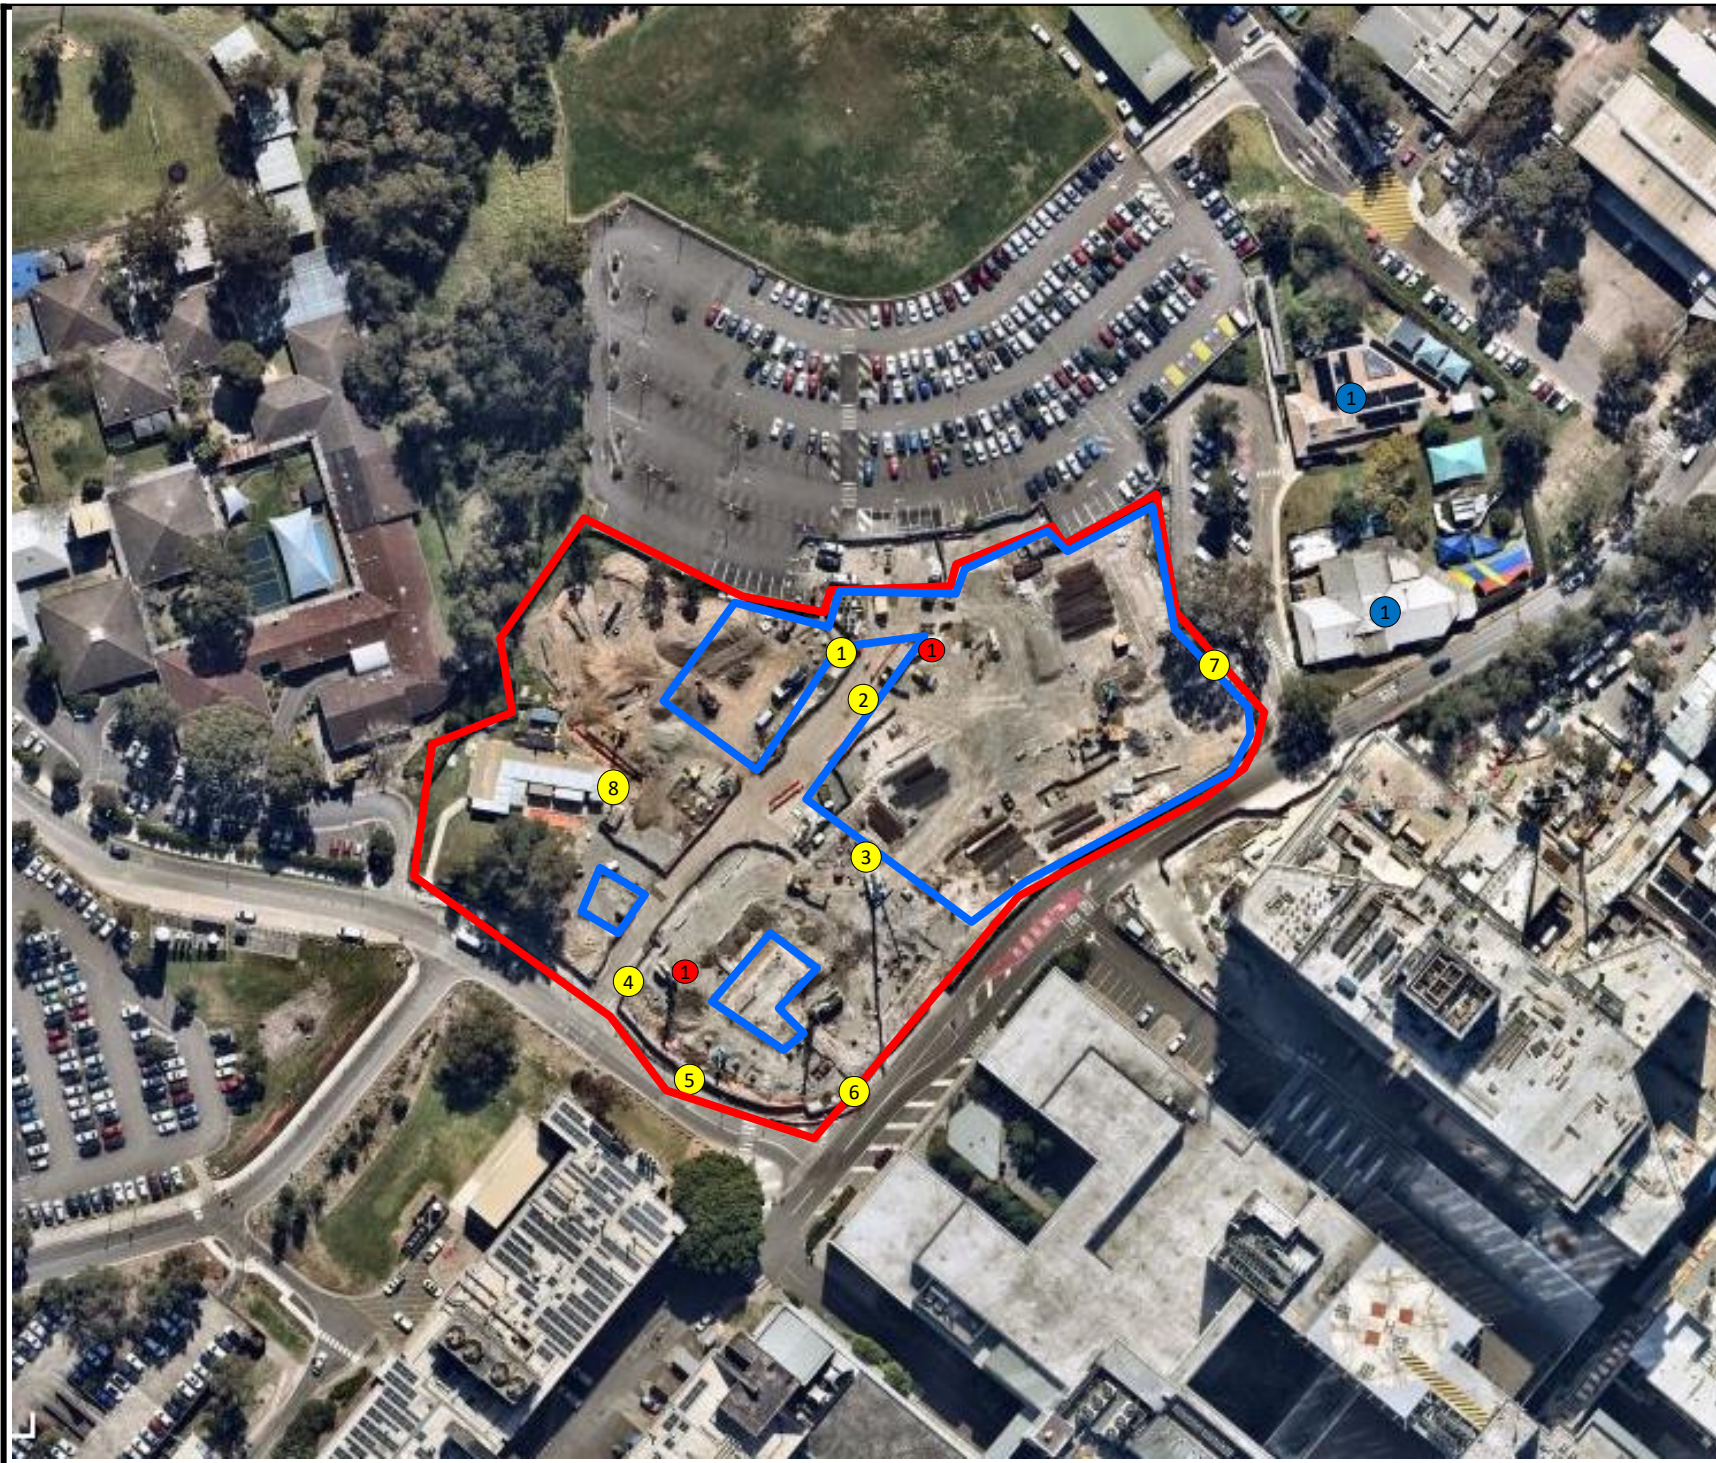

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 15/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,169)

AMR291 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

17 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR291: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Wednesday 16 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1149652-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 16, 2024
Date Reported Oct 16, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 16, 2024
Report 1149652-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0039393	DJ300735	AC106	LOC1: LP7, NE ADJ TO LP6 + P14	7:24	15:11	2.0	2.0	0/100	< 0.01
24-Oc0039394	DJ300714	AC152	LOC2: BIRSB, WEST ADJ TO P14	7:26	15:13	2.0	2.0	0/100	< 0.01
24-Oc0039395	DJ300695	AC027	LOC3: BIRSB, CENTRE OF OPPOSITE RETAINING WALL	7:28	15:15	2.0	2.0	0/100	< 0.01
24-Oc0039396	DJ300742	AC119	LOC4: BIRSB, SW ADJ TO P14 + LP9	7:30	15:17	2.0	2.0	0/100	< 0.01
24-Oc0039397	DJ300746	AC035	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:32	15:19	2.0	2.0	0/100	< 0.01
24-Oc0039398	DJ300711	AC142	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:34	15:21	2.0	2.0	0/100	< 0.01
24-Oc0039399	DJ300724	AC248	LOC7: BIRSB, EAST ADJ TO CCC	7:37	15:23	2.0	2.0	0/100	< 0.01
24-Oc0039400	DJ300712	AC257	LOC8: LP7, SW ADJ TO SITE SHED	7:40	15:26	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0039401	DJ300744	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 16, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 +64 9 526 4551 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L	Order No.:	Received: Oct 16, 2024 3:55 PM
Address: Level 1, 50 Margaret St Sydney NSW 2000	Report #: 1149652	Due: Oct 16, 2024
	Phone: 02 8245 0300	Priority: Same day
	Fax:	Contact Name: Milad Noujaim
Project Name: IMHC WESTMEAD	Eurofins Analytical Services Manager : Andrew Black	
Project ID: 65686		

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300735	Oct 16, 2024	3:11PM	Air	S24-Oc0039393	X
2	DJ300714	Oct 16, 2024	3:13PM	Air	S24-Oc0039394	X
3	DJ300695	Oct 16, 2024	3:15PM	Air	S24-Oc0039395	X
4	DJ300742	Oct 16, 2024	3:17PM	Air	S24-Oc0039396	X
5	DJ300746	Oct 16, 2024	3:19PM	Air	S24-Oc0039397	X
6	DJ300711	Oct 16, 2024	3:21PM	Air	S24-Oc0039398	X
7	DJ300724	Oct 16, 2024	3:23PM	Air	S24-Oc0039399	X
8	DJ300712	Oct 16, 2024	3:26PM	Air	S24-Oc0039400	X
9	DJ300744	Oct 16, 2024		Air	S24-Oc0039401	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times PA)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times PA)_x}{x}$

Terms

%asbestos

Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 *Appendix 2*, else assumed to be 15% in accordance with WA DOH *Appendix 2 (PA)*. This estimate is not NATA-accredited.

ACM

Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.

AF

Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".

AFM

Airborne Fibre Monitoring, e.g., by the MFM.

Amosite

Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.

AS

Australian Standard.

Asbestos Content (as asbestos) Total %w/w asbestos content in asbestos-containing finds in a soil sample (**% w/w**).

Chrysotile

Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

COC

Chain of Custody.

Crocidolite

Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Dry

Sample is dried by heating prior to analysis.

DS

Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.

FA

Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.

Fibre Count

Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003

Fibre ID

Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.

Friable

Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.

HSG248

UK HSE HSG248, *Asbestos: The Analysts Guide*, 2nd Edition (2021), ISBN: 9780616667079.

HSG264

UK HSE HSG264, *Asbestos: The Survey Guide* (2012), ISBN: 9780717665020

ISO (also ISO/IEC)

International Organization for Standardization / International Electrotechnical Commission.

K Factor

Microscope constant (**K**) as derived from the effective filter area of the given AFM membrane used for collecting the sample (**A**) and the projected eyepiece graticule area of the specific microscope used for the analysis (**a**).

LOR

Limit of Reporting.

MFM (also NOHSC:3003)

Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres*, 2nd Edition [NOHSC:3003(2005)].

MMVF

Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).

NEPM (also ASC NEPM)

National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).

Organic

Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

PCM

Phase Contrast Microscopy. This is used for fibre counting according to the MFM.

PLM

Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Sampling

Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.

SRA

Sample Receipt Advice.

Trace Analysis

An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.

UK HSE HSG

United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.

UMF

Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.

WA DOH

Reference document for the NEPM. Government of Western Australia, *Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia* (updated 2021), including Appendix Four: *Laboratory analysis*

Weighted Average

Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (**%_{WA}**).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Laxman Dias Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

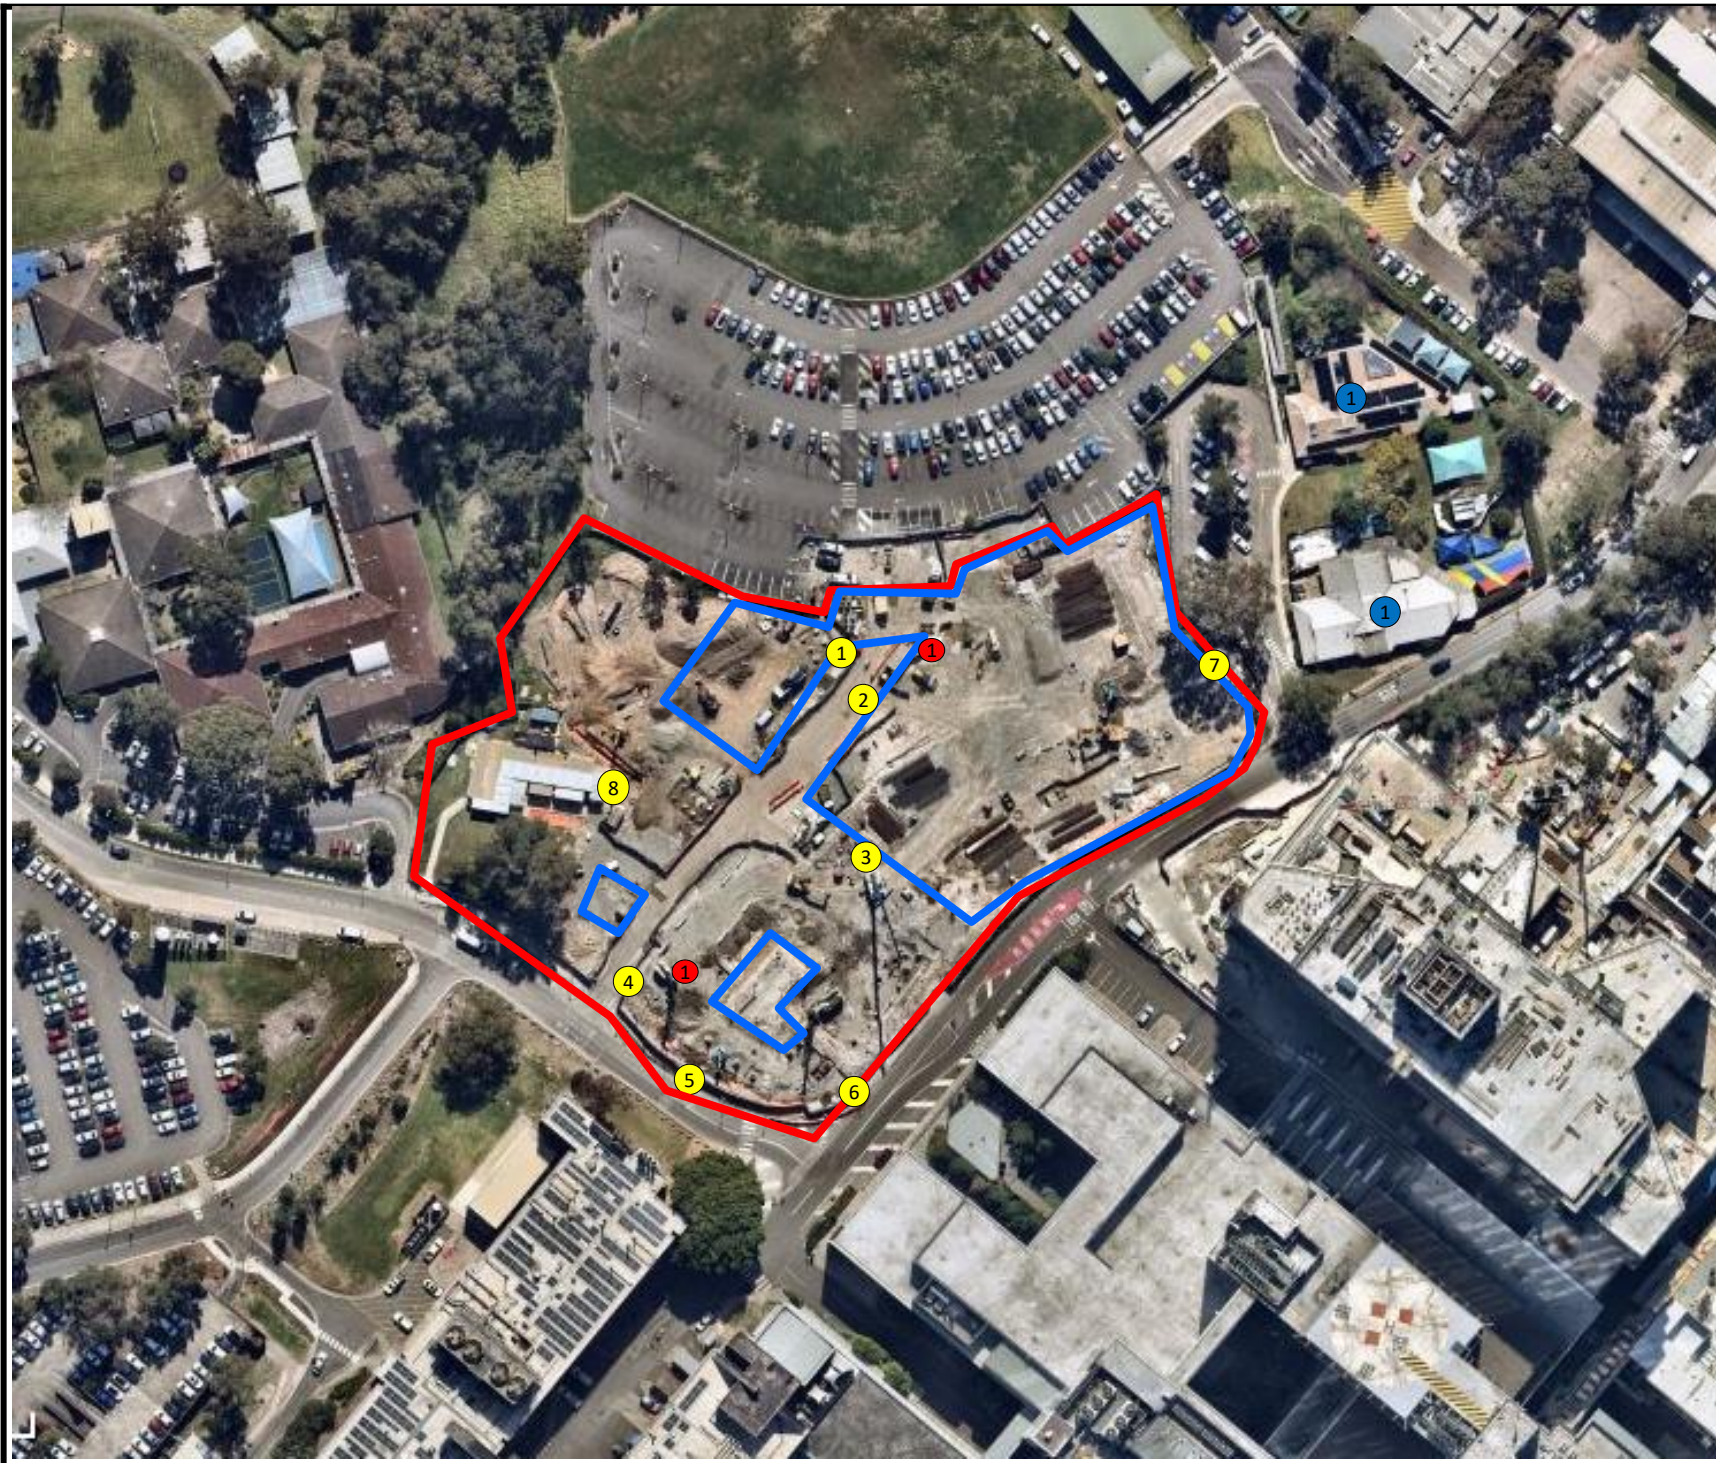

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- 1 Decontamination Unit
- 1 Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 16/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,171)

AMR292 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

18 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR292: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Thursday 17 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1150141-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 17, 2024
Date Reported Oct 17, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 17, 2024
Report 1150141-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0042758	DJ300691	AC257	LOC1: LP7, NE ADJ TO LP6 + P14	7:08	15:04	2.0	2.0	0/100	< 0.01
24-Oc0042759	DJ300716	AC142	LOC2: BIRSB, WEST ADJ TO P14	7:10	15:06	2.0	2.0	0/100	< 0.01
24-Oc0042760	DJ300700	AC248	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:12	15:08	2.0	2.0	0/100	< 0.01
24-Oc0042761	DJ300728	AC106	LOC4: BIRSB, SW ADJ TO P14 + LP9	7:14	15:10	2.0	2.0	0/100	< 0.01
24-Oc0042762	DJ300831	AC119	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:16	15:12	2.0	2.0	0/100	< 0.01
24-Oc0042763	DJ300701	AC035	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:18	15:14	2.0	2.0	0/100	< 0.01
24-Oc0042764	DJ300696	AC027	LOC7: BIRSB, EAST ADJ TO CCC	7:21	15:17	2.0	2.0	0/100	< 0.01
24-Oc0042765	DJ300694	AC152	LOC8: LP7, SW ADJ TO SITE SHED	7:24	15:22	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0042766	DJ300703	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 17, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	--	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1150141
Phone: 02 8245 0300
Fax:

Received: Oct 17, 2024 3:55 PM
Due: Oct 17, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ300691	Oct 17, 2024	7:08AM	Air	S24-Oc0042758	X
2	DJ300716	Oct 17, 2024	7:10AM	Air	S24-Oc0042759	X
3	DJ300700	Oct 17, 2024	7:12AM	Air	S24-Oc0042760	X
4	DJ300728	Oct 17, 2024	7:14AM	Air	S24-Oc0042761	X
5	DJ300831	Oct 17, 2024	7:16AM	Air	S24-Oc0042762	X
6	DJ300701	Oct 17, 2024	7:18AM	Air	S24-Oc0042763	X
7	DJ300696	Oct 17, 2024	7:21AM	Air	S24-Oc0042764	X
8	DJ300694	Oct 17, 2024	7:24AM	Air	S24-Oc0042765	X
9	DJ300703	Oct 17, 2024		Air	S24-Oc0042766	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : DAVID EDWARDS-DAVIS, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Laxman Dias Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

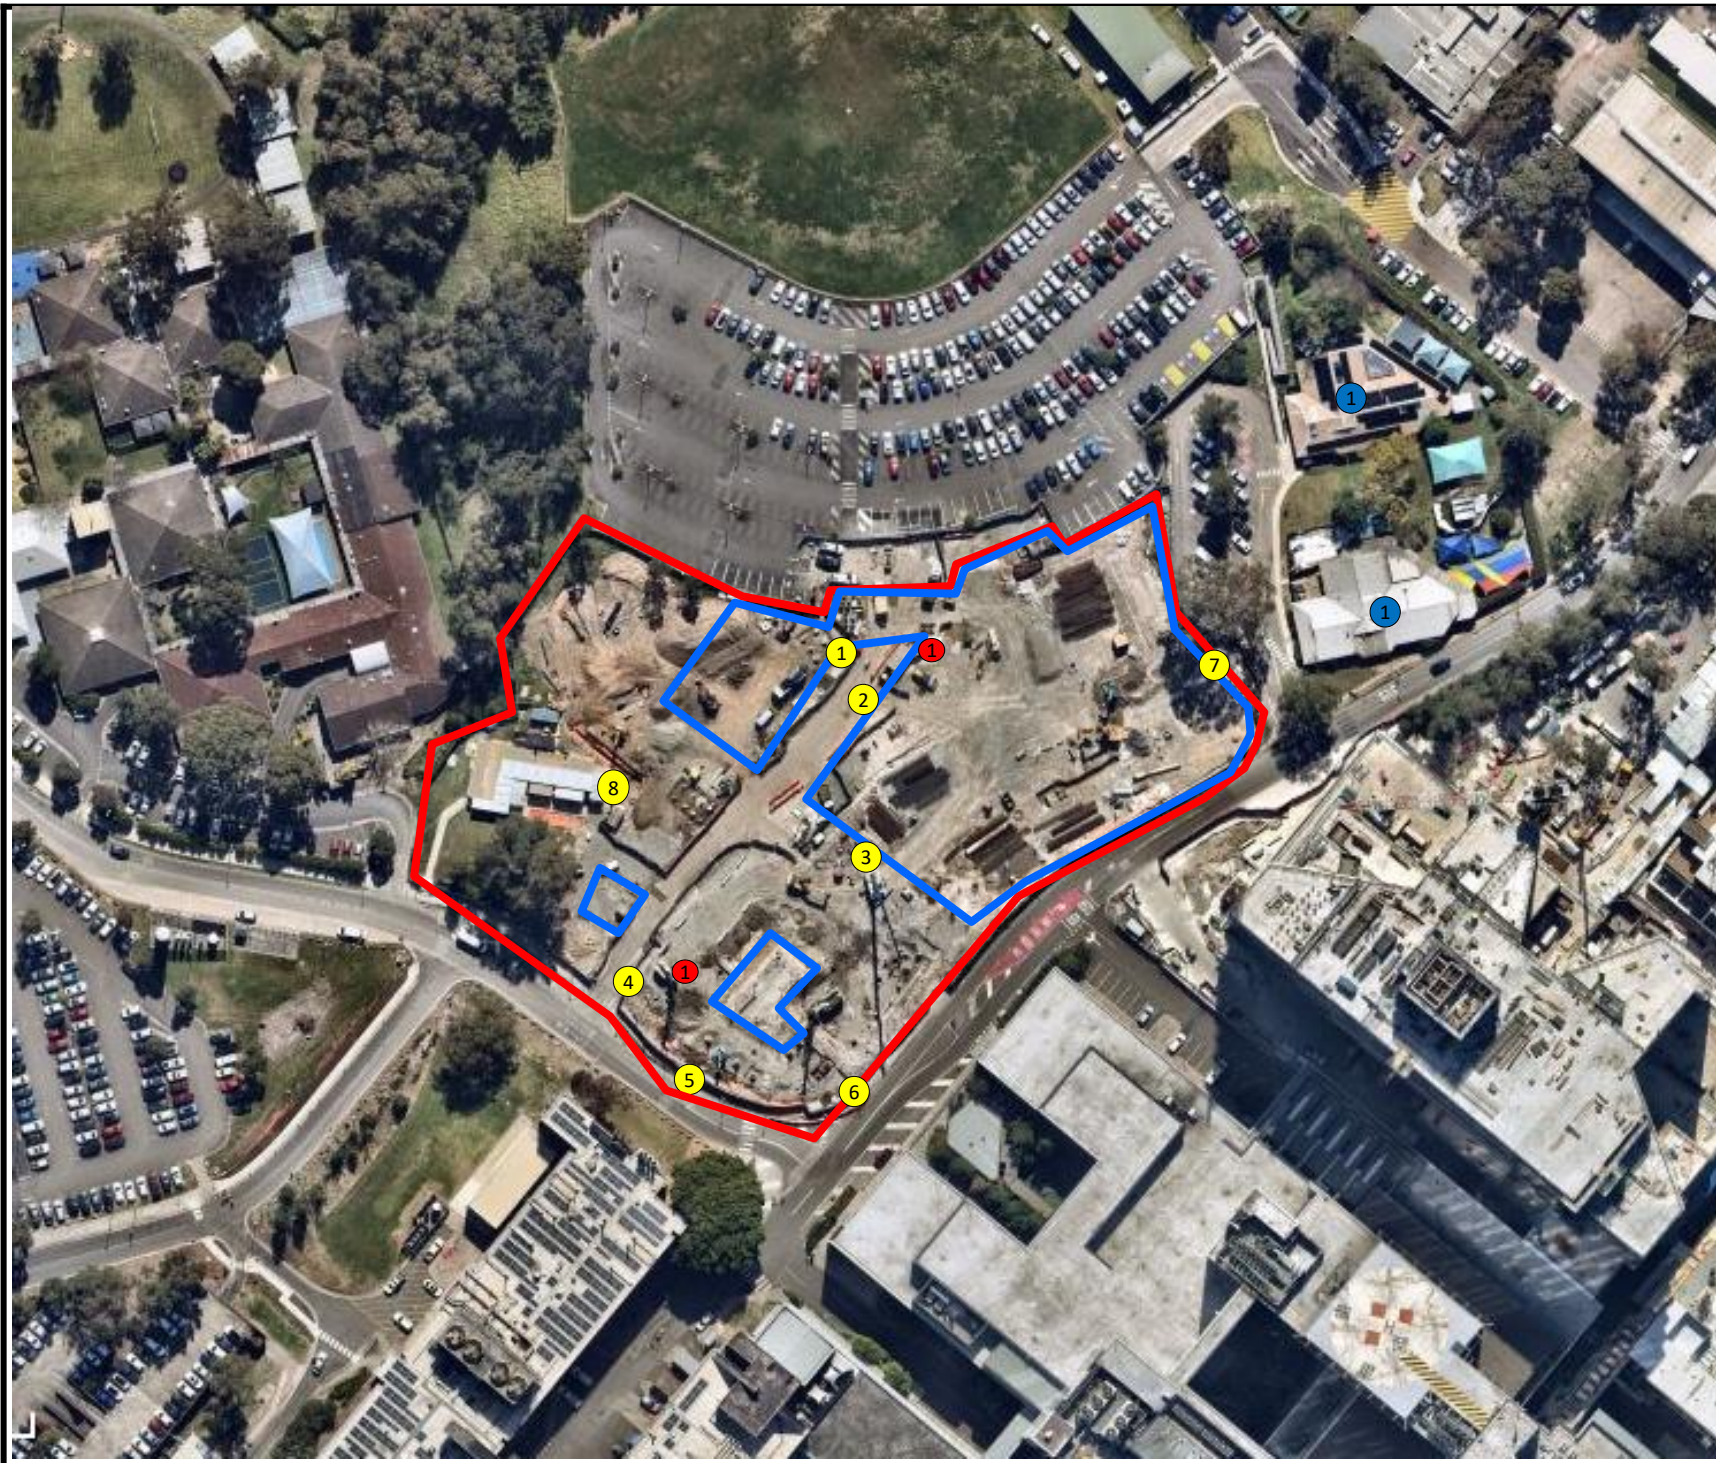

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 17/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,172)

AMR293 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

21 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR293: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Friday 18 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1150682-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 18, 2024
Date Reported Oct 18, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 18, 2024
Report 1150682-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0047131	DJ641867	AC248	LOC 1: LP7, NE ADJ TO LP6, P14	10:04	15:18	2.0	2.0	0/100	< 0.01
24-Oc0047132	DJ641881	AC200	LOC 2: BIRSB, WEST ADJ TO P14	10:06	15:20	2.0	2.0	0/100	< 0.01
24-Oc0047133	DJ641892	AC257	LOC 3: BIRSB CENTRE OPPOSITE TO RETAINING WALL	10:08	15:22	2.0	2.0	0/100	< 0.01
24-Oc0047134	DJ641877	AC152	LOC 4: BIRSB, SW ADJ TO P14, LP9	10:10	15:24	2.0	2.0	0/100	< 0.01
24-Oc0047135	DJ641855	AC142	LOC 5: BIRSB, SOUTH ADJ TO DRAGON FLY DRIVE	10:13	15:27	2.0	2.0	0/100	< 0.01
24-Oc0047136	DJ641889	AC035	LOC 6: BIRSB, SOUTH ADJ TO RED BANK RD	10:15	15:29	2.0	2.0	0/100	< 0.01
24-Oc0047137	DJ641865	AC119	LOC 7: BIRSB, EAST ADJ TO CCC	10:17	15:32	2.0	2.0	0/100	< 0.01
24-Oc0047138	DJ641769	AC027	LOC 8: LP7, SW ADJ TO SITE SHEDS	10:21	15:37	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0047139	DJ641890	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 18, 2024	Indefinite

web: www.eurofins.com.au
 email: EnviroSales@eurofins.com

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1150682
Phone: 02 8245 0300
Fax:

Received: Oct 18, 2024 4:25 PM
Due: Oct 18, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ641867	Oct 18, 2024	3:18PM	Air	S24-Oc0047131	X
2	DJ641881	Oct 18, 2024	3:20PM	Air	S24-Oc0047132	X
3	DJ641892	Oct 18, 2024	3:22PM	Air	S24-Oc0047133	X
4	DJ641877	Oct 18, 2024	3:24PM	Air	S24-Oc0047134	X
5	DJ641855	Oct 18, 2024	3:27PM	Air	S24-Oc0047135	X
6	DJ641889	Oct 18, 2024	3:29PM	Air	S24-Oc0047136	X
7	DJ641865	Oct 18, 2024	3:32PM	Air	S24-Oc0047137	X
8	DJ641769	Oct 18, 2024	3:37PM	Air	S24-Oc0047138	X
9	DJ641890	Oct 18, 2024		Air	S24-Oc0047139	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms
%asbestos

Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 *Appendix 2*, else assumed to be 15% in accordance with WA DOH *Appendix 2 (PA)*. This estimate is not NATA-accredited.

ACM

Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.

AF

Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".

AFM

Airborne Fibre Monitoring, e.g., by the MFM.

Amosite

Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.

AS

Australian Standard.

Asbestos Content (as asbestos) Total %w/w asbestos content in asbestos-containing finds in a soil sample (**% w/w**).

Chrysotile

Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

COC

Chain of Custody.

Crocidolite

Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Dry

Sample is dried by heating prior to analysis.

DS

Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.

FA

Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.

Fibre Count

Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003

Fibre ID

Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.

Friable

Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.

HSG248

UK HSE HSG248, *Asbestos: The Analysts Guide*, 2nd Edition (2021), ISBN: 9780616667079.

HSG264

UK HSE HSG264, *Asbestos: The Survey Guide* (2012), ISBN: 9780717665020

ISO (also ISO/IEC)

International Organization for Standardization / International Electrotechnical Commission.

K Factor

Microscope constant (**K**) as derived from the effective filter area of the given AFM membrane used for collecting the sample (**A**) and the projected eyepiece graticule area of the specific microscope used for the analysis (**a**).

LOR

Limit of Reporting.

MFM (also NOHSC:3003)

Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres*, 2nd Edition [NOHSC:3003(2005)].

MMVF

Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).

NEPM (also ASC NEPM)

National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).

Organic

Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

PCM

Phase Contrast Microscopy. This is used for fibre counting according to the MFM.

PLM

Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Sampling

Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.

SRA

Sample Receipt Advice.

Trace Analysis

An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.

UK HSE HSG

United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.

UMF

Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.

WA DOH

Reference document for the NEPM. Government of Western Australia, *Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia* (updated 2021), including Appendix Four: *Laboratory analysis*

Weighted Average

Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (**%_{WA}**).

Comments

Volume Measurement : Milad Noujaim, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Laxman Dias Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

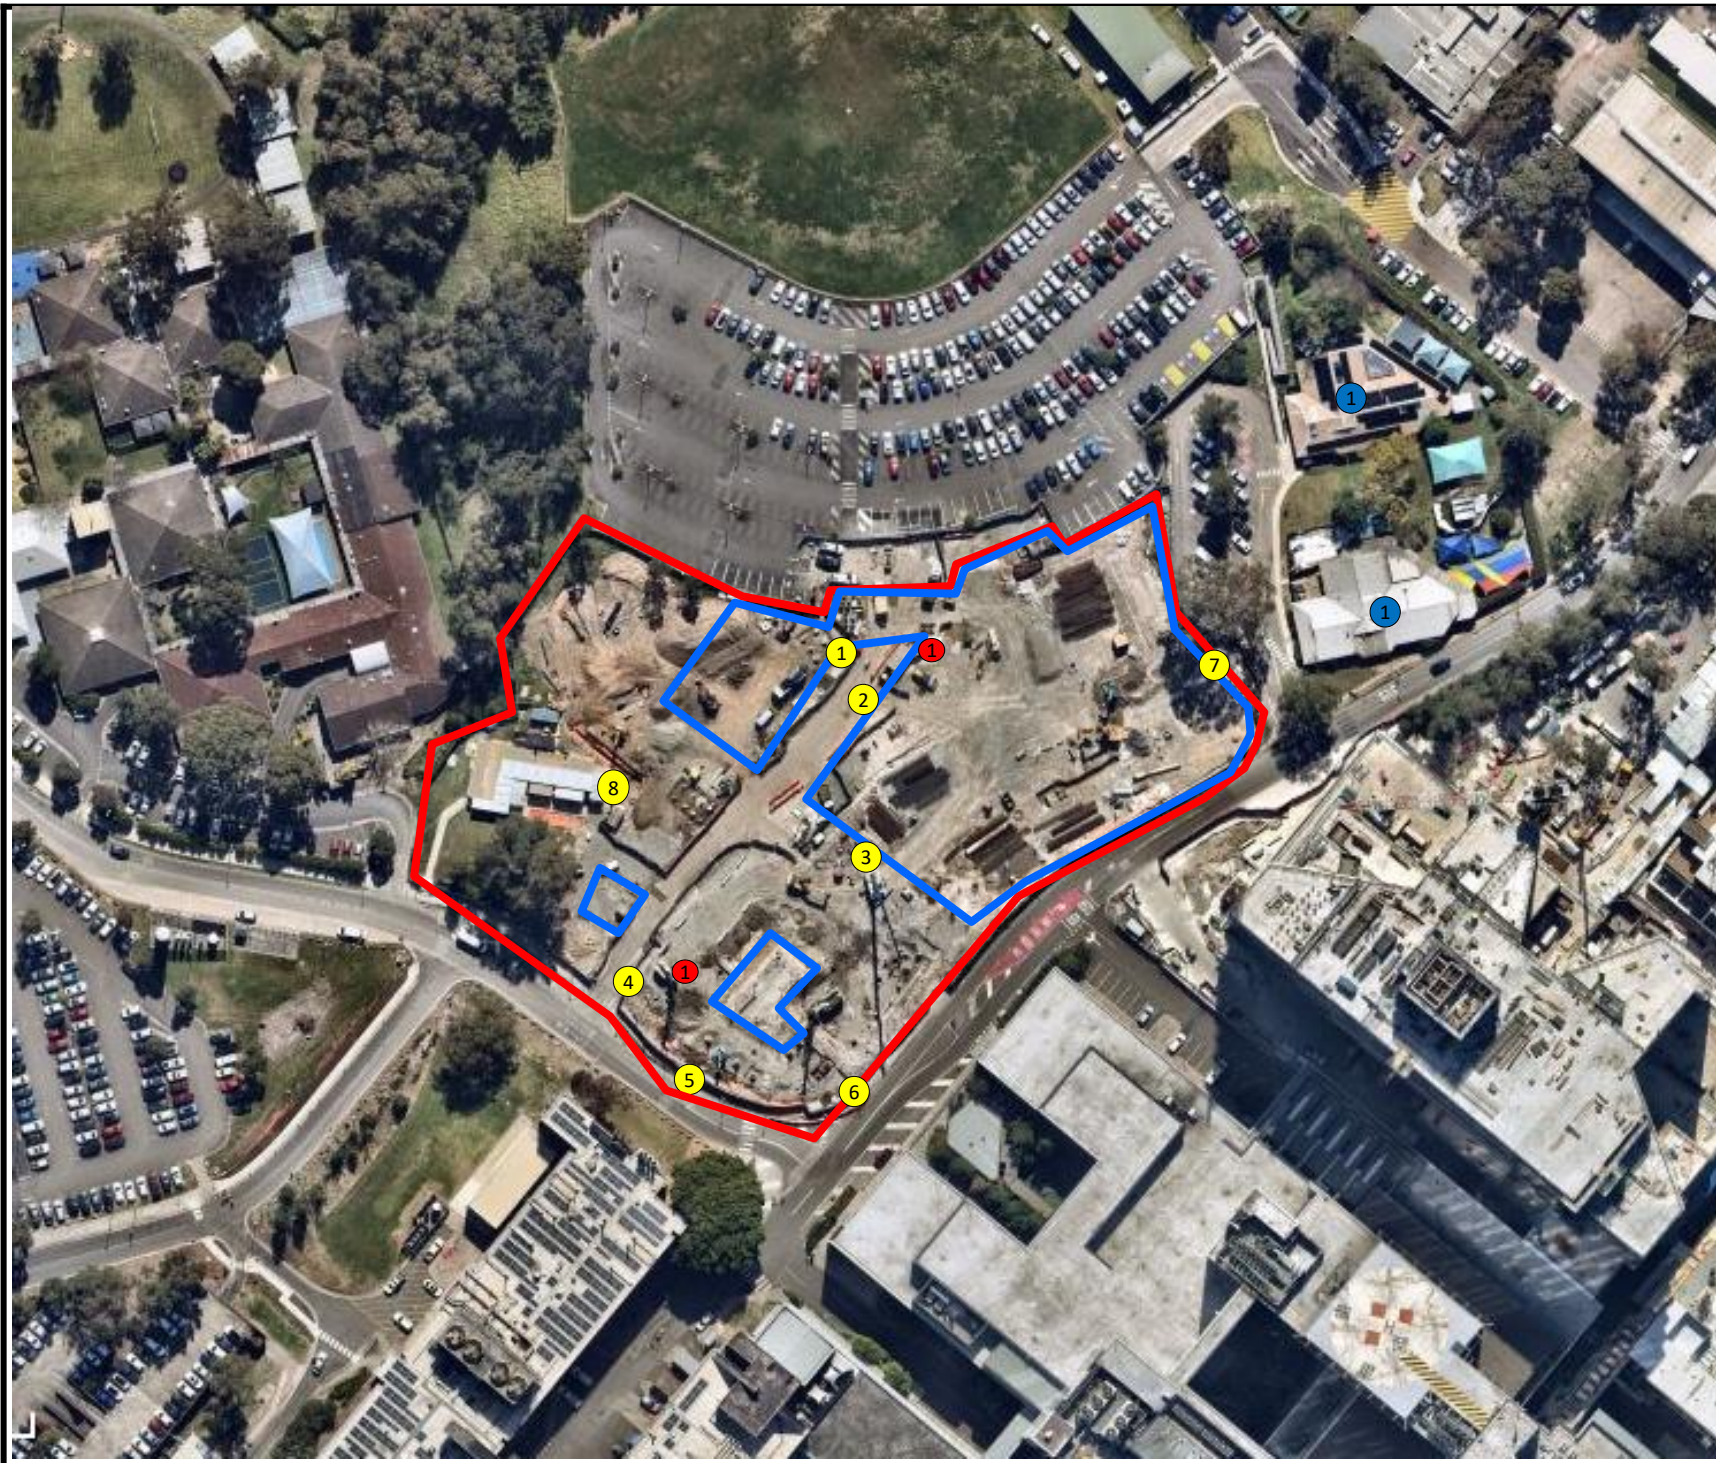

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 15/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,173)

AMR294 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

22 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR294: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Monday 21 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1151166-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 21, 2024
Date Reported Oct 21, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition, [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 21, 2024
Report 1151166-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0050700	DJ641859	AC152	LOC1: LP7, NE ADJ TO LP6 + P14	7:04	15:03	2.0	2.0	0/100	< 0.01
24-Oc0050701	DJ641851	AC142	LOC2: BIRSB, WEST ADJ TO P14	7:06	15:05	2.0	2.0	0/100	< 0.01
24-Oc0050702	DJ641871	AC257	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:08	15:07	2.0	2.0	0/100	< 0.01
24-Oc0050703	DJ641862	AC035	LOC4: BIRSB, SW ADJ TO P14 + LP9	7:10	15:09	2.0	2.0	0/100	< 0.01
24-Oc0050704	DJ641838	AC027	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:12	15:11	2.0	2.0	0/100	< 0.01
24-Oc0050705	DJ641887	AC119	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:14	15:13	2.0	2.0	0/100	< 0.01
24-Oc0050706	DJ641853	AC200	LOC7: BIRSB, EAST ADJ TO CCC	7:17	15:16	2.0	2.0	0/100	< 0.01
24-Oc0050707	DJ641849	AC248	LOC8: LP7, SW ADJ TO SITE SHED	7:20	15:19	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0050708	DJ641758	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 21, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1151166
Phone: 02 8245 0300
Fax:

Received: Oct 21, 2024 3:48 PM
Due: Oct 21, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ641859	Oct 21, 2024	3:03PM	Air	S24-Oc0050700	X
2	DJ641851	Oct 21, 2024	3:05PM	Air	S24-Oc0050701	X
3	DJ641871	Oct 21, 2024	3:07PM	Air	S24-Oc0050702	X
4	DJ641862	Oct 21, 2024	3:09PM	Air	S24-Oc0050703	X
5	DJ641838	Oct 21, 2024	3:11PM	Air	S24-Oc0050704	X
6	DJ641887	Oct 21, 2024	3:13PM	Air	S24-Oc0050705	X
7	DJ641853	Oct 21, 2024	3:16PM	Air	S24-Oc0050706	X
8	DJ641849	Oct 21, 2024	3:19PM	Air	S24-Oc0050707	X
9	DJ641758	Oct 21, 2024		Air	S24-Oc0050708	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Chamath JHM Annakkage Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

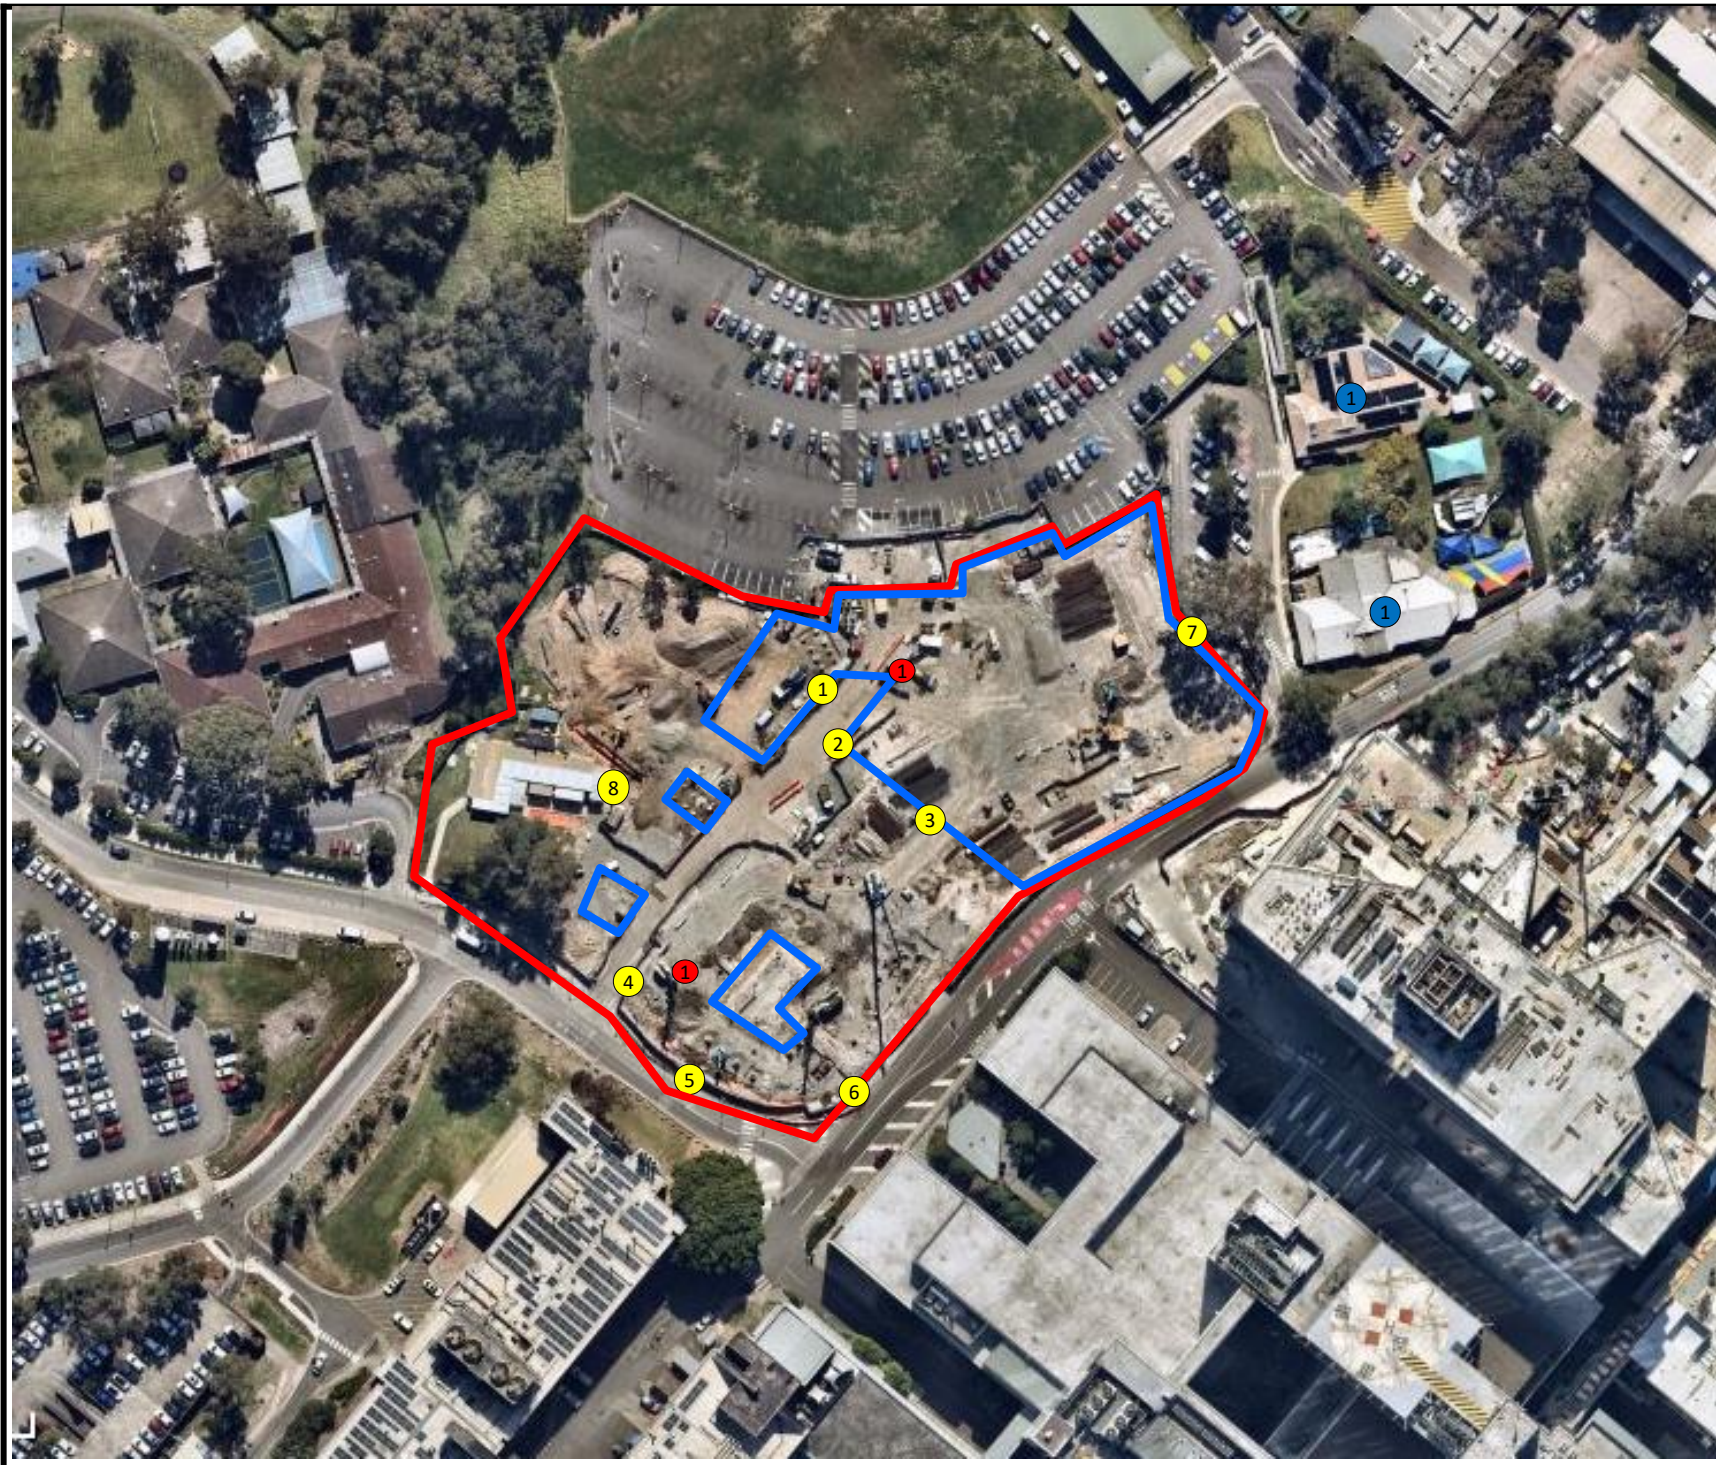

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- Asbestos Air Monitoring Pumps
- Decontamination Unit
- Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 15/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,290)

AMR295 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

23 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR295: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Tuesday 22 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1151656-AFC
Project Name IMHC WESTMEAD
Project ID 65688
Received Date Oct 22, 2024
Date Reported Oct 22, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65688
Date Sampled Oct 22, 2024
Report 1151656-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0054497	DJ641754	AC119	LOC1: LP7, NE ADJ TO LP6 + P14	7:00	15:04	2.0	2.0	0/100	< 0.01
24-Oc0054498	DJ641844	AC027	LOC2: BIRSB, WEST ADJ TO P14	7:02	15:06	2.0	2.0	0/100	< 0.01
24-Oc0054499	DJ641888	AC257	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:04	15:08	2.0	2.0	0/100	< 0.01
24-Oc0054500	DJ641864	AC248	LOC4: BIRSB, SW ADJ TO P14 + LP9	7:06	15:10	2.0	2.0	0/100	< 0.01
24-Oc0054501	DJ641857	AC035	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:08	15:12	2.0	2.0	0/100	< 0.01
24-Oc0054502	DJ641872	AC142	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:10	15:14	2.0	2.0	0/100	< 0.01
24-Oc0054503	DJ641900	AC161	LOC7: BIRSB, EAST ADJ TO CCC	7:13	15:17	2.0	2.0	0/100	< 0.01
24-Oc0054504	DJ641894	AC152	LOC8: LP7, SW ADJ TO SITE SHED	7:19	15:20	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0054505	DJ641875	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 22, 2024	Indefinite

web: www.eurofins.com.au
email: EnviroSales@eurofins.com

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 +64 9 526 4551 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	--	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L Address: Level 1, 50 Margaret St Sydney NSW 2000	Order No.: Report #: 1151656 Phone: 02 8245 0300 Fax:	Received: Oct 22, 2024 4:00 PM Due: Oct 22, 2024 Priority: Same day Contact Name: Milad Noujaim
Project Name: IMHC WESTMEAD Project ID: 65688	Eurofins Analytical Services Manager : Andrew Black	

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ641754	Oct 22, 2024	7:00AM	Air	S24-Oc0054497	X
2	DJ641844	Oct 22, 2024	7:02AM	Air	S24-Oc0054498	X
3	DJ641888	Oct 22, 2024	7:04AM	Air	S24-Oc0054499	X
4	DJ641864	Oct 22, 2024	7:06AM	Air	S24-Oc0054500	X
5	DJ641857	Oct 22, 2024	7:08AM	Air	S24-Oc0054501	X
6	DJ641872	Oct 22, 2024	7:10AM	Air	S24-Oc0054502	X
7	DJ641900	Oct 22, 2024	7:13AM	Air	S24-Oc0054503	X
8	DJ641894	Oct 22, 2024	7:19AM	Air	S24-Oc0054504	X
9	DJ641875	Oct 22, 2024		Air	S24-Oc0054505	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	N/A
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Chamath JHM Annakkage Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

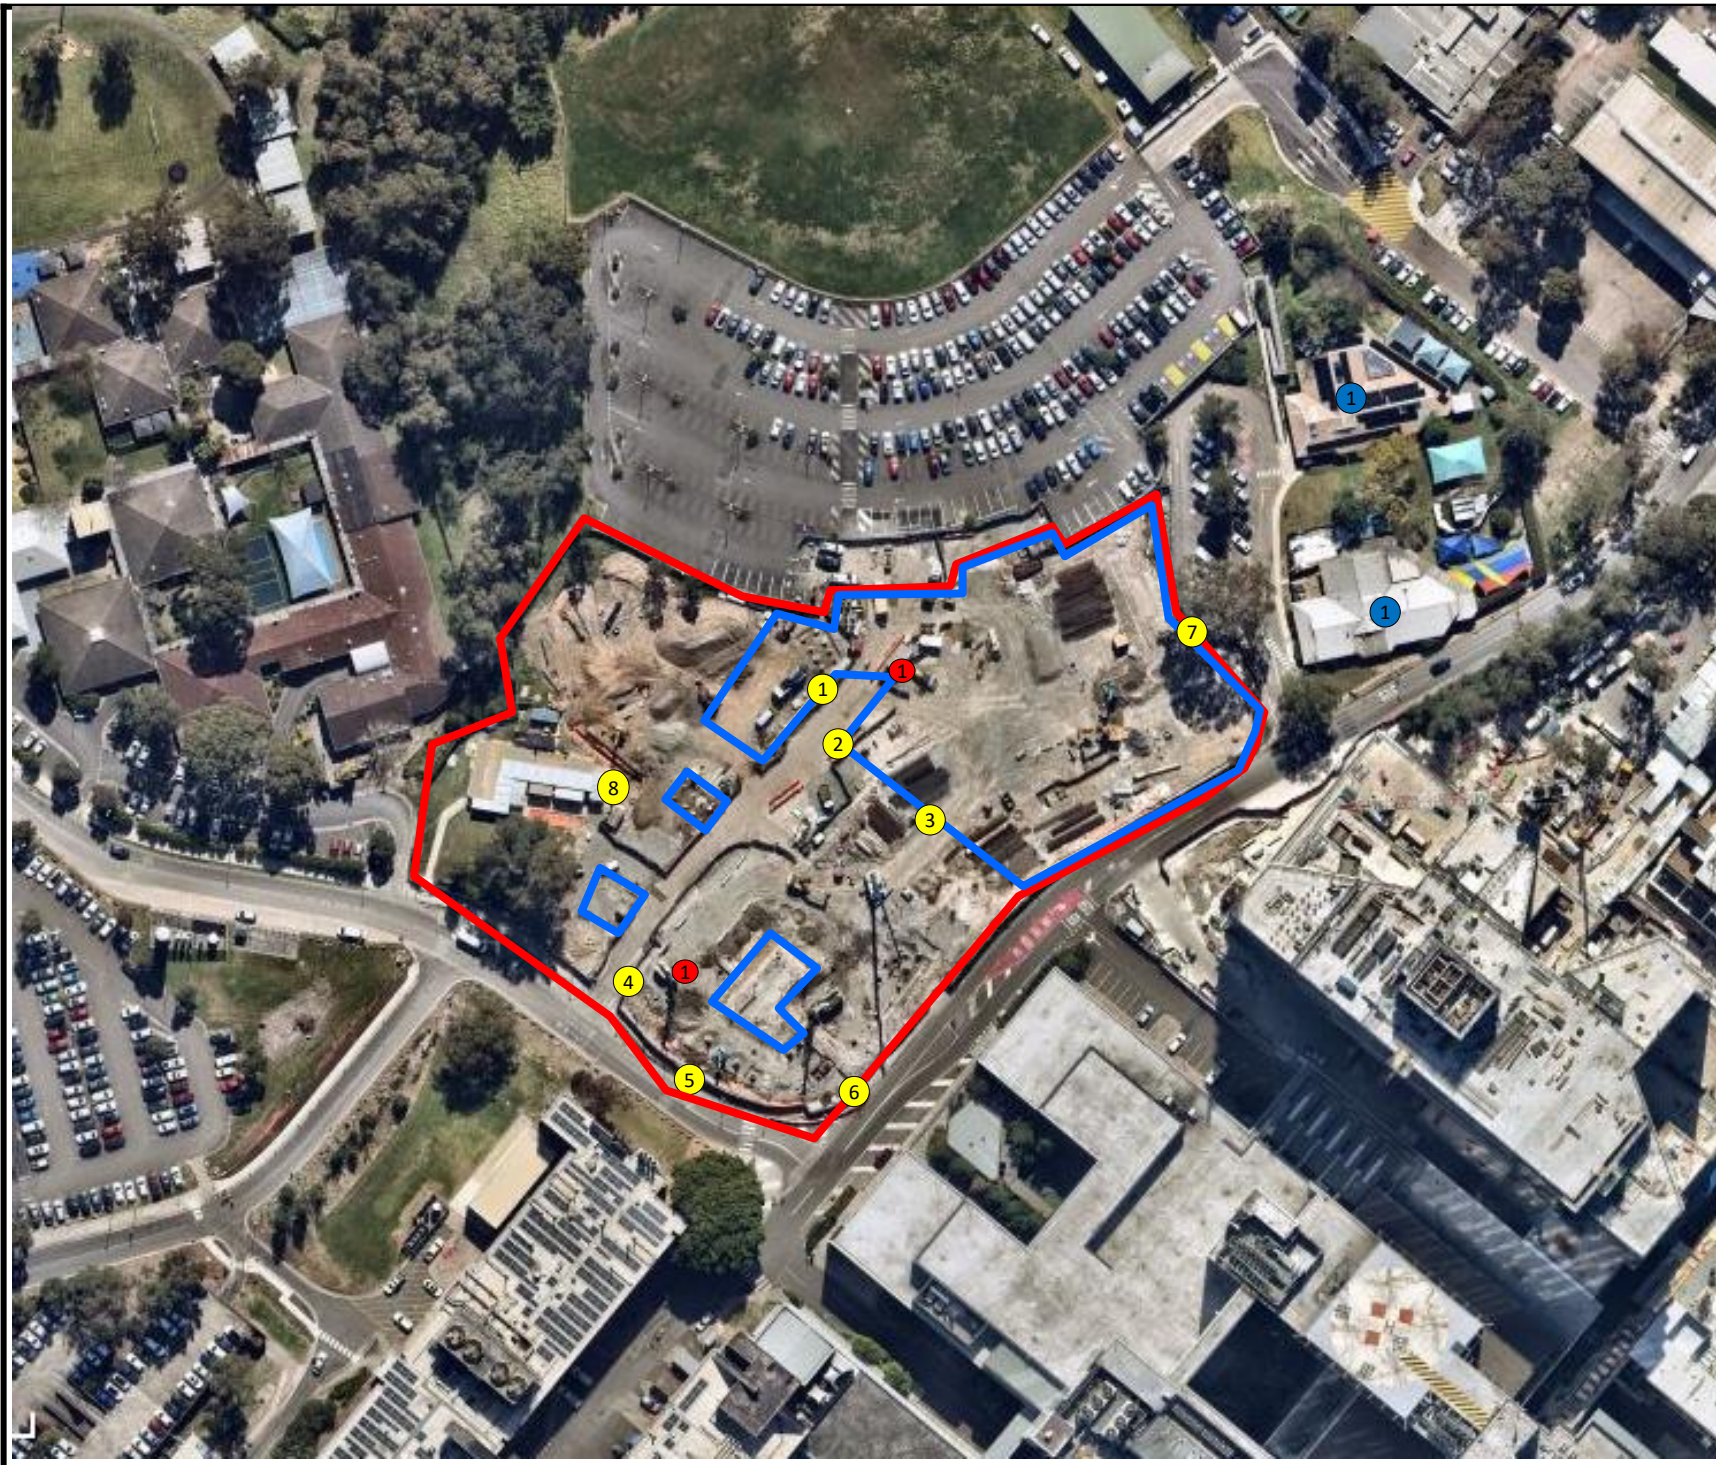

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- 1 Decontamination Unit
- 1 Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 15/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,295)

AMR296 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

24 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR296: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Wednesday 23 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1152172-AFC
Project Name IHMC WESTMEAD
Project ID 65686
Received Date Oct 23, 2024
Date Reported Oct 23, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IHMC WESTMEAD
Project ID 65686
Date Sampled Oct 23, 2024
Report 1152172-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0058457	DJ641883	AC152	LOC1: LP7, NE ADJ TO LP6 + P14	7:04	15:05	2.0	2.0	0/100	< 0.01
24-Oc0058458	DJ641863	AC200	LOC2: BIRSB, WEST ADJ TO P14	7:06	15:07	2.0	2.0	0/100	< 0.01
24-Oc0058459	DJ641876	AC248	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:08	15:09	2.0	2.0	0/100	< 0.01
24-Oc0058460	DJ641899	AC119	LOC4: BIRSB, SW ADJ TO P14 + LP9	7:10	15:11	2.0	2.0	0/100	< 0.01
24-Oc0058461	DJ641884	AC027	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:12	15:13	2.0	2.0	0/100	< 0.01
24-Oc0058462	DJ641886	AC257	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:14	15:15	2.0	2.0	0/100	< 0.01
24-Oc0058463	DJ641880	AC142	LOC7: BIRSB, EAST ADJ TO CCC	7:17	15:18	2.0	2.0	0/100	< 0.01
24-Oc0058464	DJ641878	AC035	LOC8: LP7, SW ADJ TO SITE SHED	7:22	15:21	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0058465	DJ641895	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 23, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L	Order No.:	Received: Oct 23, 2024 3:50 PM
Address: Level 1, 50 Margaret St Sydney NSW 2000	Report #: 1152172	Due: Oct 23, 2024
Project Name: IHMC WESTMEAD	Phone: 02 8245 0300	Priority: Same day
Project ID: 65686	Fax:	Contact Name: Milad Noujaim
Eurofins Analytical Services Manager : Andrew Black		

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ641883	Oct 23, 2024	3:05PM	Air	S24-Oc0058457	X
2	DJ641863	Oct 23, 2024	3:07PM	Air	S24-Oc0058458	X
3	DJ641876	Oct 23, 2024	3:09PM	Air	S24-Oc0058459	X
4	DJ641899	Oct 23, 2024	3:11PM	Air	S24-Oc0058460	X
5	DJ641884	Oct 23, 2024	3:13PM	Air	S24-Oc0058461	X
6	DJ641886	Oct 23, 2024	3:15PM	Air	S24-Oc0058462	X
7	DJ641880	Oct 23, 2024	3:18PM	Air	S24-Oc0058463	X
8	DJ641878	Oct 23, 2024	3:21PM	Air	S24-Oc0058464	X
9	DJ641895	Oct 23, 2024		Air	S24-Oc0058465	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	N/A
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Chamath JHM Annakkage Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

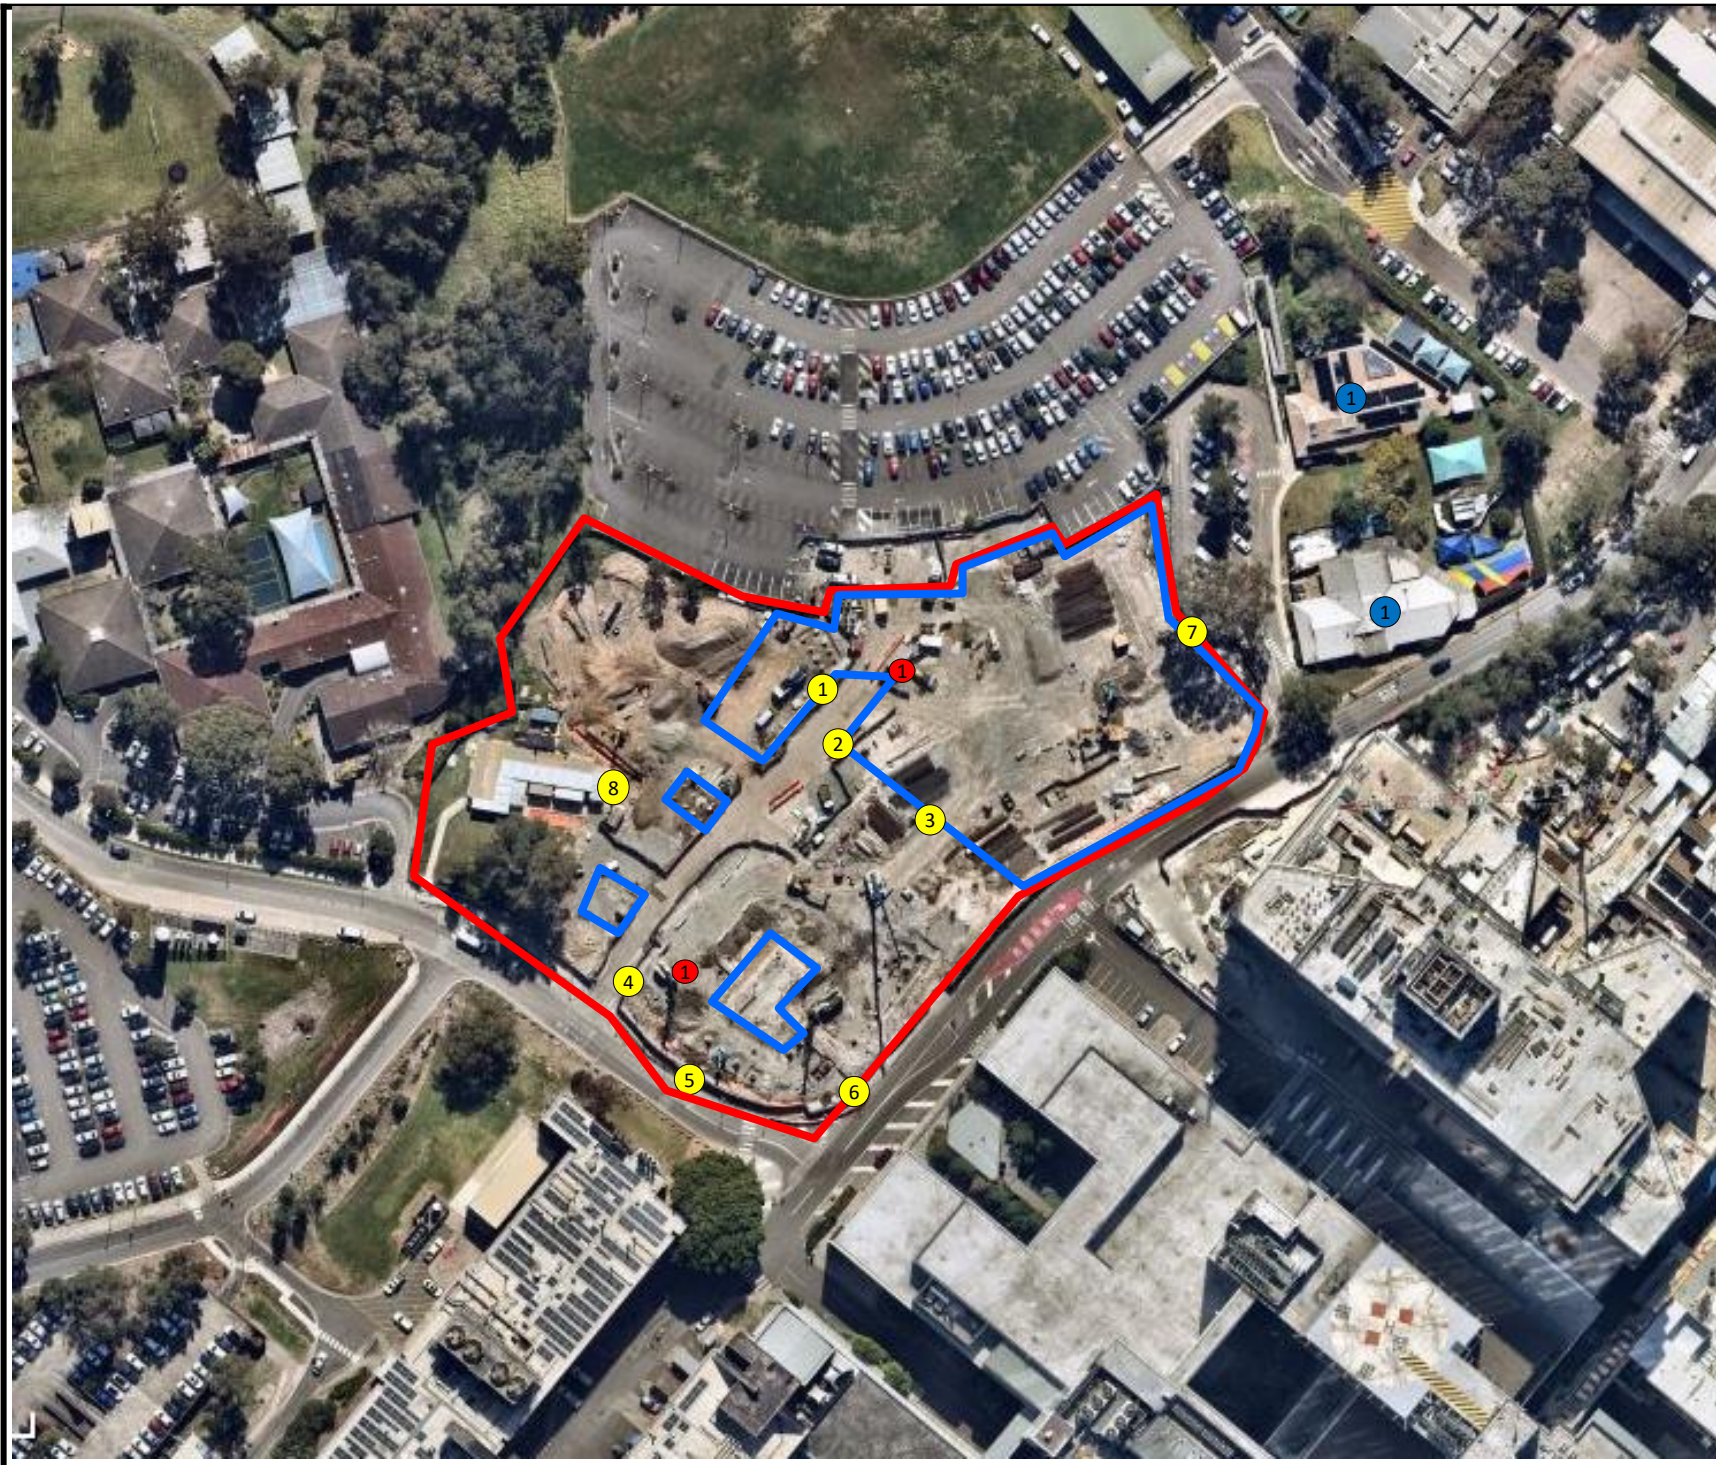

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 15/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,296)

AMR297 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

25 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR297: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Thursday 24 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 1, 50 Margaret St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1152726-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 24, 2024
Date Reported Oct 24, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition, [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 24, 2024
Report 1152726-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0063458	DJ641893	AC161	LOC1: LP7, NE ADJ TO LP6 + P14	7:02	15:03	2.0	2.0	0/100	< 0.01
24-Oc0063459	DJ641891	AC142	LOC2: BIRSB, WEST ADJ TO P14	7:04	15:05	2.0	2.0	0/100	< 0.01
24-Oc0063460	DJ641902	AC119	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:06	15:07	2.0	2.0	0/100	< 0.01
24-Oc0063461	DJ641879	AC257	LOC4: BIRSB, SW ADJ TO P14 + LP9	7:08	15:09	2.0	2.0	0/100	< 0.01
24-Oc0063462	DJ641874	AC027	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DR	7:10	15:11	2.0	2.0	0/100	< 0.01
24-Oc0063463	DJ641896	AC152	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:12	15:13	2.0	2.0	0/100	< 0.01
24-Oc0063464	DJ641882	AC248	LOC7: BIRSB, EAST ADJ TO CCC	7:15	15:16	2.0	2.0	0/100	< 0.01
24-Oc0063465	DJ641897	AC035	LOC8: LP7, SW ADJ TO SITE SHED	7:20	15:19	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0063466	DJ641898	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 24, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	--	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 1, 50 Margaret St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1152726
Phone: 02 8245 0300
Fax:

Received: Oct 24, 2024 3:55 PM
Due: Oct 24, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ641893	Oct 24, 2024	3:03PM	Air	S24-Oc0063458	X
2	DJ641891	Oct 24, 2024	3:05PM	Air	S24-Oc0063459	X
3	DJ641902	Oct 24, 2024	3:07PM	Air	S24-Oc0063460	X
4	DJ641879	Oct 24, 2024	3:09PM	Air	S24-Oc0063461	X
5	DJ641874	Oct 24, 2024	3:11PM	Air	S24-Oc0063462	X
6	DJ641896	Oct 24, 2024	3:13PM	Air	S24-Oc0063463	X
7	DJ641882	Oct 24, 2024	3:16PM	Air	S24-Oc0063464	X
8	DJ641897	Oct 24, 2024	3:19PM	Air	S24-Oc0063465	X
9	DJ641898	Oct 24, 2024		Air	S24-Oc0063466	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Chamath JHM Annakkage Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

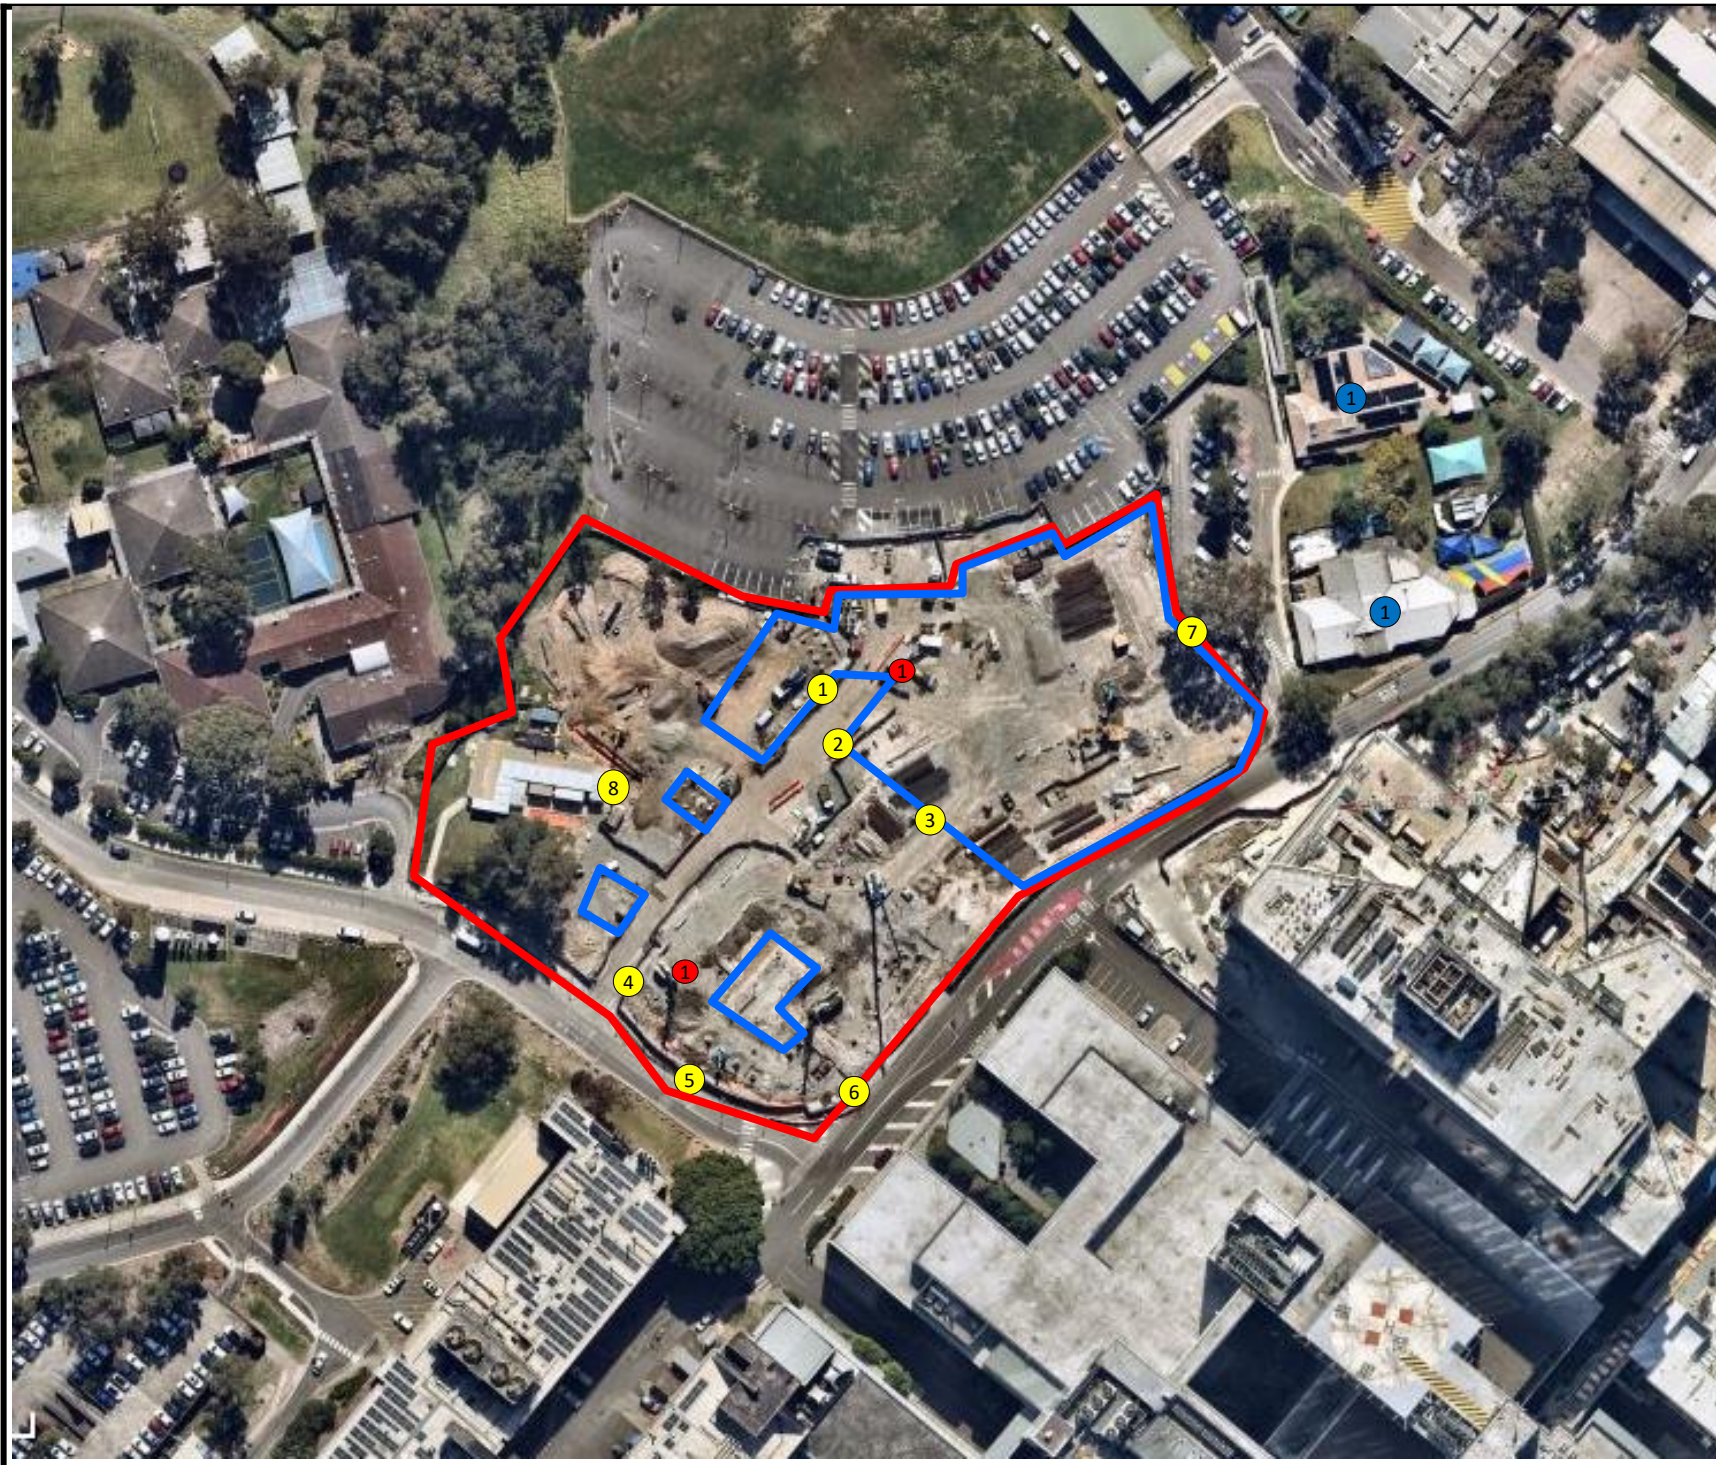

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- Asbestos Air Monitoring Pumps
- Decontamination Unit
- Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 15/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,297)

AMR298 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

28 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR298: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Friday 25 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 8, 179 Elizabeth St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1153251-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 25, 2024
Date Reported Oct 25, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 25, 2024
Report 1153251-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0067074	DJ634018	AC027	LOC1: LP7, NE ADJ TO LP6 & P14	7:01	15:00	2.0	2.0	0/100	< 0.01
24-Oc0067075	DJ634038	AC257	LOC2: BIRSB, WEST ADJ TO P14	7:03	15:02	2.0	2.0	0/100	< 0.01
24-Oc0067076	DJ634029	AC142	LOC3: BIRSB, CENTRE OPPOSITE TO RETAINING WALL	7:05	15:04	2.0	2.0	0/100	< 0.01
24-Oc0067077	DJ634043	AC117	LOC4: BIRSB, SW ADJ TO P14 & LP9	7:07	15:06	2.0	2.0	0/100	< 0.01
24-Oc0067078	DJ634015	AC161	LOC5: BIRSB, SOUTH ADJ TO DRAGONFLY DRIVE	7:09	15:08	2.0	2.0	0/100	< 0.01
24-Oc0067079	DJ634046	AC248	LOC6: BIRSB, SOUTH ADJ TO REDBANK RD	7:11	15:10	2.0	2.0	0/100	< 0.01
24-Oc0067080	DJ634033	AC152	LOC7: BIRSB, EAST ADJ TO TO CCC CARPARK	7:14	15:13	2.0	2.0	0/100	< 0.01
24-Oc0067081	DJ634051	AC035	LOC8: FENCE ADJ TO SITE OFFICE	7:18	15:16	2.0	2.0	0/100	< 0.01

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0067082	DJ634021	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 25, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	--	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L	Order No.:	Received: Oct 25, 2024 4:05 PM
Address: Level 8, 179 Elizabeth St Sydney NSW 2000	Report #: 1153251	Due: Oct 25, 2024
	Phone: 02 8245 0300	Priority: Same day
	Fax:	Contact Name: Milad Noujaim
Project Name: IMHC WESTMEAD	Eurofins Analytical Services Manager : Andrew Black	
Project ID: 65686		

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ634018	Oct 25, 2024	7:01AM	Air	S24-Oc0067074	X
2	DJ634038	Oct 25, 2024	7:03AM	Air	S24-Oc0067075	X
3	DJ634029	Oct 25, 2024	7:05AM	Air	S24-Oc0067076	X
4	DJ634043	Oct 25, 2024	7:07AM	Air	S24-Oc0067077	X
5	DJ634015	Oct 25, 2024	7:09AM	Air	S24-Oc0067078	X
6	DJ634046	Oct 25, 2024	7:11AM	Air	S24-Oc0067079	X
7	DJ634033	Oct 25, 2024	7:14AM	Air	S24-Oc0067080	X
8	DJ634051	Oct 25, 2024	7:18AM	Air	S24-Oc0067081	X
9	DJ634021	Oct 25, 2024		Air	S24-Oc0067082	X
Test Counts						9

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos

Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 *Appendix 2*, else assumed to be 15% in accordance with WA DOH *Appendix 2 (PA)*. This estimate is not NATA-accredited.

ACM

Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.

AF

Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".

AFM

Airborne Fibre Monitoring, e.g., by the MFM.

Amosite

Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.

AS

Australian Standard.

Asbestos Content (as asbestos) Total %w/w asbestos content in asbestos-containing finds in a soil sample (**% w/w**).

Chrysotile

Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

COC

Chain of Custody.

Crocidolite

Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Dry

Sample is dried by heating prior to analysis.

DS

Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.

FA

Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.

Fibre Count

Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003

Fibre ID

Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.

Friable

Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.

HSG248

UK HSE HSG248, *Asbestos: The Analysts Guide*, 2nd Edition (2021), ISBN: 9780616667079.

HSG264

UK HSE HSG264, *Asbestos: The Survey Guide* (2012), ISBN: 9780717665020

ISO (also ISO/IEC)

International Organization for Standardization / International Electrotechnical Commission.

K Factor

Microscope constant (**K**) as derived from the effective filter area of the given AFM membrane used for collecting the sample (**A**) and the projected eyepiece graticule area of the specific microscope used for the analysis (**a**).

LOR

Limit of Reporting.

MFM (also NOHSC:3003)

Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres*, 2nd Edition [NOHSC:3003(2005)].

MMVF

Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).

NEPM (also ASC NEPM)

National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).

Organic

Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

PCM

Phase Contrast Microscopy. This is used for fibre counting according to the MFM.

PLM

Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Sampling

Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.

SRA

Sample Receipt Advice.

Trace Analysis

An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.

UK HSE HSG

United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.

UMF

Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.

WA DOH

Reference document for the NEPM. Government of Western Australia, *Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia* (updated 2021), including Appendix Four: *Laboratory analysis*

Weighted Average

Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (**%_{WA}**).

Comments

Volume Measurement : MILAD NOUJAIM, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Laxman Dias Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

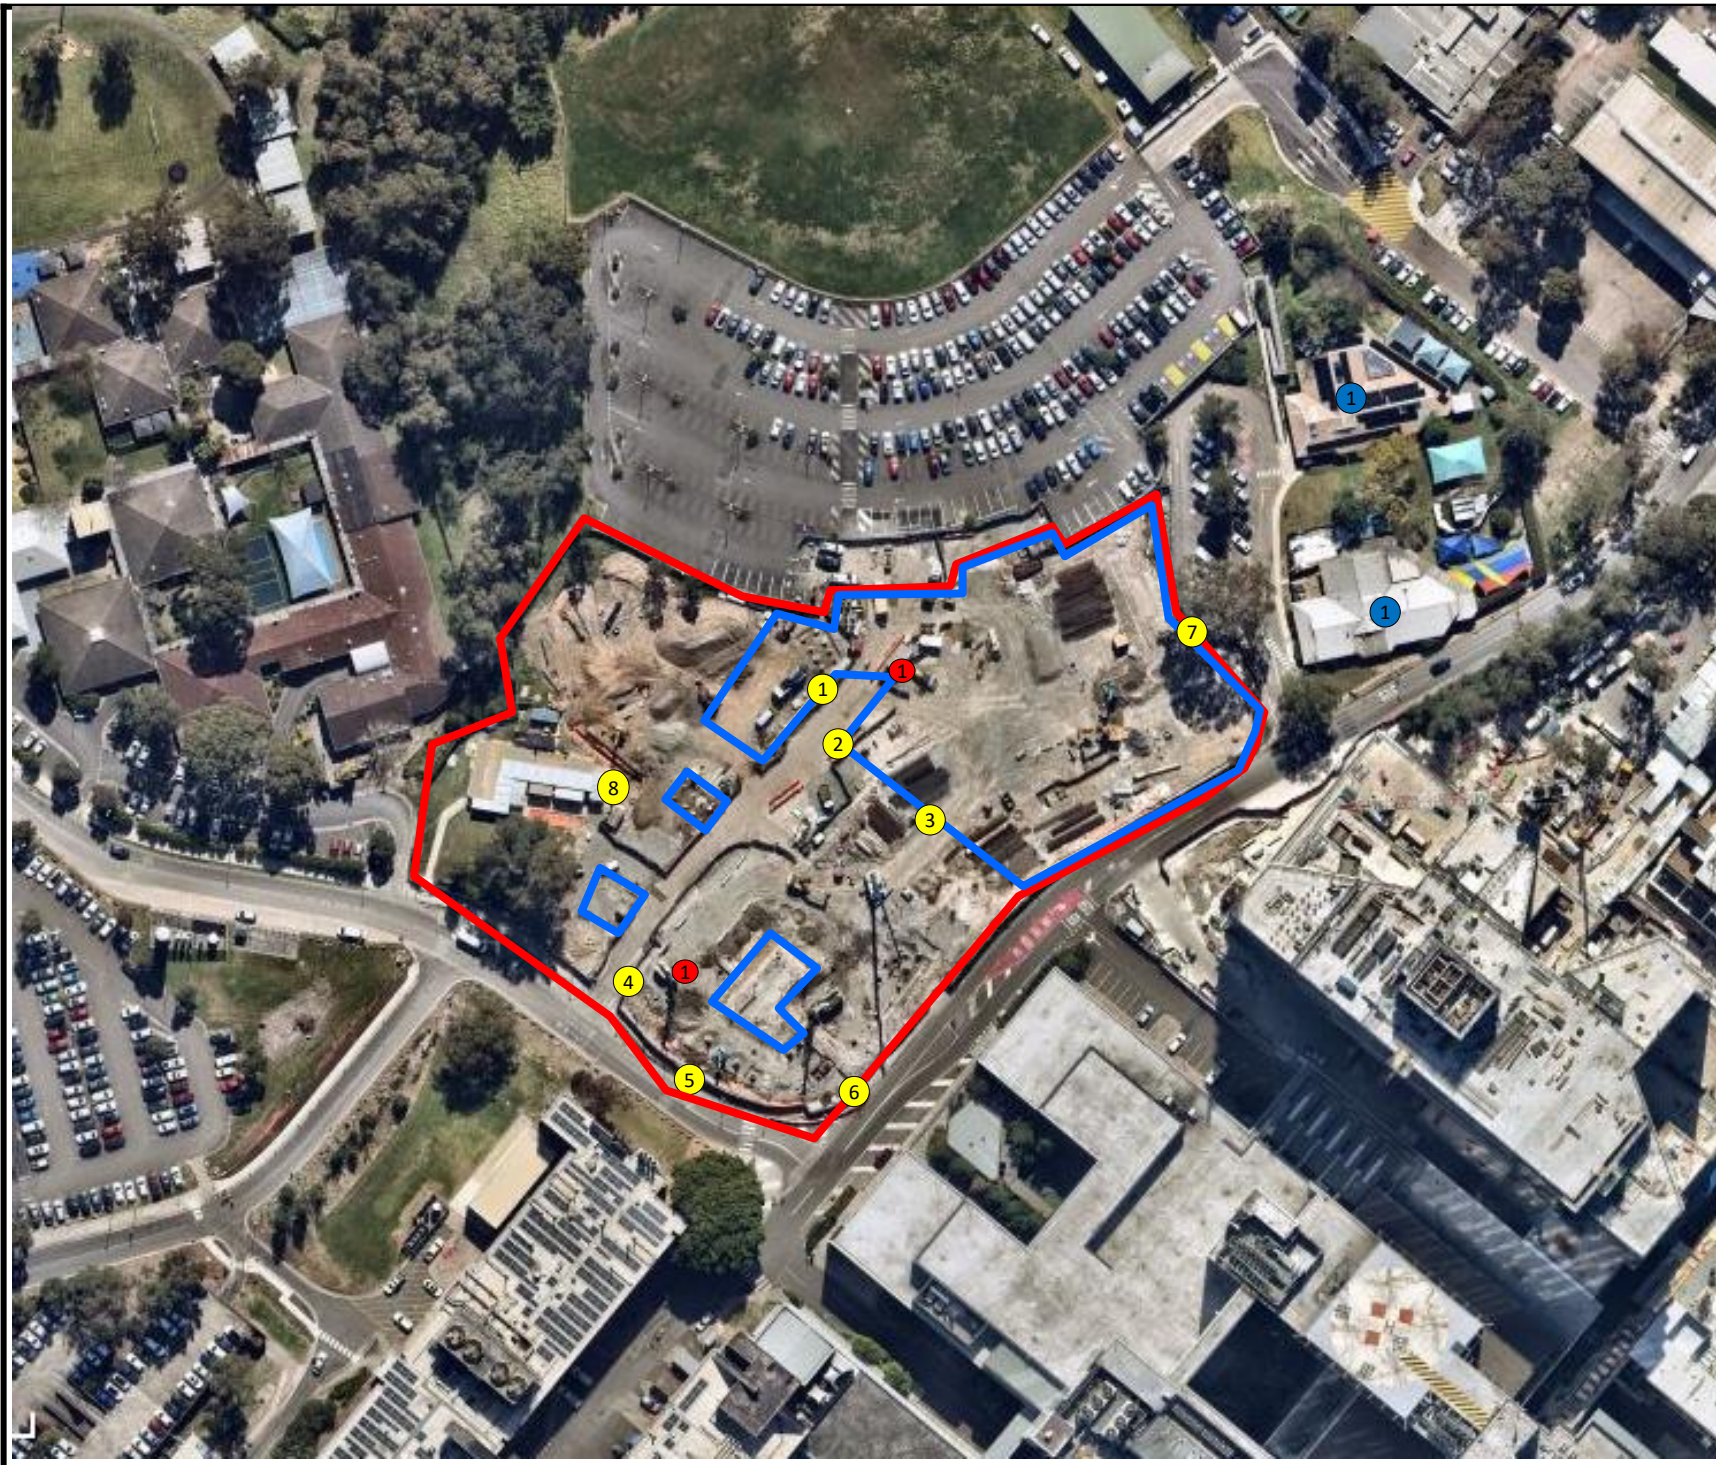

- Legend:**
- Approximate Site Boundary
 - Approximate Exclusion Zone
 - Asbestos Air Monitoring Pumps
 - ① Decontamination Unit
 - ① Childcare Centre



Job No: 65686	
Client: Cherrie Civil Engineering Pty Ltd	
Version: Rev A	Date: 15/10/2024
Drawn By: DED	Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,298)

AMR299 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

29 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR299: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Monday 28 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 8, 179 Elizabeth St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1153776-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 28, 2024
Date Reported Oct 28, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 28, 2024
Report 1153776-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0071637	DJ240488	AC161	LOC1: LP7, NE ADJ TO LP14 + P6	7:21	15:14	2.0	2.0	0/100	< 0.01
24-Oc0071638	DJ240793	AC035	LOC2: BIRSB, WEST ADJ TO P14	7:23	15:16	2.0	2.0	0/100	< 0.01
24-Oc0071639	DJ240458	AC119	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:25	15:18	2.0	2.0	0/100	< 0.01
24-Oc0071640	DJ240756	AC142	LOC4: BIRSB, EAST ADJ TO CCC	7:28	15:21	2.0	2.0	0/100	< 0.01
24-Oc0071641	DJ240484	AC027	LOC5: LP7, SW ADJ TO SIDE SHED	7:35	15:25	2.0	2.0	0/100	< 0.01
24-Oc0071642	DJ240604	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 28, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 8, 179 Elizabeth St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1153776
Phone: 02 8245 0300
Fax:

Received: Oct 28, 2024 3:55 PM
Due: Oct 28, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ240488	Oct 28, 2024	7:21AM	Air	S24-Oc0071637	X
2	DJ240793	Oct 28, 2024	7:23AM	Air	S24-Oc0071638	X
3	DJ240458	Oct 28, 2024	7:25AM	Air	S24-Oc0071639	X
4	DJ240756	Oct 28, 2024	7:28AM	Air	S24-Oc0071640	X
5	DJ240484	Oct 28, 2024	7:35AM	Air	S24-Oc0071641	X
6	DJ240604	Oct 28, 2024		Air	S24-Oc0071642	X
Test Counts						6

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : DAVID EDWARDS-DAVIS, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Chamath JHM Annakkage Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

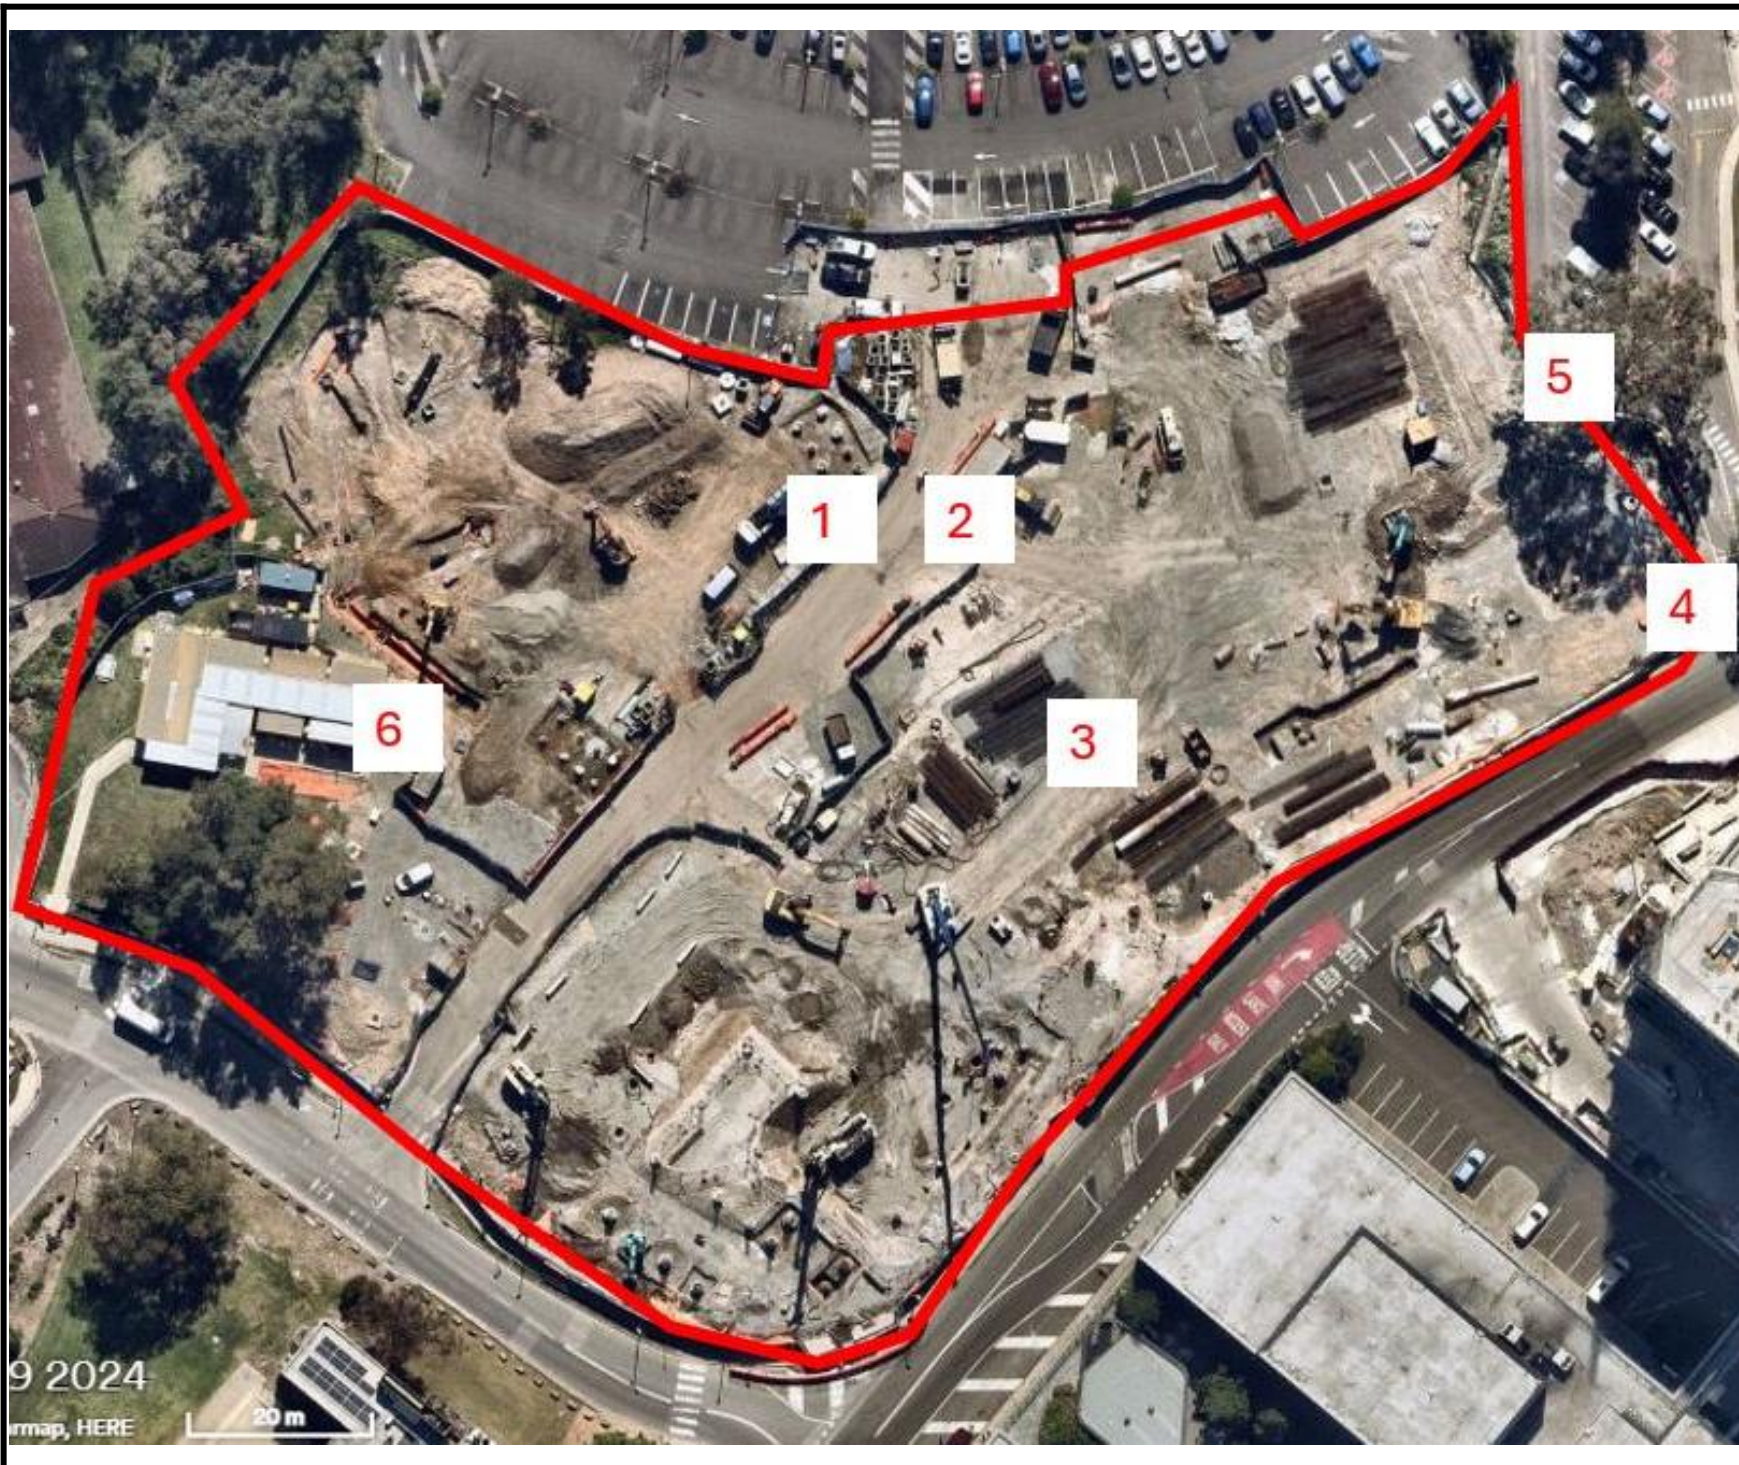

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A	Date: 28/10/2024
Drawn By: DED	Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,299)

AMR300 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

30 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR300: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Tuesday 29 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 8, 179 Elizabeth St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1154254-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 29, 2024
Date Reported Oct 29, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 29, 2024
Report 1154254-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0076100	DJ288525	AC152	LOC1: LP7, NE ADJ P14 + P6	7:21	15:03	2.0	2.0	0/100	< 0.01
24-Oc0076101	DJ288524	AC027	LOC2: BIRSB, WEST ADJ TO P14	7:23	15:05	2.0	2.0	0/100	< 0.01
24-Oc0076102	DJ288987	AC142	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:25	15:07	2.0	2.0	0/100	< 0.01
24-Oc0076103	DJ288523	AC119	LOC4: BIRSB, REDBANK RD CORNER CCC CARPARK	7:27	15:10	2.0	2.0	0/100	< 0.01
24-Oc0076104	DJ288989	AC035	LOC5: BIRSB, EAST ADJ CCC	7:30	15:12	2.0	2.0	0/100	< 0.01
24-Oc0076105	DJ288991	AC161	LOC6: LP7, SW ADJ SITE SHEDS	7:35	15:16	2.0	2.0	0/100	< 0.01
24-Oc0076106	DJ289007	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 29, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 8, 179 Elizabeth St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1154254
Phone: 02 8245 0300
Fax:

Received: Oct 29, 2024 3:58 PM
Due: Oct 29, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ288525	Oct 29, 2024	7:21AM	Air	S24-Oc0076100	X
2	DJ288524	Oct 29, 2024	7:23AM	Air	S24-Oc0076101	X
3	DJ288987	Oct 29, 2024	7:25AM	Air	S24-Oc0076102	X
4	DJ288523	Oct 29, 2024	7:27AM	Air	S24-Oc0076103	X
5	DJ288989	Oct 29, 2024	7:30AM	Air	S24-Oc0076104	X
6	DJ288991	Oct 29, 2024	7:35AM	Air	S24-Oc0076105	X
7	DJ289007	Oct 29, 2024		Air	S24-Oc0076106	X
Test Counts						7

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

Comments

Volume Measurement : DAVID EDWARDS-DAVIS, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Chamath JHM Annakkage Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

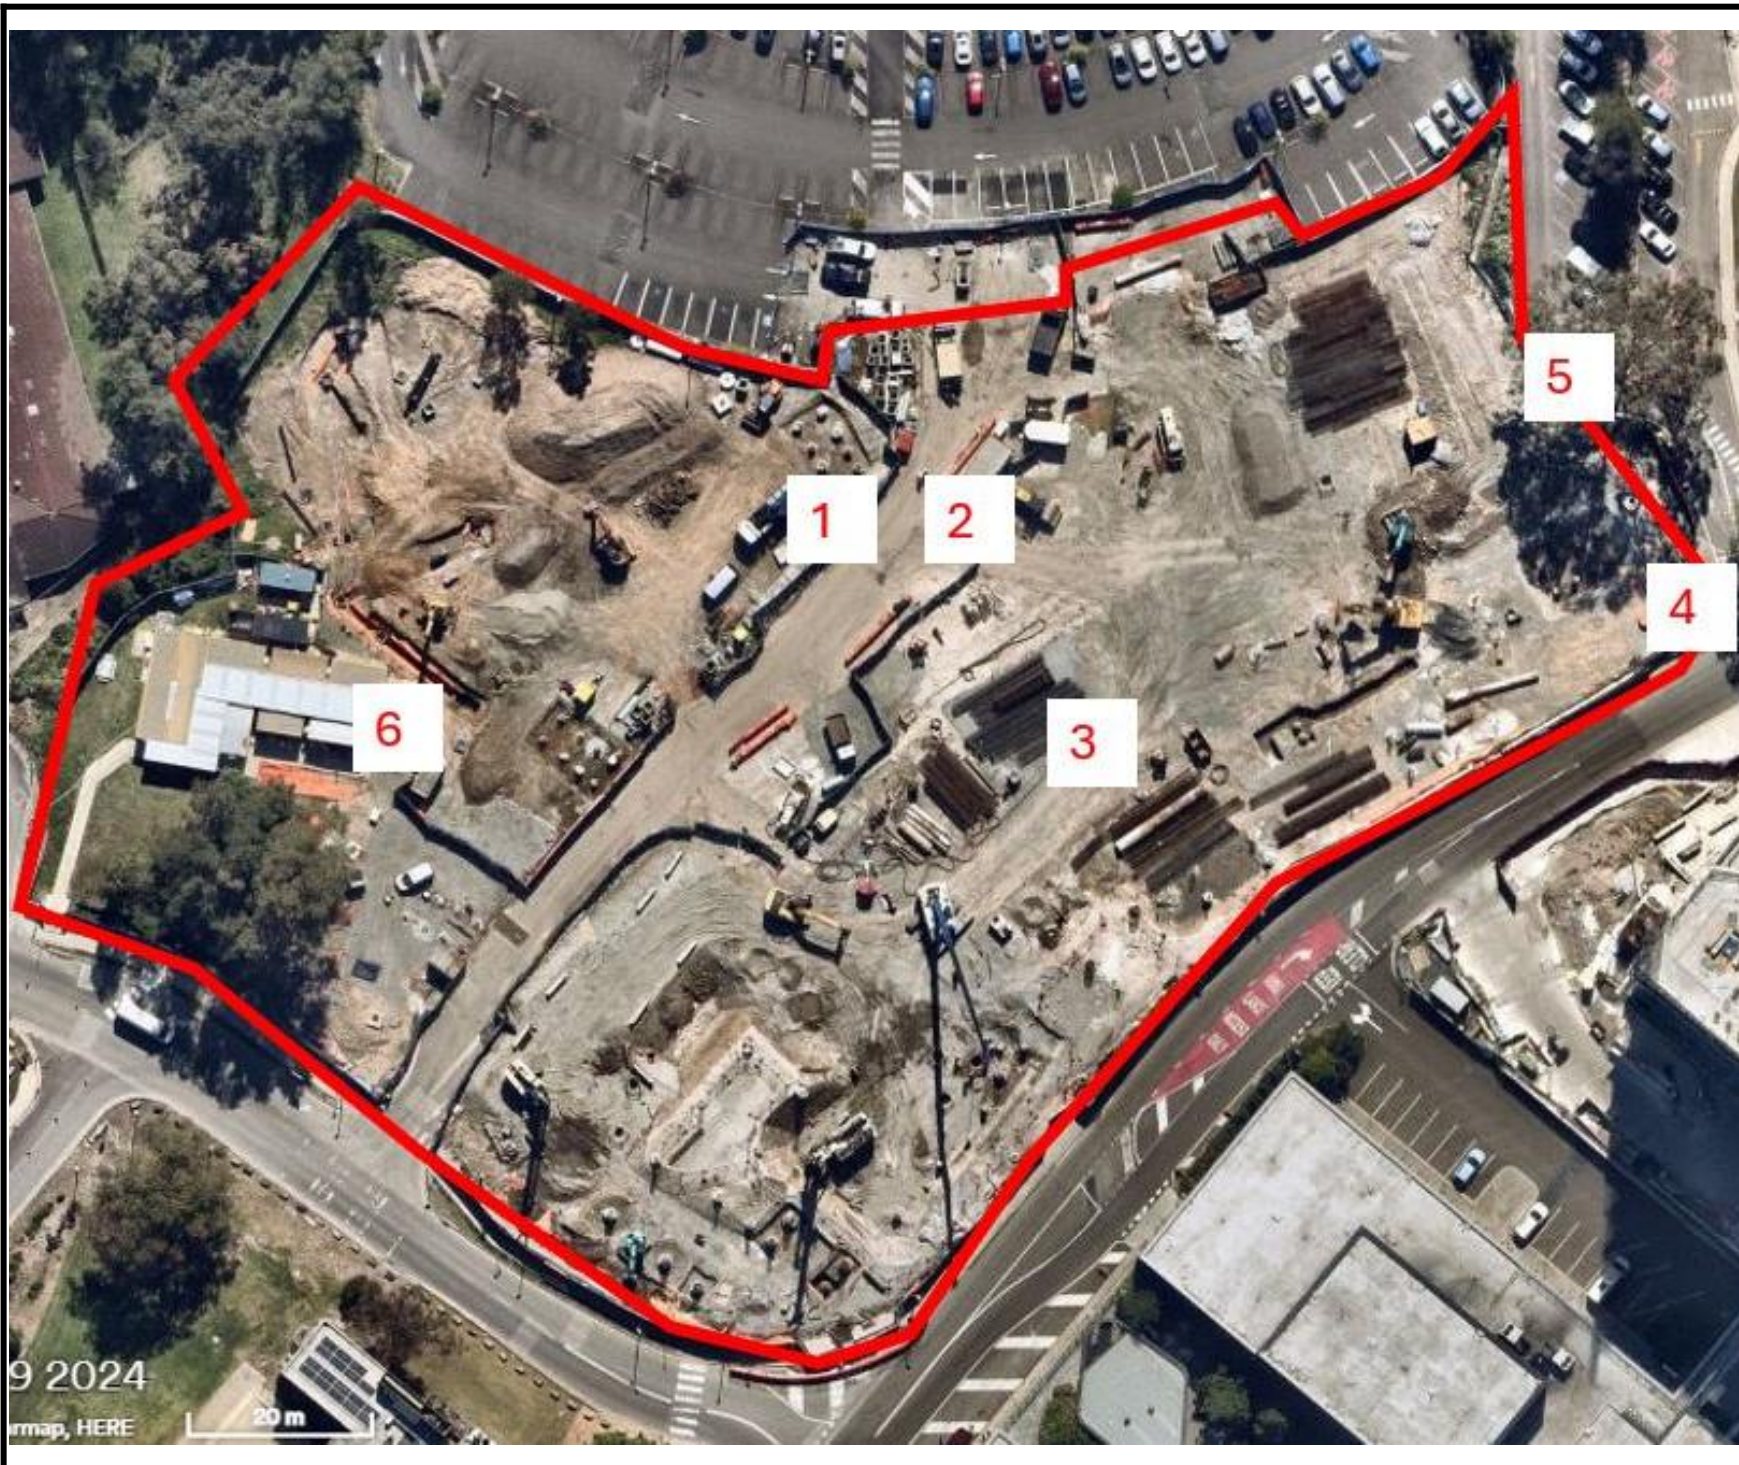

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A	Date: 28/10/2024
Drawn By: DED	Checked By: JP



IMHC Westmead

FIGURE 1

9 2024
 map, HERE 20 m

JBS&G (65686 – 163,300)

AMR301 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

31 October 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR301: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Wednesday 30 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 8, 179 Elizabeth St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1154738-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 30, 2024
Date Reported Oct 30, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 30, 2024
Report 1154738-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0080681	DI482584	AC119	LOC1: LP7, NE ADJ TO LP6 + P14	7:00	15:04	2.0	2.0	0/100	< 0.01
24-Oc0080682	DI482522	AC035	LOC2: BIRSB, WEST ADJ TO P14	7:02	15:06	2.0	2.0	0/100	< 0.01
24-Oc0080683	DI482573	AC161	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:04	15:08	2.0	2.0	0/100	< 0.01
24-Oc0080684	DI482578	AC152	LOC4: BIRSB, REDBANK RD COIRNER CCC CAR PARK	7:07	15:11	2.0	2.0	0/100	< 0.01
24-Oc0080685	DI482582	AC142	LOC5: BRISB, EAST ADJ TO CCC	7:09	15:13	2.0	2.0	0/100	< 0.01
24-Oc0080686	DI482570	AC027	LOC5: LP7, SW ADJ TO SIDE SHED	7:13	15:16	2.0	2.0	0/100	< 0.01
24-Oc0080687	DI482521	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 30, 2024	Indefinite

web: www.eurofins.com.au
email: EnviroSales@eurofins.com

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L	Order No.:	Received: Oct 30, 2024 3:45 PM
Address: Level 8, 179 Elizabeth St Sydney NSW 2000	Report #: 1154738	Due: Oct 30, 2024
	Phone: 02 8245 0300	Priority: Same day
	Fax:	Contact Name: Milad Noujaim
Project Name: IMHC WESTMEAD	Eurofins Analytical Services Manager : Andrew Black	
Project ID: 65686		

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DI482584	Oct 30, 2024	3:04PM	Air	S24-Oc0080681	X
2	DI482522	Oct 30, 2024	3:06PM	Air	S24-Oc0080682	X
3	DI482573	Oct 30, 2024	3:08PM	Air	S24-Oc0080683	X
4	DI482578	Oct 30, 2024	3:11PM	Air	S24-Oc0080684	X
5	DI482582	Oct 30, 2024	3:13PM	Air	S24-Oc0080685	X
6	DI482570	Oct 30, 2024	3:16PM	Air	S24-Oc0080686	X
7	DI482521	Oct 30, 2024		Air	S24-Oc0080687	X
Test Counts						7

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$


Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos	Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 <i>Appendix 2</i> , else assumed to be 15% in accordance with WA DOH <i>Appendix 2 (PA)</i> . This estimate is not NATA-accredited.
ACM	Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.
AF	Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".
AFM	Airborne Fibre Monitoring, e.g., by the MFM.
Amosite	Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.
AS	Australian Standard.
Asbestos Content (as asbestos)	Total %w/w asbestos content in asbestos-containing finds in a soil sample (% w/w).
Chrysotile	Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
COC	Chain of Custody.
Crocidolite	Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Dry	Sample is dried by heating prior to analysis.
DS	Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.
FA	Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.
Fibre Count	Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003
Fibre ID	Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.
Friable	Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.
HSG248	UK HSE HSG248, <i>Asbestos: The Analysts Guide</i> , 2 nd Edition (2021), ISBN: 9780616667079.
HSG264	UK HSE HSG264, <i>Asbestos: The Survey Guide</i> (2012), ISBN: 9780717665020
ISO (also ISO/IEC)	International Organization for Standardization / International Electrotechnical Commission.
K Factor	Microscope constant (K) as derived from the effective filter area of the given AFM membrane used for collecting the sample (A) and the projected eyepiece graticule area of the specific microscope used for the analysis (a).
LOR	Limit of Reporting.
MFM (also NOHSC:3003)	Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, <i>Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres</i> , 2nd Edition [NOHSC:3003(2005)].
MMVF	Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).
NEPM (also ASC NEPM)	National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).
Organic	Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
PCM	Phase Contrast Microscopy. This is used for fibre counting according to the MFM.
PLM	Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..
Sampling	Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.
SRA	Sample Receipt Advice.
Trace Analysis	An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.
UK HSE HSG	United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.
UMF	Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.
WA DOH	Reference document for the NEPM. Government of Western Australia, <i>Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia</i> (updated 2021), including Appendix Four: <i>Laboratory analysis</i>
Weighted Average	Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (%_{WA}).

2 Daily Sample Locations

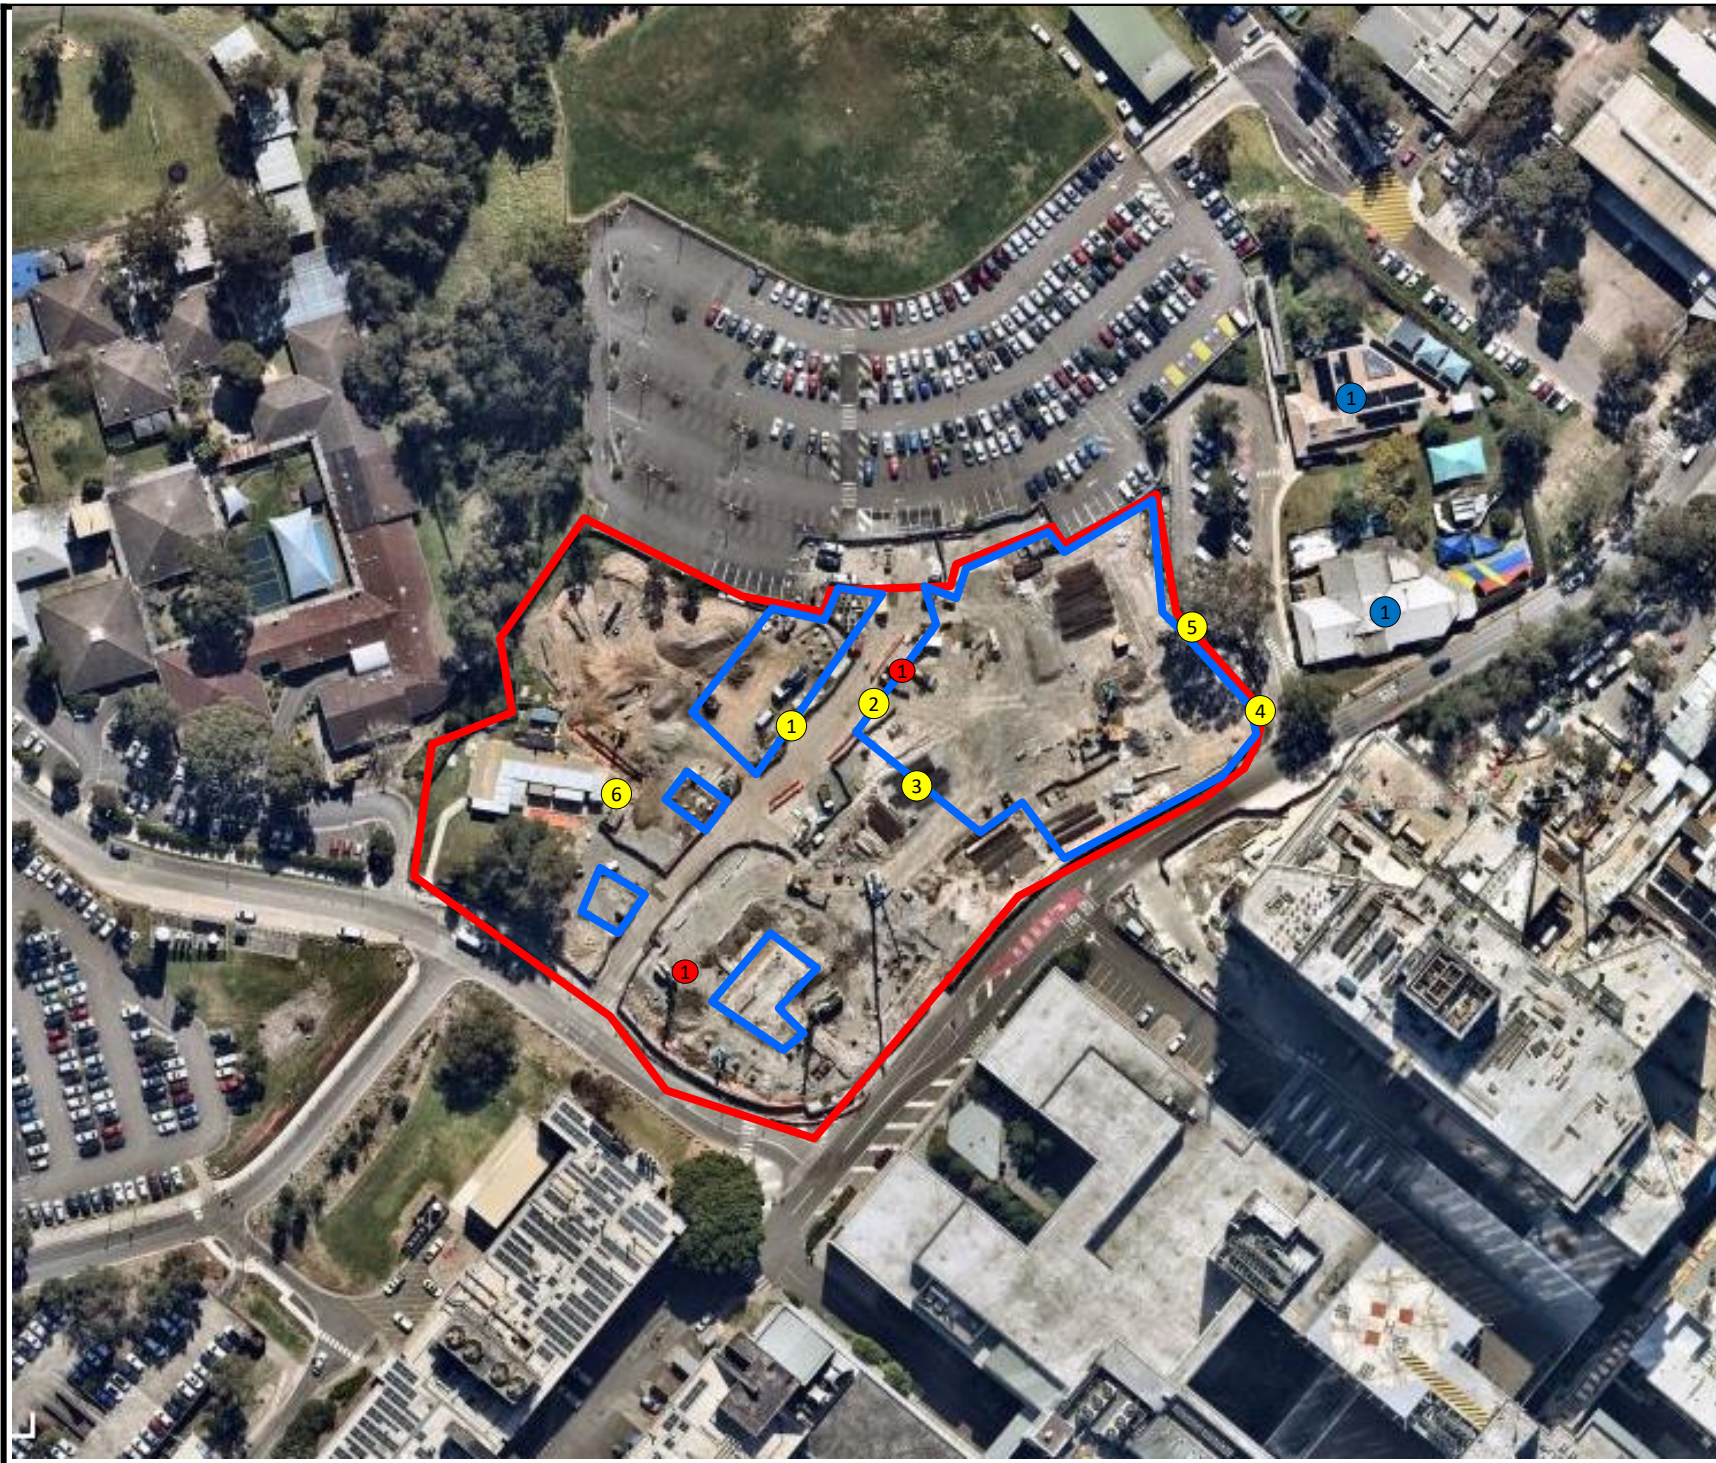

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- Asbestos Air Monitoring Pumps
- Decontamination Unit
- Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 30/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1

JBS&G (65686 – 163,301)

AMR302 Airborne Asbestos Fibre Monitoring Report, Westmead IMHC (Rev 0)

1 November 2024

Taariq Van Heerden
Cherrie Civil Engineering Pty Ltd
Via email: taariq@cherriecivil.com.au

**AMR302: Airborne Asbestos Fibre Monitoring Report
Westmead Integrated Mental Health Complex (IMHC) Redevelopment Project**

Dear Taariq,

Please find as **Attachment 1**, the airborne asbestos fibre monitoring results for works associated with the Westmead Integrated Mental Health Complex (IMHC) redevelopment project within the Westmead Hospital Precinct, located at the corner of Redbank Road and Dragonfly Drive, Westmead NSW (the site) on **Thursday 31 October 2024**. Daily sample locations are shown in **Attachment 2**.


All air monitoring was completed in accordance with the *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres* [NOHSC: 3003(2005)], with NATA certification applying to all sample collection, handling, and analytical procedures.

All reported results were satisfactory and conform with the minimum action level of 0.01 fibres /mL for control monitoring as outlined in:

- Work, Health and Safety (2017) Regulation; and
- Safework NSW (2022) Code of Practice – *How to Safely Remove Asbestos*.

If you have any questions regarding these results, please feel free to contact the undersigned on 02 8245 0300 or by email mnoujaim@jbsg.com.au.

Yours sincerely:



Milad Noujaim
Environmental Consultant
SafeWork NSW Licensed Asbestos Assessor (LAA 002002)
JBS&G Australia Pty Ltd

1 Asbestos Air Monitoring Results

JBS & G Australia (NSW) P/L
Level 8, 179 Elizabeth St
Sydney
NSW 2000



NATA Accredited
Accreditation Number 1261
Site Number 18217

Accredited for compliance with ISO/IEC 17025-Testing
NATA is a signatory to the ILAC Mutual Recognition
Arrangement for the mutual recognition of the
equivalence of testing, medical testing, calibration,
inspection, proficiency testing scheme providers and
reference materials producers reports and certificates.

Attention: Milad Noujaim
Report 1155194-AFC
Project Name IMHC WESTMEAD
Project ID 65686
Received Date Oct 31, 2024
Date Reported Oct 31, 2024

METHODOLOGY:

Asbestos Sampling Sampling as per the National Occupational Health & Safety Commission – Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] and the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022.

Pump Calibration Air sampling pump performance has been assessed in accordance with Australian Institute of Occupational Hygiene (AIOH) Technical Paper Air Sampling Pumps: Equipment Calibration Requirements. Pump flow rate measurement equipment (e.g. Field Rotameter) has been calibrated in accordance with AIOH Technical Paper Flow Measurement Equipment: Calibration Requirements.

Asbestos Counting Fibre counting is conducted in accordance with the National Occupational Health & Safety Commission Guidance Note on the Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition , [NOHSC:3003(2005)] (MFM) and supplementary work instruction in-house LTM-ASB-8010. Unless specifically noted, analysis is undertaken by approved analysts at the base facility. Fibre counts (Fibres/fields) are covered by the facility's NATA scope of accreditation. The requirements of the NATA Specific Accreditation Criteria, ISO/IEC 17025 Application Document Life Sciences – Annex, Asbestos sampling and testing, Issued: March 2022 are realised.

Project Name IMHC WESTMEAD
Project ID 65686
Date Sampled Oct 31, 2024
Report 1155194-AFC

Eurofins Sample No.	Client Sample ID	Pump ID	Location	Start (time)	End (time)	Start Flow Rate (L/min)	End Flow Rate (L/min)	Result (Fibres/Fields)	Result (Fibres/mL)
24-Oc0084777	DJ633957	AC257	LOC1: LP7, NE ADJ TO LP14 + P6	7:05	15:08	2.0	2.0	0/100	< 0.01
24-Oc0084778	DJ634016	AC152	LOC2: BIRSB, WEST ADJ TO P14	7:07	15:10	2.0	2.0	0/100	< 0.01
24-Oc0084779	DJ634019	AC142	LOC3: BIRSB, CENTRE OPPOSITE RETAINING WALL	7:09	15:12	2.0	2.0	0/100	< 0.01
24-Oc0084780	DJ633995	AC161	LOC4: BIRSB, REDBANK RD CORNER CCC CARPARK	7:12	15:15	2.0	2.0	0/100	< 0.01
24-Oc0084781	DJ634037	AC119	LOC5: BIRSB, EAST ADJ CCC	7:14	15:17	2.0	2.0	0/100	< 0.01
24-Oc0084782	DJ634124	AC035	LOC6: LP7, SW ADJ TO SIDE SHED	7:17	15:19	2.0	2.0	0/100	< 0.01
24-Oc0084783	DJ633960	BLANK	BLANK	--	--	--	--	0/100	--

Sample History

Where samples are submitted/analysed over several days, the last date of extraction is reported.

If the date and time of sampling are not provided, the Laboratory will not be responsible for compromised results should testing be performed outside the recommended holding time.

Description	Testing Site	Extracted	Holding Time
Asbestos - LTM-ASB-8010	Sydney	Oct 31, 2024	Indefinite

Melbourne 6 Monterey Road Dandenong South VIC 3175 +61 3 8564 5000 NATA# 1261 Site# 1254	Geelong 19/8 Lewalan Street Grovedale VIC 3216 +61 3 8564 5000 NATA# 1261 Site# 25403	Sydney 179 Magowar Road Girraween NSW 2145 +61 2 9900 8400 NATA# 1261 Site# 18217	Canberra Unit 1,2 Dacre Street Mitchell ACT 2911 +61 2 6113 8091 NATA# 1261 Site# 25466	Brisbane 1/21 Smallwood Place Murarrie QLD 4172 T: +61 7 3902 4600 NATA# 1261 Site# 20794 & 2780	Newcastle 1/2 Frost Drive Mayfield West NSW 2304 +61 2 4968 8448 NATA# 1261 Site# 25079	Perth 46-48 Banksia Road Welshpool WA 6106 +61 8 6253 4444 NATA# 2377 Site# 2370 & 2554	Auckland 35 O'Rorke Road Penrose, Auckland 1061 IANZ# 1327	Auckland (Focus) Unit C1/4 Pacific Rise, Mount Wellington, Auckland 1061 +64 9 525 0568 IANZ# 1308	Christchurch 43 Detroit Drive Rolleston, Christchurch 7675 +64 3 343 5201 IANZ# 1290	Tauranga 1277 Cameron Road, Gate Pa, Tauranga 3112 +64 9 525 0568 IANZ# 1402
---	--	--	--	---	--	--	---	--	--	--

Company Name: JBS & G Australia (NSW) P/L
Address: Level 8, 179 Elizabeth St
 Sydney
 NSW 2000

Project Name: IMHC WESTMEAD
Project ID: 65686

Order No.:
Report #: 1155194
Phone: 02 8245 0300
Fax:

Received: Oct 31, 2024 3:47 PM
Due: Oct 31, 2024
Priority: Same day
Contact Name: Milad Noujaim

Eurofins Analytical Services Manager : Andrew Black

Sample Detail						Asbestos Fibre Count & Concentration
Sydney Laboratory - NATA # 1261 Site # 18217						X
External Laboratory						
No	Sample ID	Sample Date	Sampling Time	Matrix	LAB ID	
1	DJ633957	Oct 31, 2024	3:08PM	Air	S24-Oc0084777	X
2	DJ634016	Oct 31, 2024	3:10PM	Air	S24-Oc0084778	X
3	DJ634019	Oct 31, 2024	3:12PM	Air	S24-Oc0084779	X
4	DJ633995	Oct 31, 2024	3:15PM	Air	S24-Oc0084780	X
5	DJ634037	Oct 31, 2024	3:17PM	Air	S24-Oc0084781	X
6	DJ634124	Oct 31, 2024	3:19PM	Air	S24-Oc0084782	X
7	DJ633960	Oct 31, 2024		Air	S24-Oc0084783	X
Test Counts						7

Internal Quality Control Review and Glossary General

1. QC data may be available on request.
2. All soil results are reported on a dry basis, unless otherwise stated.
3. Samples were analysed on an 'as received' basis.
4. Information identified on this report with the colour **blue** indicates data provided by customer that may have an impact on the results.
5. This report replaces any interim results previously issued.

Holding Times

Please refer to the most recent version of the 'Sample Preservation and Container Guide' for holding times (QS3001).

Units

% w/w:	Percentage weight-for-weight basis, e.g. of asbestos in asbestos-containing finds in soil samples (% w/w)
F/fld	Airborne fibre filter loading as Fibres (N) per Fields counted (n)
F/mL	Airborne fibre reported concentration as Fibres per millilitre of air drawn over the sampler membrane (C)
g, kg	Mass, e.g. of whole sample (M) or asbestos-containing find within the sample (m)
g/kg	Concentration in grams per kilogram
L, mL	Volume, e.g. of air as measured in AFM (V = r x t)
L/min	Airborne fibre sampling Flowrate as litres per minute of air drawn over the sampler membrane (r)
min	Time (t), e.g. of air sample collection period

Calculations

Airborne Fibre Concentration: $C = \left(\frac{A}{a}\right) \times \left(\frac{N}{n}\right) \times \left(\frac{1}{r}\right) \times \left(\frac{1}{t}\right) = K \times \left(\frac{N}{n}\right) \times \left(\frac{1}{V}\right)$

Asbestos Content (as asbestos): $\% w/w = \frac{(m \times P_A)}{M}$

Weighted Average (of asbestos): $\%_{WA} = \frac{\sum (m \times P_A) \times x}{x}$

Terms

%asbestos

Estimated percentage of asbestos in a given matrix may be derived from knowledge or experience of the material, informed by HSG264 *Appendix 2*, else assumed to be 15% in accordance with WA DOH *Appendix 2 (PA)*. This estimate is not NATA-accredited.

ACM

Asbestos Containing Materials. Asbestos contained within a non-asbestos matrix, typically presented in bonded (non-friable) condition. For the purposes of the NEPM and WA DOH, ACM corresponds to material larger than 7 mm x 7 mm.

AF

Asbestos Fines. Asbestos contamination within a soil sample, as defined by WA DOH. Includes loose fibre bundles and small pieces of friable and non-friable material such as asbestos cement fragments mixed with soil. Considered under the NEPM as equivalent to "non-bonded / friable".

AFM

Airborne Fibre Monitoring, e.g., by the MFM.

Amosite

Amosite Asbestos Detected. Amosite may also refer to Fibrous Grunerite or Brown Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.

AS

Australian Standard.

Asbestos Content (as asbestos) Total %w/w asbestos content in asbestos-containing finds in a soil sample (**% w/w**).

Chrysotile

Chrysotile Asbestos Detected. Chrysotile may also refer to Fibrous Serpentine or White Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

COC

Chain of Custody.

Crocidolite

Crocidolite Asbestos Detected. Crocidolite may also refer to Fibrous Riebeckite or Blue Asbestos. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Dry

Sample is dried by heating prior to analysis.

DS

Dispersion Staining. Technique required for unequivocal Identification of asbestos fibres by PLM.

FA

Fibrous Asbestos. Asbestos-containing material that is wholly or in part friable, including materials with higher asbestos content with a propensity to become friable with handling, and any material that was previously non-friable and in a severely degraded condition. For the purposes of the NEPM and WA DOH, FA generally corresponds to material larger than 7 mm x 7 mm, although FA may be more difficult to distinguish visibly and may be assessed as AF.

Fibre Count

Total of all fibres (whether asbestos or not) meeting the counting criteria set out in the NOHSC:3003

Fibre ID

Fibre Identification. Unequivocal identification of asbestos fibres according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. Includes Chrysotile, Amosite (Grunerite) or Crocidolite asbestos.

Friable

Asbestos-containing materials of any size that may be broken or crumbled by hand pressure. For the purposes of the NEPM, this includes both AF and FA. It is outside of the laboratory's remit to assess the degree of friability.

HSG248

UK HSE HSG248, *Asbestos: The Analysts Guide*, 2nd Edition (2021), ISBN: 9780616667079.

HSG264

UK HSE HSG264, *Asbestos: The Survey Guide* (2012), ISBN: 9780717665020

ISO (also ISO/IEC)

International Organization for Standardization / International Electrotechnical Commission.

K Factor

Microscope constant (**K**) as derived from the effective filter area of the given AFM membrane used for collecting the sample (**A**) and the projected eyepiece graticule area of the specific microscope used for the analysis (**a**).

LOR

Limit of Reporting.

MFM (also NOHSC:3003)

Membrane Filter Method. As described by the Australian Government National Occupational Health and Safety Commission, *Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres*, 2nd Edition [NOHSC:3003(2005)].

MMVF

Man-Made Vitreous Fibre - exhibiting isotropic characteristics, including glass fibres, glass wool, rock wool, slag wool, ceramic fibres and "bio-soluble fibres". NOTE: previously known as "synthetic mineral fibre" (SMF).

NEPM (also ASC NEPM)

National Environment Protection (Assessment of Site Contamination) Measure, (2013, as amended).

Organic

Organic Fibres Detected. Organic may refer to Natural or Man-Made Polymeric Fibres. Identified in accordance with AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

PCM

Phase Contrast Microscopy. This is used for fibre counting according to the MFM.

PLM

Polarised Light Microscopy. As used for Fibre Identification and Trace Analysis according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004..

Sampling

Unless otherwise stated, Eurofins are not responsible for sampling equipment or the sampling process.

SRA

Sample Receipt Advice.

Trace Analysis

An analytical procedure is used to detect the presence of respirable fibres (particularly asbestos) in a given sample matrix.

UK HSE HSG

United Kingdom, Health and Safety Executive, Health and Safety Guidance, publication.

UMF

Unidentified Mineral Fibre Detected. Fibrous minerals that are detected but have not been unequivocally identified by PLM with DS according to AS 5370:2024* Sampling and qualitative identification of asbestos in bulk materials (ISO 22262-1:2012, MOD), formerly AS 4964-2004.. It may include (but is not limited to) actinolite, anthophyllite, or tremolite asbestos.

WA DOH

Reference document for the NEPM. Government of Western Australia, *Guidelines for the Assessment, Remediation and Management of Asbestos-Contaminated Sites in Western Australia* (updated 2021), including Appendix Four: *Laboratory analysis*

Weighted Average

Combined average %w/w asbestos content of all asbestos-containing finds in the given aliquot or total soil sample (**%_{WA}**).

Comments

Volume Measurement : David Edwards-Davis, JBS & G Australia (NSW) P/L, has been trained by Eurofins and they conducted the sampling in accordance with the National Occupational Health & Safety Commission - Guidance Note on The Membrane Filter Method For Estimating Airborne Asbestos Fibres 2nd Edition [NOHSC:3003(2005)] methodology. Sampling pumps used by JBS & G Australia (NSW) P/L were calibrated by Eurofins Environment Testing and therefore volume measurements contained in this report are traceable back to Eurofins Environment Testing. Eurofins Environment Testing are responsible for all data contained in this report.

Sample Integrity

Custody Seals Intact (if used)	N/A
Attempt to Chill was evident	N/A
Sample correctly preserved	Yes
Appropriate sample containers have been used	Yes
Sample containers for volatile analysis received with minimal headspace	Yes
Samples received within HoldingTime	Yes
Some samples have been subcontracted	No

Asbestos Counter/Identifier:

Sayeed Abu Senior Analyst-Asbestos

Authorised by:

Chamath JHM Annakkage Senior Analyst-Asbestos



Glenn Jackson
Managing Director

Final Report – this report replaces any previously issued Report


- Indicates Not Requested

* Indicates NATA accreditation does not cover the performance of this service

Measurement uncertainty of test data is available on request or please [click here](#).

Eurofins shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Eurofins be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested. Unless indicated otherwise, the tests were performed on the samples as received.

2 Daily Sample Locations

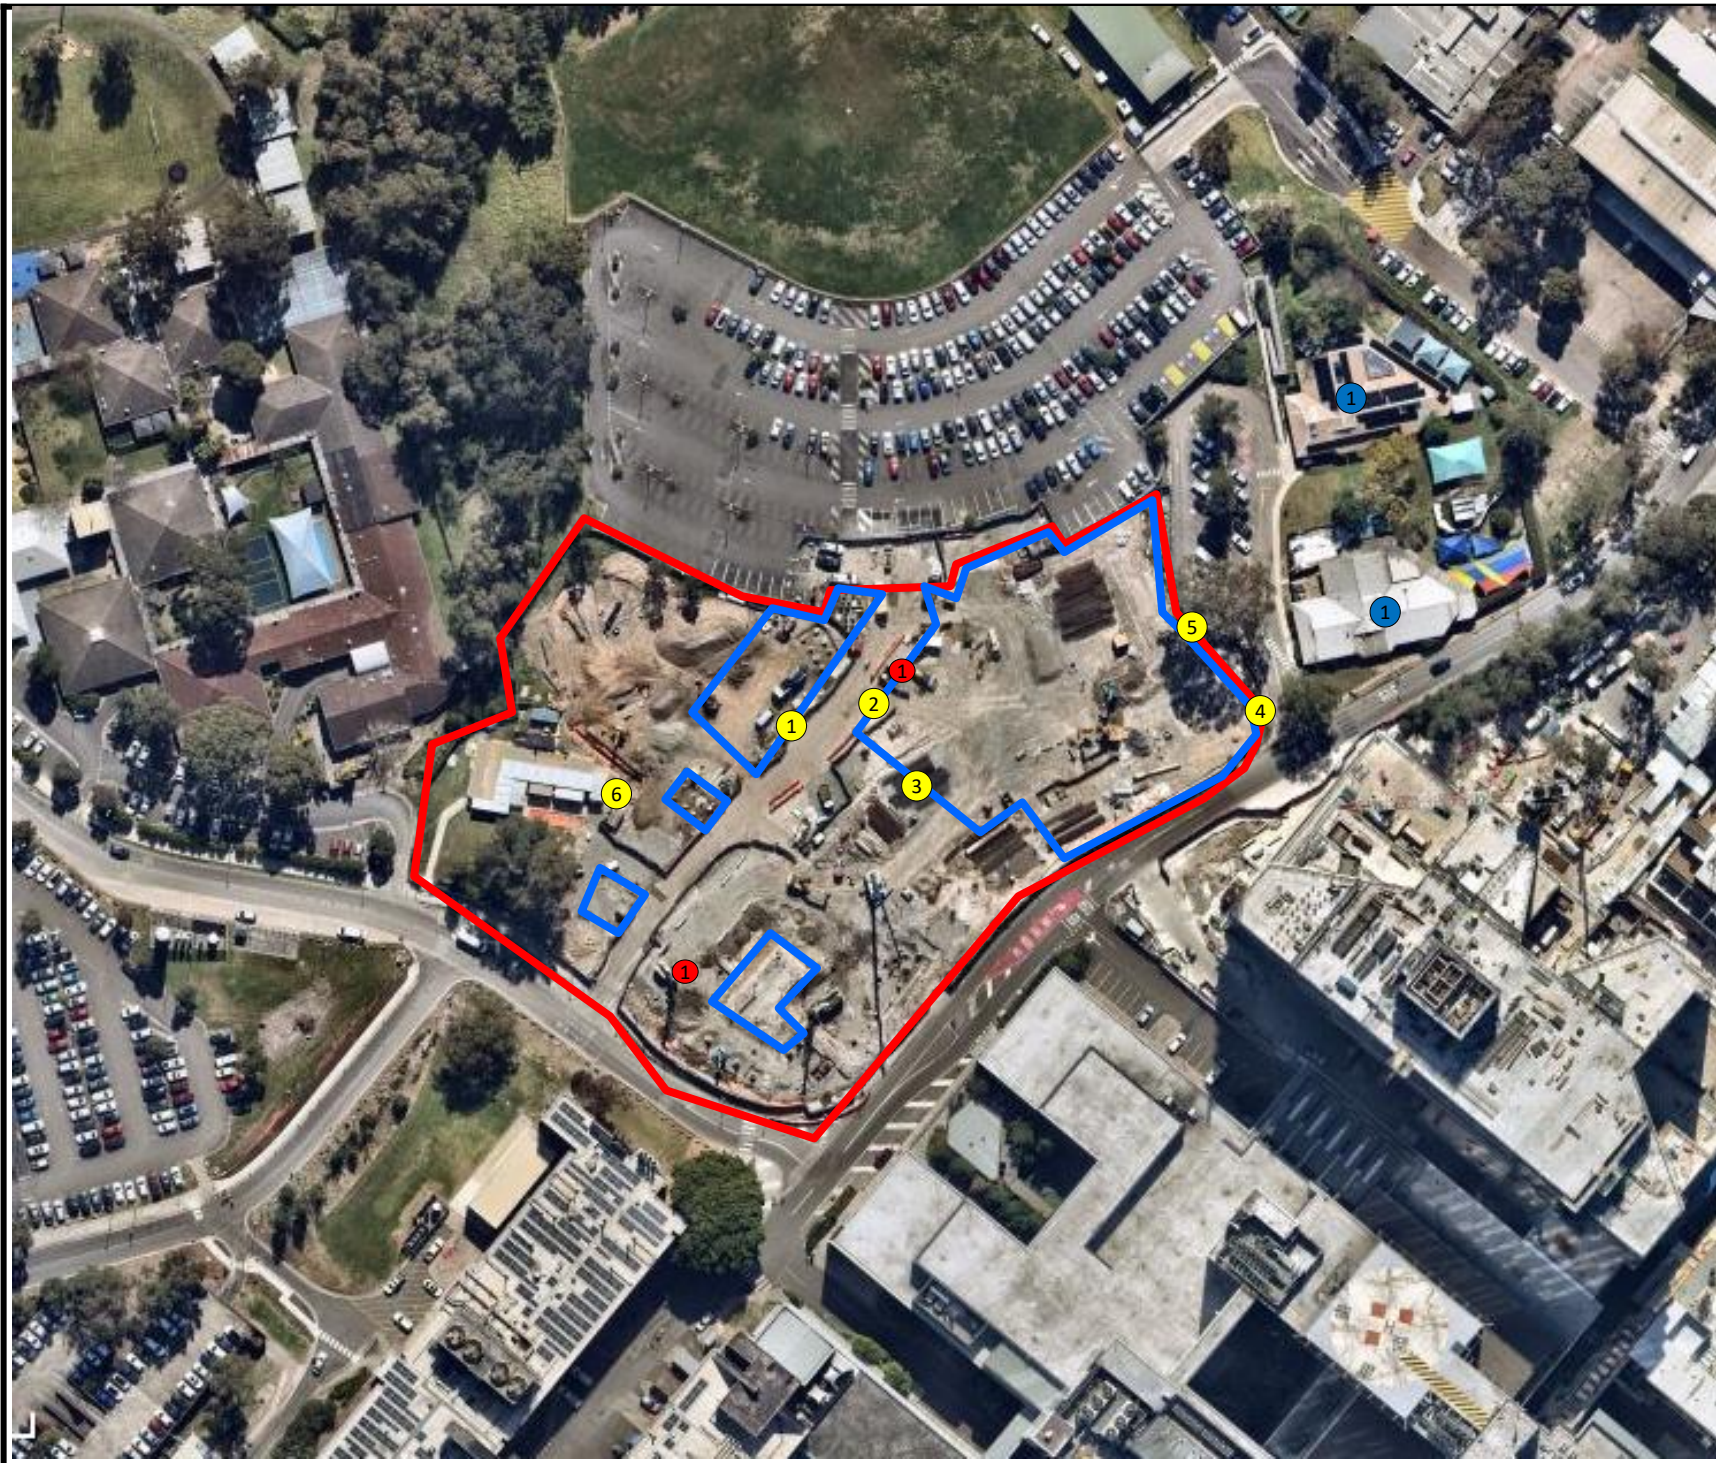

Legend:

- Approximate Site Boundary
- Approximate Exclusion Zone
- # Asbestos Air Monitoring Pumps
- ① Decontamination Unit
- ① Childcare Centre



Job No: 65686

Client: Cherrie Civil Engineering Pty Ltd

Version: Rev A

Date: 31/10/2024

Drawn By: DED

Checked By: JP



IMHC Westmead

FIGURE 1