

## TEST REPORT

August 06, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	5 Filters
Date of Sampling:	05/08/24
Date of Analysis:	06/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory

**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1079	Abi Civil – Redevelopment Works – Location 1	0702	1526	504	2.0	100	0	<0.01
70836 – 1080	Abi Civil – Redevelopment Works – Location 2	0703	1527	504	2.0	100	0	<0.01
70836 – 1081	Boone & Willard – Redevelopment Works – Location 3	0704	1528	504	2.0	100	0	<0.01
70836 – 1082	Quick – Redevelopment Works – Location 5	0706	1529	503	2.0	100	1	<0.01
70836 – 1083	Stowe – Redevelopment Works – Location 5	0709	1530	501	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full



## TEST REPORT

August 07, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	5 Filters
Date of Sampling:	06/08/24
Date of Analysis:	07/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory

**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1084	Abi Civil – Redevelopment Works – Location 1	0659	1530	511	2.0	100	0	<0.01
70836 – 1085	Abi Civil – Redevelopment Works – Location 2	0700	1531	511	2.0	100	0	<0.01
70836 – 1086	Boone & Willard – Redevelopment Works – Location 3	0701	1532	511	2.0	100	2	<0.01
70836 – 1087	Quick – Redevelopment Works – Location 5	0702	1533	511	2.0	100	0	<0.01
70836 – 1088	Stowe – Redevelopment Works – Location 5	0703	1534	511	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



## TEST REPORT

August 08, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	5 Filters
Date of Sampling:	07/08/24
Date of Analysis:	08/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory

**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1089	Abi Civil – Redevelopment Works – Location 1	0703	1530	507	2.0	100	1	<0.01
70836 – 1090	Abi Civil – Redevelopment Works – Location 2	0704	1533	509	2.0	100	0	<0.01
70836 – 1091	Boone & Willard – Redevelopment Works – Location 3	0707	1533	506	2.0	100	2	<0.01
70836 – 1092	Quick – Redevelopment Works – Location 5	0708	1536	508	2.0	100	0	<0.01
70836 – 1093	Stowe – Redevelopment Works – Location 5	0709	1537	508	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe’s findings at the time of its intervention only and within the limits of Client’s instructions, if any. The Airsafe’s sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA’s accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full





## TEST REPORT

August 09, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	5 Filters
Date of Sampling:	08/08/24
Date of Analysis:	09/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory

**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1094	Abi Civil – Redevelopment Works – Location 1	0648	1551	543	2.0	100	0	<0.01
70836 – 1095	Abi Civil – Redevelopment Works – Location 2	0647	1552	545	2.0	100	0	<0.01
70836 – 1096	Boone & Willard – Redevelopment Works – Location 3	0646	1553	547	2.0	100	0	<0.01
70836 – 1097	Quick – Redevelopment Works – Location 5	0645	1554	549	2.0	100	0	<0.01
70836 – 1098	Stowe – Redevelopment Works – Location 5	0644	1555	551	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full



## TEST REPORT

August 12, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	5 Filters
Date of Sampling:	09/08/24
Date of Analysis:	12/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory

**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1099	Abi Civil – Redevelopment Works – Location 1	0709	1550	521	2.0	100	0	<0.01
70836 – 1100	Abi Civil – Redevelopment Works – Location 2	0708	1550	522	2.0	100	0	<0.01
70836 – 1101	Boone & Willard – Redevelopment Works – Location 3	0707	1551	524	2.0	100	0	<0.01
70836 – 1102	Quick – Redevelopment Works – Location 5	0706	1552	526	2.0	100	0	<0.01
70836 – 1103	Stowe – Redevelopment Works – Location 5	0704	1553	529	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full



## TEST REPORT

August 13, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	5 Filters
Date of Sampling:	12/08/24
Date of Analysis:	13/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory



**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1104	Abi Civil – Redevelopment Works – Location 1	0650	1540	530	2.0	100	0	<0.01
70836 – 1105	Abi Civil – Redevelopment Works – Location 2	0652	1541	529	2.0	100	0	<0.01
70836 – 1106	Boone & Willard – Redevelopment Works – Location 3	0654	1542	528	2.0	100	0	<0.01
70836 – 1107	Quick – Redevelopment Works – Location 4	0655	1543	528	2.0	100	1	<0.01
70836 – 1108	Stowe – Redevelopment Works – Location 5	0657	1544	527	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full



## TEST REPORT

August 14, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	5 Filters
Date of Sampling:	13/08/24
Date of Analysis:	14/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory

**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1109	Abi Civil – Redevelopment Works – Location 1	0649	1543	534	2.0	100	0	<0.01
70836 – 1110	Abi Civil – Redevelopment Works – Location 2	0651	1544	533	2.0	100	0	<0.01
70836 – 1111	Boone & Willard – Redevelopment Works – Location 3	0651	1545	534	2.0	100	2	<0.01
70836 – 1112	Quick – Redevelopment Works – Location 4	0653	1546	533	2.0	100	0	<0.01
70836 – 1113	Stowe – Redevelopment Works – Location 5	0655	1547	532	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full

## SITE MAP

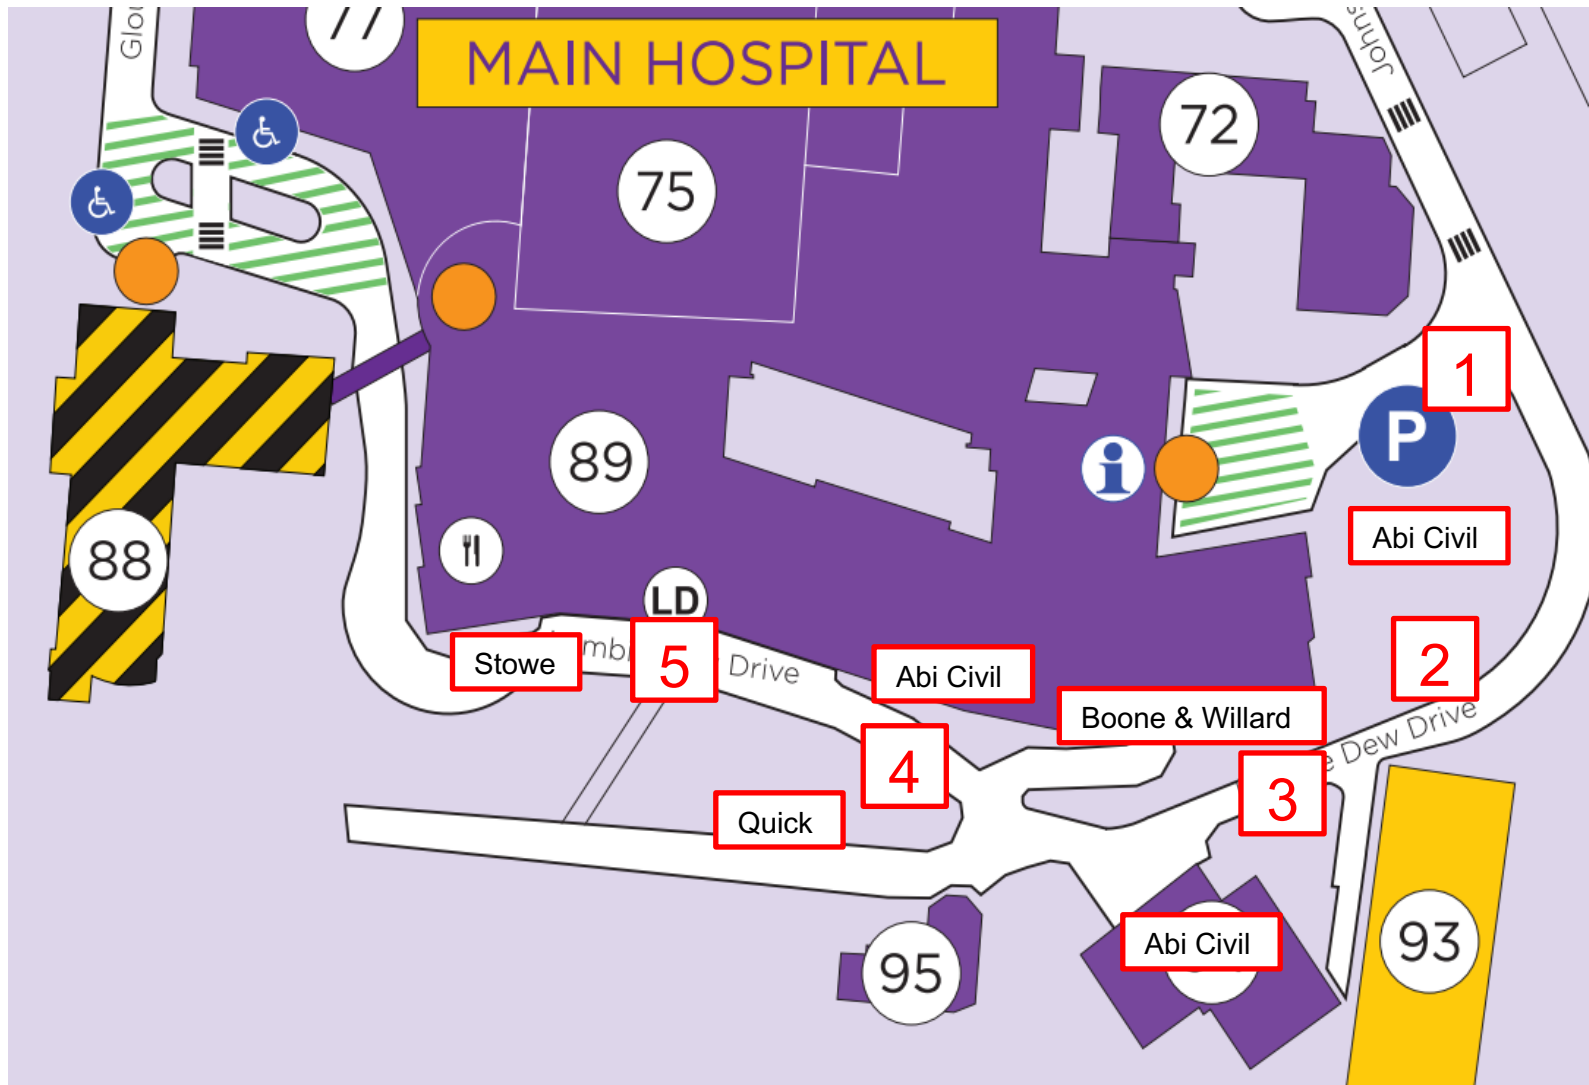


Figure 1. Air Monitoring Location.

## TEST REPORT

August 15, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	14/08/24
Date of Analysis:	15/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory

**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1114	Redevelopment Works – Location 1	0712	1542	510	2.0	100	0	<0.01
70836 – 1115	Redevelopment Works – Location 2	0713	1543	510	2.0	100	0	<0.01
70836 – 1116	Redevelopment Works – Location 3	0715	1545	510	2.0	100	0	<0.01
70836 – 1117	Red4velopment Works – Location 4	0724	1548	504	2.0	100	0	<0.01
70836 – 1118	Redevelopment Works – Location 5	0730	1549	499	2.0	100	0	<0.01
70836 – 1119	Redevelopment Works – Location 6	0750	1551	481	2.0	100	1	<0.01
70836 – 1120	Redevelopment Works – Location 7	0754	1554	480	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

## SITE MAP

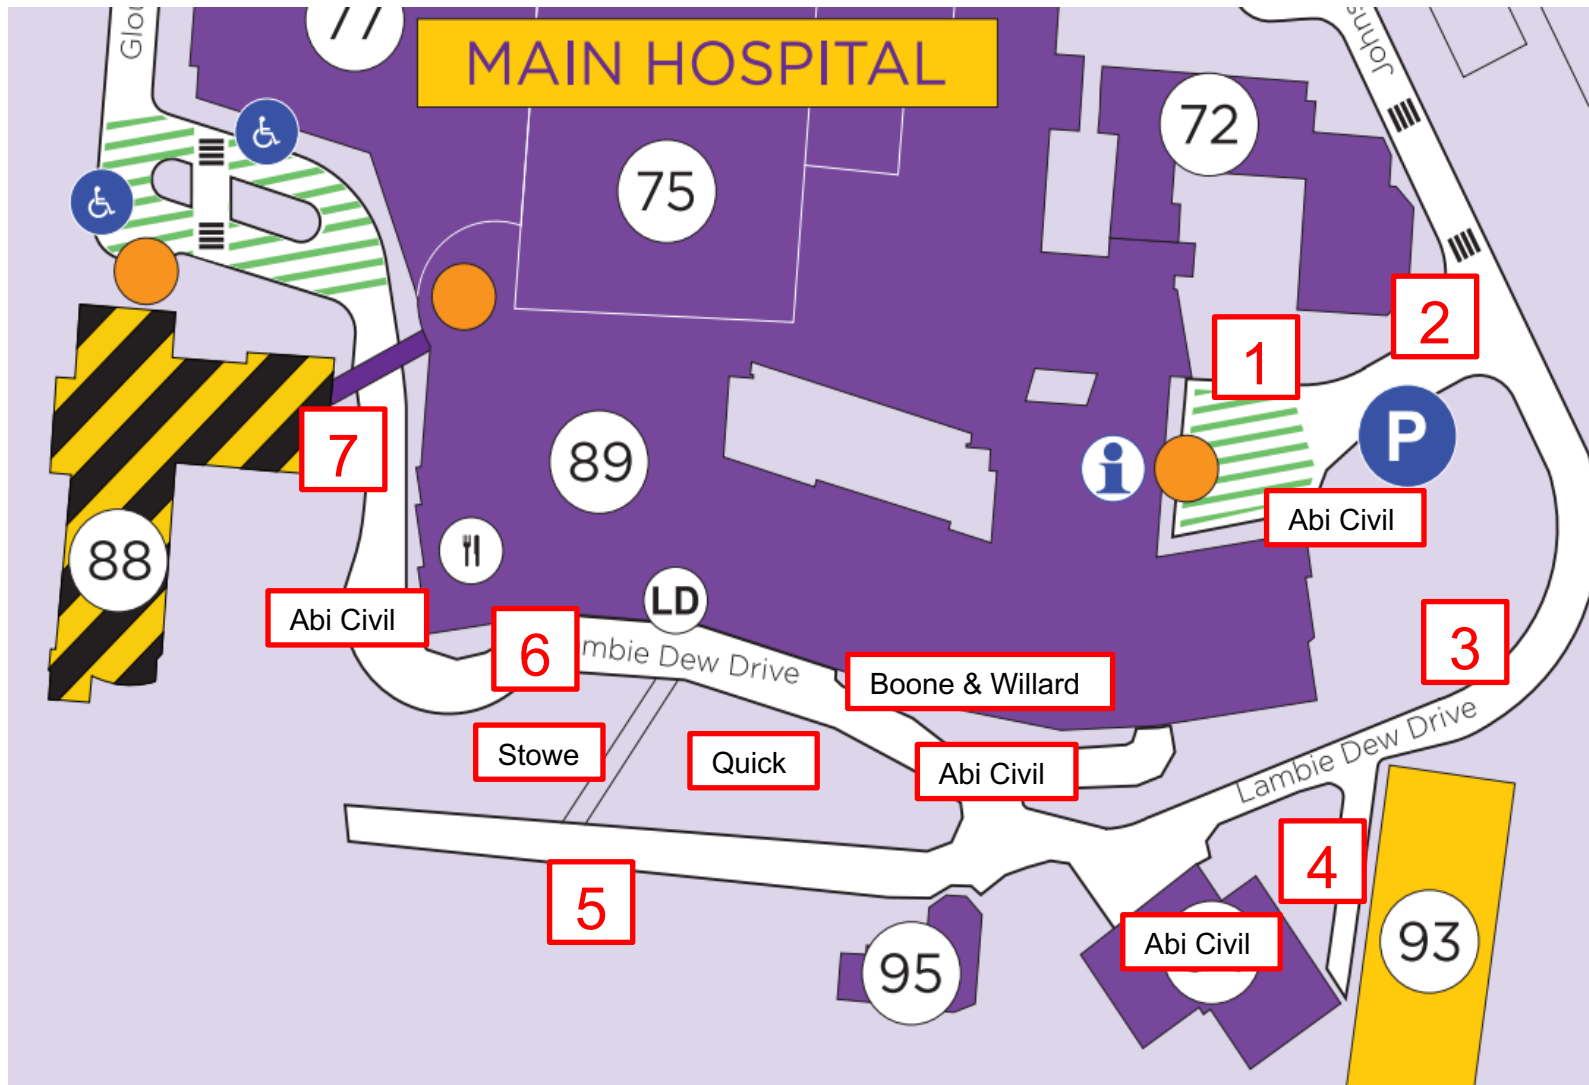


Figure 1. Air Monitoring Location.



## TEST REPORT

August 16, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	15/08/24
Date of Analysis:	16/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory

**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1121	Redevelopment Works – Location 1	0711	1614	543	2.0	100	0	<0.01
70836 – 1122	Redevelopment Works – Location 2	0714	1616	542	2.0	100	0	<0.01
70836 – 1123	Redevelopment Works – Location 3	0715	1622	547	2.0	100	0	<0.01
70836 – 1124	Red4velopment Works – Location 4	0717	1623	546	2.0	100	1	<0.01
70836 – 1125	Redevelopment Works – Location 5	0720	1619	539	2.0	100	0	<0.01
70836 – 1126	Redevelopment Works – Location 6	0733	1610	517	2.0	100	0	<0.01
70836 – 1127	Redevelopment Works – Location 7	0735	1609	514	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

## SITE MAP

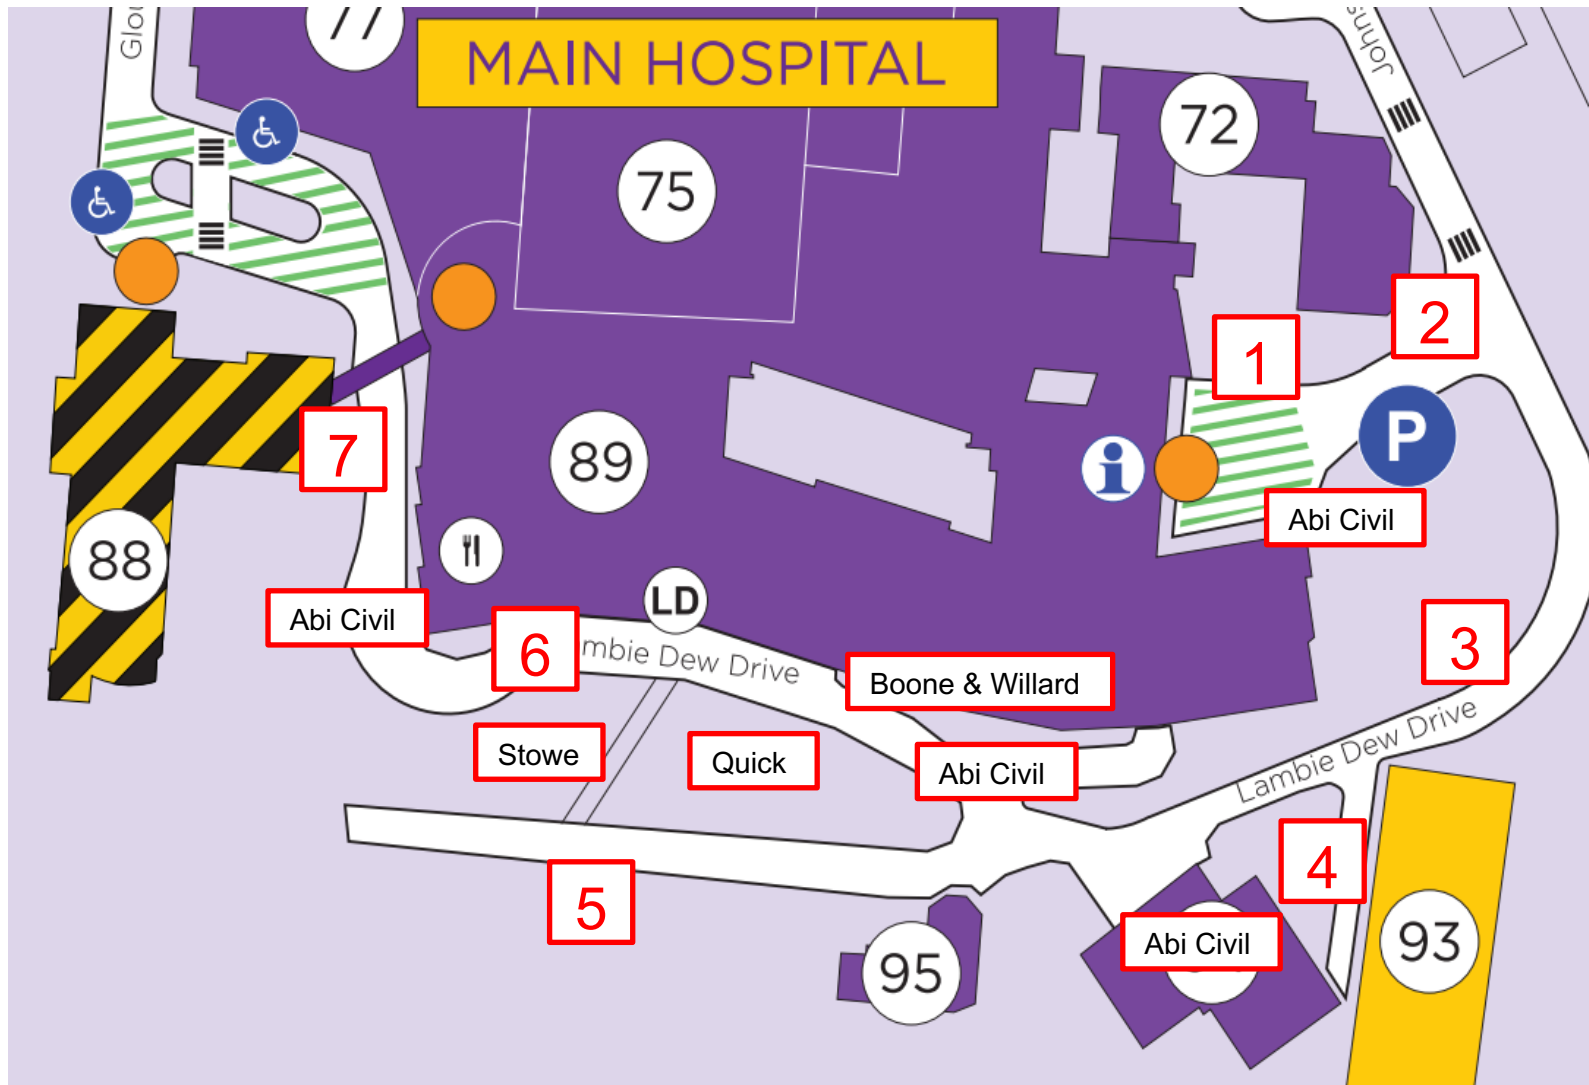


Figure 1. Air Monitoring Location.

## TEST REPORT

August 19, 2024

**Australasian Technical Services (NSW) Pty Ltd**  
9 Phiney Place  
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works  
Job Number: 70836

**Attention:** Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	16/08/24
Date of Analysis:	19/08/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully  
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens  
Approved Counter and Signatory

**PROJECT: Royal Prince Alfred Hospital – Redevelopment Works**

**JOB NO: 70836**

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 1128	Redevelopment Works – Location 1	0715	1616	541	2.0	100	0	<0.01
70836 – 1129	Redevelopment Works – Location 2	0714	1616	542	2.0	100	0	<0.01
70836 – 1130	Redevelopment Works – Location 3	0713	1623	550	2.0	100	1	<0.01
70836 – 1131	Red4velopment Works – Location 4	0711	1623	552	2.0	100	0	<0.01
70836 – 1132	Redevelopment Works – Location 5	0722	1620	538	2.0	100	1	<0.01
70836 – 1133	Redevelopment Works – Location 6	0726	1612	526	2.0	100	0	<0.01
70836 – 1134	Redevelopment Works – Location 7	0728	1611	523	2.0	100	0	<0.01

**Method:** Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

**Sampling:** All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

**Location of Laboratory Activities:** Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

**Quality Control:** A field blank is taken and analysed for each batch of samples.

**Environmental Conditions:** Background air monitoring during removal works.

**Comment:** These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

**Disclaimer:** N/A

**Sampled By:** Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

**Note:** The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

## SITE MAP

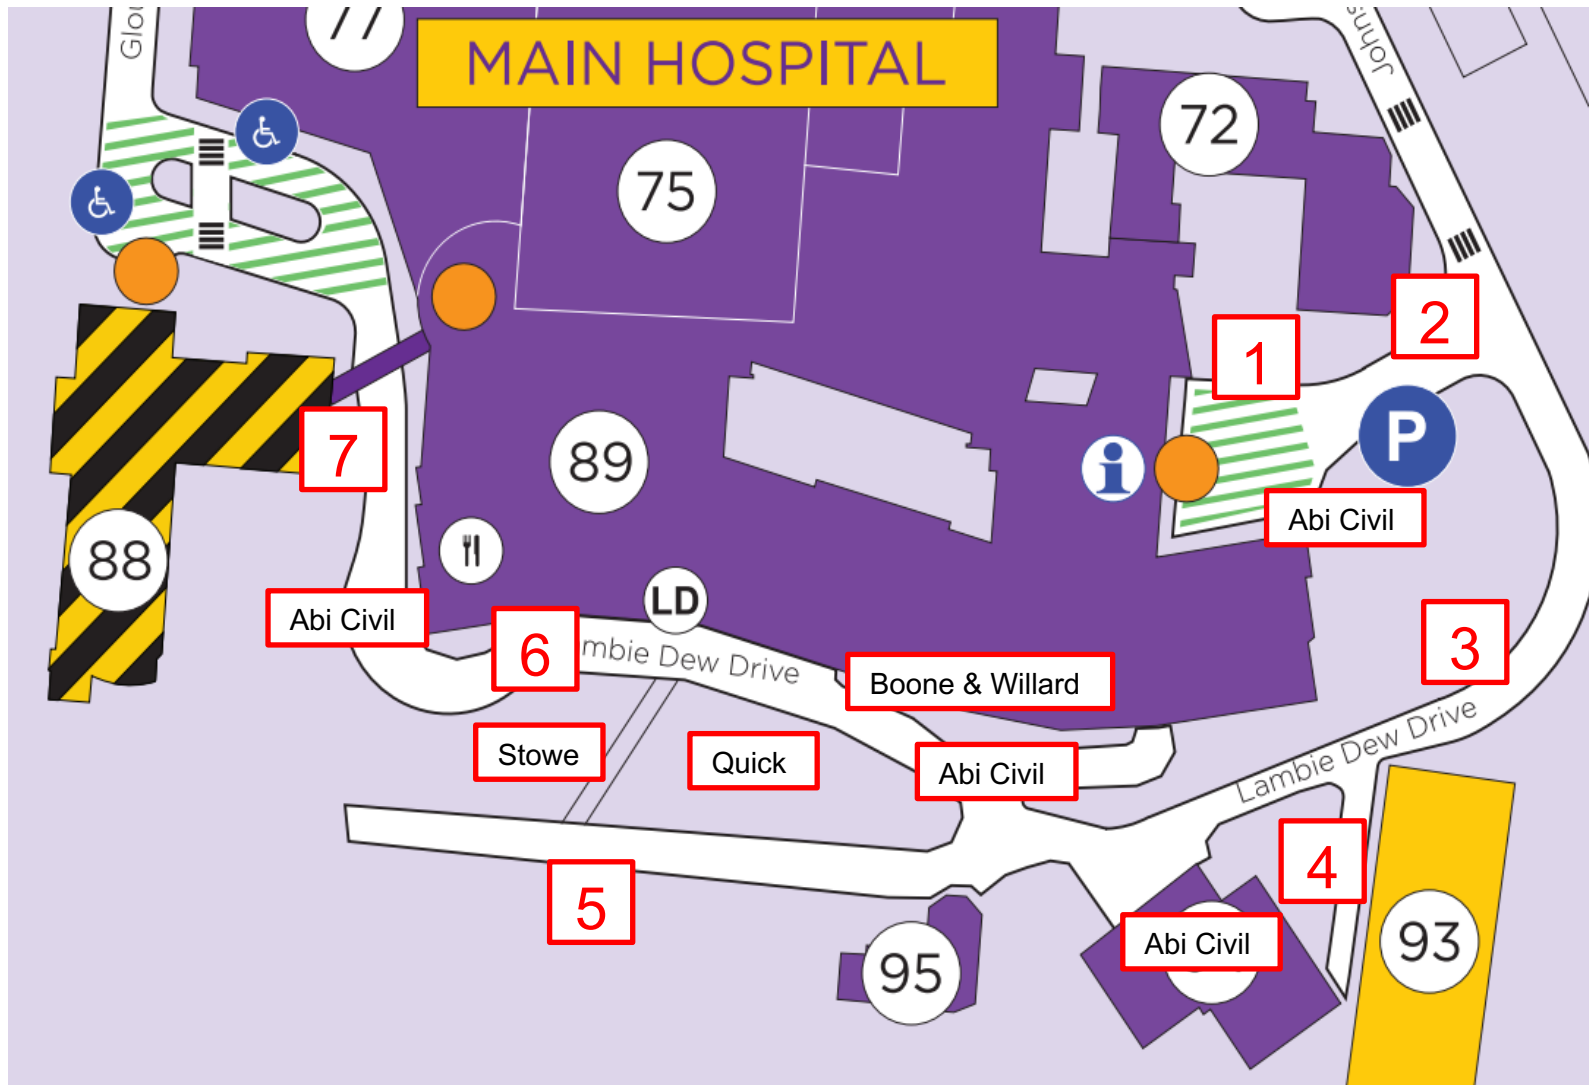


Figure 1. Air Monitoring Location.